





General Domestic

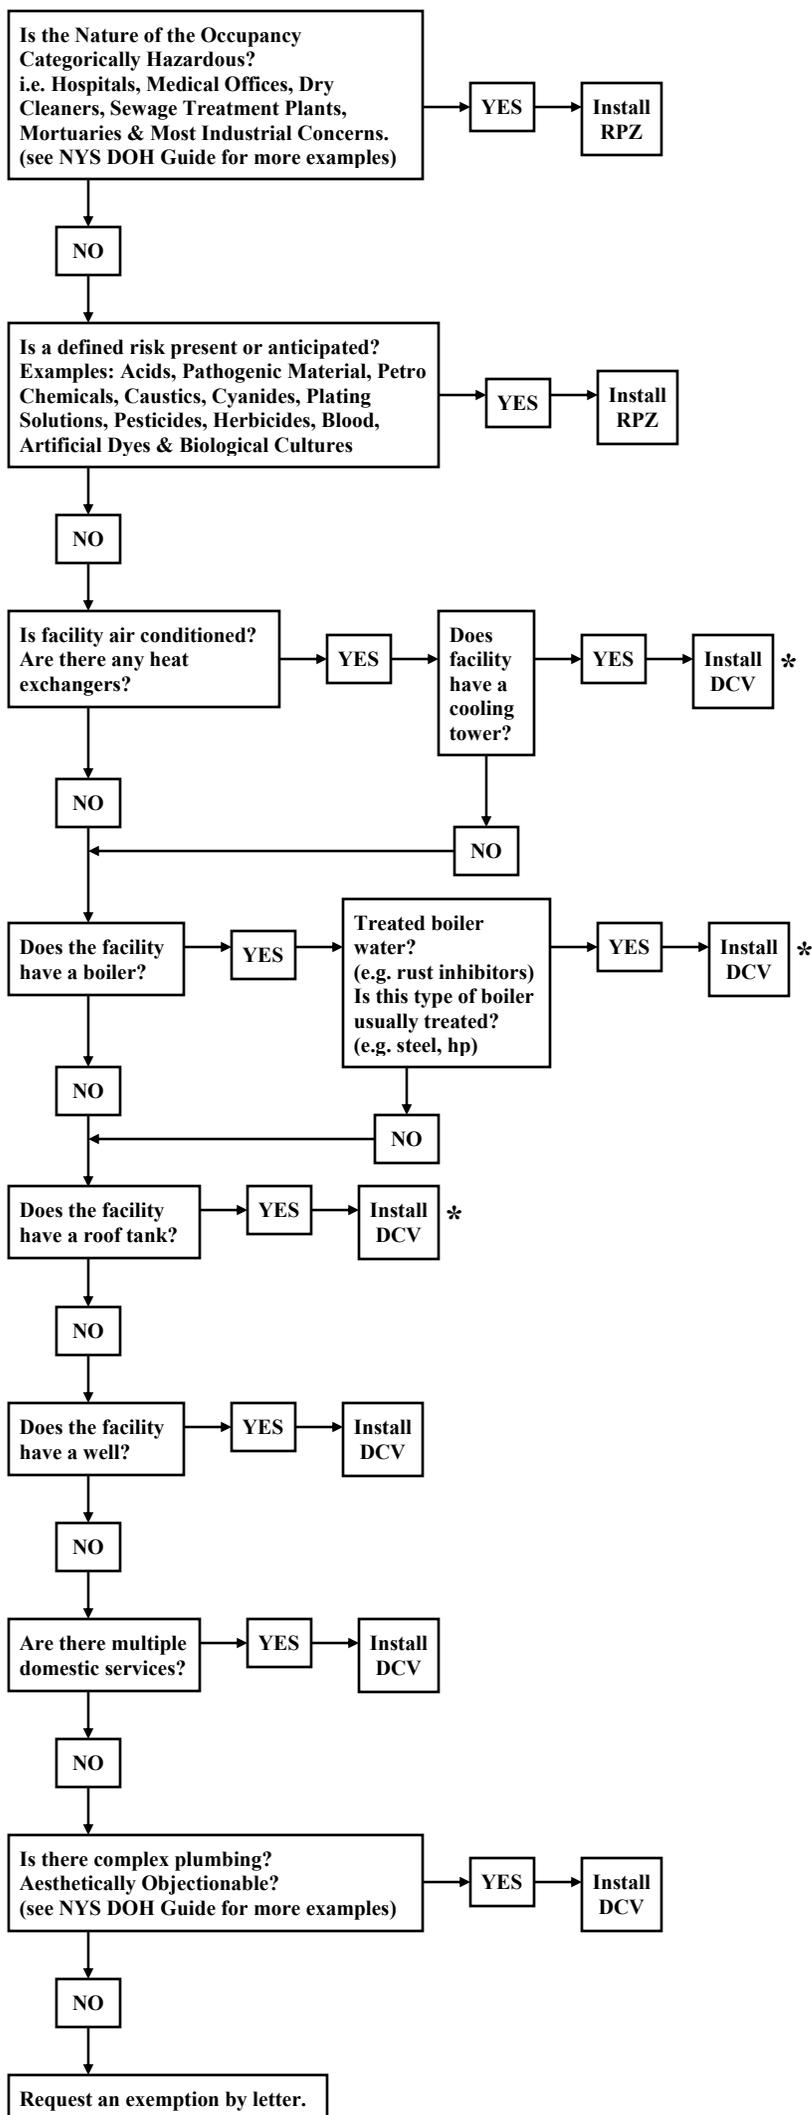

General for Fire Sprinkler/Standpipe

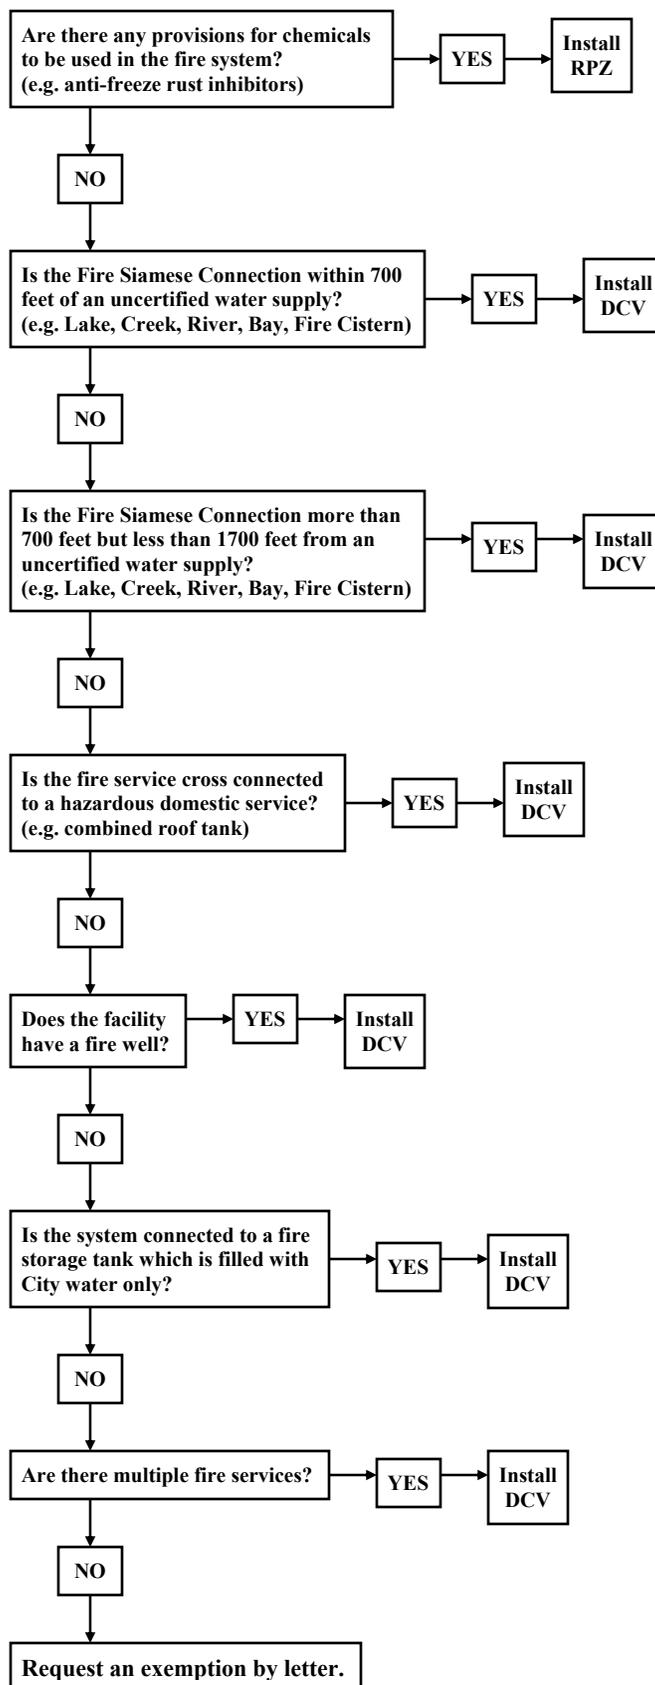

* For facilities with roof tanks, cooling towers or treated boilers, DCV's may be installed provided that internal protective devices are installed in accordance with the Department of Building requirements.

DCV = approved Double Check Valve Assembly.
RPZ = approved Reduced Pressure Zone Device.