




CROSS-CONNECTION CONTROL RISK ASSESSMENT CHARTS

A. General Fire Sprinkler/Standpipe System

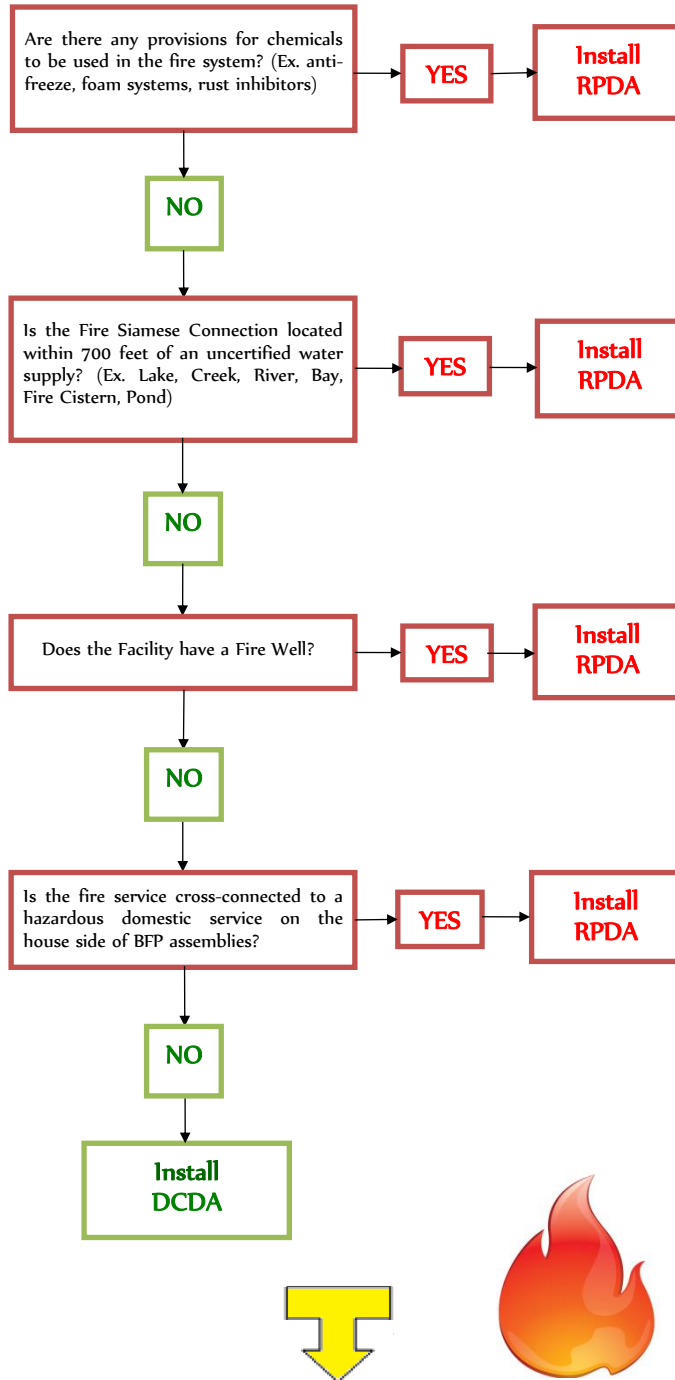

DCDA = approved “Double Check Detector Assembly”
RPDA = approved “Reduced Pressure Detector Assembly”

B. General Domestic Water System

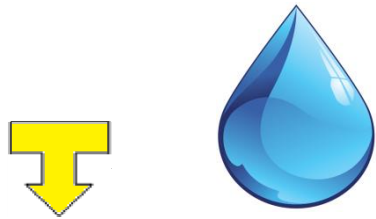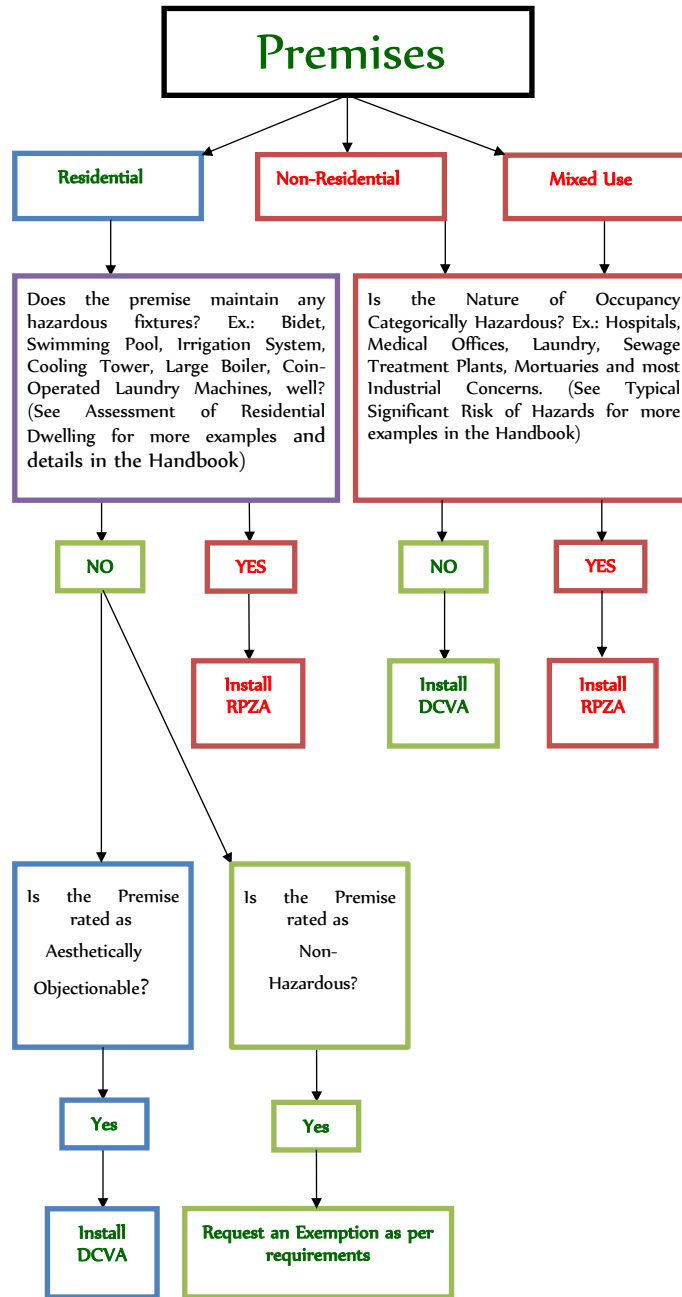

DCVA = approved "Double Check Valve Assembly"
RPZA = approved "Reduced Pressure Zone Assembly"