



October 10, 2012

New York City Office of Environmental Remediation
City Voluntary Cleanup Program
c/o Shaminder Chawla
100 Gold Street, 2nd Floor
New York, NY 10038

Re: 13CVCP083M
545-551 West 48th Street & 534-542 West 49th Street
Remedial Action Work Plan (RAWP) Stipulation List

Dear Mr. Chawla:

Environmental Business Consultants hereby submits a remedial action work plan (rawp) stipulation list for the site to the New York City Office of Environmental Remediation (OER) on behalf of. This letter serves as an addendum to the RAWP to stipulate additional content, requirements, and procedures that will be followed during the site remediation. The contents of this list are added to the RAWP and will supersede the content in the RAWP where there is a conflict in purpose or intent. The additional requirements/procedures include the following stipulation list below:

1. The criterion attached in **Appendix 1** will be utilized if additional petroleum containing tank or vessel is identified during the remedial action or subsequent redevelopment excavation activities. All petroleum spills will be reported to the NYSDEC hotline as required by applicable laws and regulations. This contingency plan is designed for heating oil tanks and other small or moderately sized storage vessels. If larger tanks, such as gasoline storage tanks are identified, OER will be notified before this criterion is utilized.
2. A pre-construction meeting is required prior to start of remedial excavation work at the site. A pre-construction meeting will be attended by OER, the consultant, and the developer's representative or excavation/general contractor.
3. A CD containing the final RAWP including this approved Stipulation List will be placed in the library that constitutes the primary public repository for project documents.
4. Signage for the project will include a sturdy placard mounted in a publically accessible right of way to building and other permits signage will consist of the NYC VCP Information Sheet (attached **Appendix 2**) announcing the remedial action. The Information sheet will be laminated and permanently affixed to the placard.
5. This NYC VCP project involving the removal and transportation of hazardous waste may be subject to the New York state Department of Environmental Conservation's Special Assessment Tax (ECL 27-0923) and Hazardous Waste Regulatory Fees (ECL 72-00402). See DEC's website for more information: <http://www.dec.ny.gov/chemical/9099.html>.
6. The recommended Alternative removes all fill /soil at the Site to the bedrock surface. However if any soil were to remain, end-point sampling would be performed in accordance



with section 4.2 of the RAWP to evaluate the performance of the remedy with respect to attainment of Track 1 SCOs.

7. A waterproofing membrane will be installed as part of development of the building foundation, since the basement level slab will be installed below the water table surface. The waterproofing membrane will be the Preprufe 300R system as manufactured by Grace or an approved equivalent system. Preprufe 300 is a 1.2 mm (0.046 in) thick HDPE film with a pressure sensitive adhesive that bonds to poured concrete. Specifications are provided in **Appendix 3**.
8. Backfilling material must achieve Track I Unrestricted Use SCOs if Track I is achieved at the site. If a Track IV remedy is achieved, clean fill soil analytical data must be lower than Restricted Residential SCOs and Groundwater Protection Standards from Part 375. Imported Backfill Limits from DER-10 are included in **Appendix 4**.
9. The planned route on local roads for trucks leaving the Site is provided in Attachment D of the RAWP and is as follows: proceed west on W. 49th Street (1-way) 1-block to 11th Avenue, turn left onto 11th Avenue (2-way) heading south to W.40th Street. Turn left heading east on W.40th 1 block to the Lincoln tunnel entrance. Turn right onto the Lincoln tunnel entrance and proceed to the tunnel exit at Rt 495. Continue on Rt 495 to Rt 1 or Interstate 95.
10. Dewatering will be performed in full compliance with applicable laws, rules and regulations.
11. Two additional groundwater monitoring wells will be installed post-demolition of onsite buildings.

Very Truly Yours,

Environmental Business Consultants



Kevin Brussee

cc: B. Gribble, OER

Appendix 1

Generic Procedures for Management of Underground Storage Tanks identified under the NYC BCP

Prior to Tank removal, the following procedures should be followed:

- Remove all fluid to its lowest draw-off point.
- Drain and flush piping into the tank.
- Vacuum out the “tank bottom” consisting of water product and sludge.
- Dig down to the top of the tank and expose the upper half.
- Remove the fill tube and disconnect the fill, gauge, product, vent lines and pumps. Cap and plug open ends of lines.
- Temporarily plug all tank openings, complete the excavation, remove the tank and place it in a secure location.
- Render the tank safe and check the tank atmosphere to ensure that petroleum vapors have been satisfactorily purged from the tank.
- Clean tank or remove to storage yard for cleaning.
- If the tank is to be moved, it must be transported by licensed waste transporter. Plug and cap all holes prior to transport leaving a 1/8 inch vent hole located at the top of the tank during transport.
- After cleaning, the tank must be made acceptable for disposal at a scrap yard, cleaning the tanks interior with a high pressure rinse and cutting the tank in several pieces.

During the tank and pipe line removal, the following field observations should be made and recorded:

- A description and photographic documentation of the tank and pipe line condition (pitting, holes, staining, leak points, evidence of repairs, etc.).
- Examination of the excavation floor and sidewalls for physical evidence of contamination (odor, staining, sheen, etc.).
- Periodic field screening (through bucket return) of the floor and sidewalls of the excavation, with a calibrated photoionization detector (PID).

Impacted Soil Excavation Methods

The excavation of the impacted soil will be performed following the removal of the existing tanks. Soil excavation will be performed in accordance with the procedures described under Section 5.5 of Draft DER-10 as follows:

- A description and photographic documentation of the excavation.
- Examination of the excavation floor and sidewalls for physical evidence of contamination (odor, staining, sheen, etc.).
- Periodic field screening (through bucket return) of the floor and sidewalls of the excavation, with calibrated photoionization detector (PID).

Final excavation depth, length, and width will be determined in the field, and will depend on the horizontal and vertical extent of contaminated soils as identified through physical examination (PID response, odor, staining, etc.). Collection of verification samples will be performed to evaluate the success of the removal action as specified in this document.

The following procedure will be used for the excavation of impacted soil (as necessary and appropriate):

- Wear appropriate health and safety equipment as outlined in the Health and Safety Plan.
- Prior to excavation, ensure that the area is clear of utility lines or other obstructions. Lay plastic sheeting on the ground next to the area to be excavated.
- Using a rubber-tired backhoe or track mounted excavator, remove overburden soils and stockpile, or dispose of, separate from the impacted soil.
- If additional UST's are discovered, the NYSDEC will be notified and the best course of action to remove the structure should be determined in the field. This may involve the continued trenching around the perimeter to minimize its disturbance.
- If physically contaminated soil is present (e.g., staining, odors, sheen, PID response, etc.) an attempt will be made to remove it, to the extent not limited by the site boundaries or the bedrock surface. If possible, physically impacted soil will be removed using the backhoe or excavator, segregated from clean soils and overburden, and staged on separated dedicated plastic sheeting or live loaded into trucks from the disposal facility. Removal of the impacted soils will continue until visibly clean material is encountered and monitoring instruments indicate that no contaminants are present.
- Excavated soils which are temporarily stockpiled on-site will be covered with tarp material while disposal options are determined. Tarp will be checked on a daily basis and replaced, repaired or adjusted as needed to provide full coverage. The sheeting will be shaped and secured in such a manner as to drain runoff and direct it toward the interior of the property.

Once the site representative and regulatory personnel are satisfied with the removal effort, verification of confirmatory samples will be collected from the excavation in accordance with DER-10.



ENVIRONMENTAL BUSINESS CONSULTANTS

Appendix 2 Signage



ENVIRONMENTAL BUSINESS CONSULTANTS

1808 MIDDLE COUNTRY ROAD
RIDGE, NY 11961

PHONE 631.504.6000
FAX 631.924.2870



NYC Voluntary Cleanup Program

This property is enrolled in the New York City Voluntary Cleanup Program for environmental remediation. This is a voluntary program administered by the NYC Office of Environmental Remediation.

For more information, log on to:

www.nyc.gov/oer



If you have questions or would like more information, please contact:

Shaminder Chawla at (212) 788-8841
or email us at brownfields@cityhall.nyc.gov
545-551 West 48th Street & 534-542 West 49th Street
Site #: 13CVCP083M

Appendix 3
Waterproofing Membrane Specifications

PREPRUFE® 300R & 160R

Pre-applied waterproofing membranes that bond integrally to poured concrete for use below slabs or behind basement walls on confined sites

Description

Preprufe® 300R & 160R membranes are unique composite sheets comprising a thick HDPE film, an aggressive pressure sensitive adhesive and a weather resistant protective coating.

Unlike conventional non-adhering membranes, which are vulnerable to water ingress tracking between the unbonded membrane and structure, the unique Preprufe bond to concrete prevents ingress or migration of water around the structure.

The Preprufe R System includes:


- **Preprufe 300R**—heavy-duty grade for use below slabs and on rafts (i.e. mud slabs). Designed to accept the placing of heavy reinforcement using conventional concrete spacers.
- **Preprufe 160R**—thinner grade for blindside, zero property line applications against soil retention systems.
- **Preprufe Tape LT**—for covering cut edges, roll ends, penetrations and detailing (temperatures between 25°F (-4°C) and 86°F (+30°C)).
- **Preprufe Tape HC**—as above for use in Hot Climates (minimum 50°F (10°C)).
- **Bituthene® Liquid Membrane**—for sealing around penetrations, etc.
- **Adcor™ ES**—waterstop for joints in concrete walls and floors
- **Preprufe Tieback Covers**—preformed cover for soil retention wall tieback heads
- **Preprufe Preformed Corners**—preformed inside and outside corners

Preprufe 300R & 160R membranes are applied either horizontally to smooth prepared concrete, carton forms or well rolled and compacted earth or crushed stone substrate; or vertically to permanent formwork or adjoining structures. Concrete is then cast directly against the adhesive side of the membranes. The specially developed Preprufe adhesive layers work together to form a continuous and integral seal to the structure.

Preprufe can be returned up the inside face of slab formwork but is not recommended for conventional twin-sided formwork on walls, etc. Use Bituthene self-adhesive membrane or Procor® fluid applied membrane to walls after removal of formwork for a fully bonded system to all structural surfaces.

Advantages

- **Forms a unique continuous adhesive bond to concrete poured against it**—prevents water migration and makes it unaffected by ground settlement beneath slabs
- **Fully-adhered watertight laps** and detailing
- **Provides a barrier to water, moisture and gas**—physically isolates the structure from the surrounding ground
- **BBA Certified** for basement Grades 2, 3, & 4 to BS 8102:1990
- **Zero permeance** to moisture
- **Solar reflective**—reduced temperature gain
- **Simple and quick to install**—requiring no priming or fillets
- **Can be applied to permanent formwork**—allows maximum use of confined sites
- **Self protecting**—can be trafficked immediately after application and ready for immediate placing of reinforcement
- **Unaffected by wet conditions**—cannot activate prematurely
- **Inherently waterproof, non-reactive system:**
 - not reliant on confining pressures or hydration
 - unaffected by freeze/thaw, wet/dry cycling
- **Chemical resistant**—effective in most types of soils and waters, protects structure from salt or sulphate attack

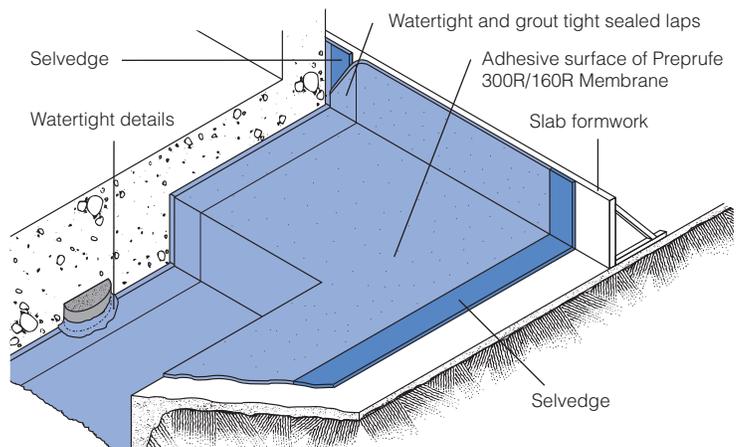

Drawings are for illustration purposes only. Please refer to graceconstruction.com for specific application details.

Installation

The most current application instructions, detail drawings and technical letters can be viewed at graceconstruction.com. For other technical information contact your local Grace representative.

Preprufe 300R & 160R membranes are supplied in rolls 4 ft (1.2 m) wide, with a selvedge on one side to provide self-adhered laps for continuity between rolls. The rolls of Preprufe Membrane and Preprufe Tape are interwound with a disposable plastic release liner which must be removed before placing reinforcement and concrete.

Substrate Preparation

All surfaces—It is essential to create a sound and solid substrate to eliminate movement during the concrete pour. Substrates must be regular and smooth with no gaps or voids greater than 0.5 in. (12 mm). Grout around all penetrations such as utility conduits, etc. for stability (see Figure 1).

Horizontal—The substrate must be free of loose aggregate and sharp protrusions. Avoid curved or rounded substrates. When installing over earth or crushed stone, ensure substrate is well compacted to avoid displacement of substrate due to traffic or concrete pour. The surface does not need to be dry, but standing water must be removed.

Vertical—Use concrete, plywood, insulation or other approved facing to sheet piling to provide support to the membrane. Board systems such as timber lagging must be close butted to provide support and not more than 0.5 in. (12 mm) out of alignment.

Membrane Installation

Preprufe can be applied at temperatures of 25°F (-4°C) or above. When installing Preprufe in cold or marginal weather conditions 55°F (<13°C) the use of Preprufe Tape LT is recommended at all laps and detailing. Preprufe Tape LT should be applied to clean, dry surfaces and the release liner must be removed immediately after application. Alternatively, Preprufe Low Temperature (LT) is available for low temperature condition applications. Refer to Preprufe LT data sheet for more information.

Horizontal substrates—Place the membrane HDPE film side to the substrate with the clear plastic release liner facing towards the concrete pour. End laps should be staggered to avoid a build up of layers. Leave plastic release liner in position until overlap procedure is completed (see Figure 2).

Accurately position succeeding sheets to overlap the previous sheet 3 in. (75 mm) along the marked selvedge. Ensure the underside of the succeeding sheet is clean, dry and free from contamination before attempting to overlap. Peel back the plastic release liner from between the overlaps as the two layers are bonded together. Ensure a continuous bond is achieved without creases and roll firmly with a heavy roller. Completely remove the plastic liner to expose the protective coating. Any initial tack will quickly disappear.

Refer to Grace Tech Letter 15 for information on suitable rebar chairs for Preprufe.

Vertical substrates—Mechanically fasten the membrane vertically using fasteners appropriate to the substrate with the clear plastic release liner facing towards the concrete pour. The membrane may be installed in any convenient length. Fastening can be made through the selvedge using a small and low profile head fastener so that the membrane lays flat and allows firmly rolled overlaps. Immediately remove the plastic release liner.

Ensure the underside of the succeeding sheet is clean, dry and free from contamination before attempting to

overlap. Roll firmly to ensure a watertight seal.

Roll ends and cut edges—Overlap all roll ends and cut edges by a minimum 3 in. (75 mm) and ensure the area is clean and free from contamination, wiping with a damp cloth if necessary. Allow to dry and apply Preprufe Tape LT (or HC in hot climates) centered over the lap edges and roll firmly (see Figure 3). Immediately remove printed plastic release liner from the tape.

Details

Refer to Preprufe Field Application Manual, Section V Application Instructions or visit graceconstruction.com. This manual gives comprehensive guidance and standard details.

Membrane Repair

Inspect the membrane before installation of reinforcement steel, formwork and final placement of concrete. The membrane can be easily cleaned by power washing if required. Repair damage by wiping the area with a damp cloth to ensure the area is clean and free from dust, and allow to dry. Repair small punctures (0.5 in. (12 mm) or less) and slices by applying Preprufe Tape centered over the damaged area and roll firmly. Remove the release liner from the tape. Repair holes and large punctures by applying a patch of Preprufe membrane, which extends 6 in. (150 mm) beyond the damaged area. Seal all edges of the patch with Preprufe Tape, remove the release liner from the tape and roll firmly. Any areas of damaged adhesive should be covered with Preprufe Tape. Remove printed plastic release liner from tape. Where exposed selvedge has lost adhesion or laps have not been sealed, ensure the area is clean and dry and cover with fresh Preprufe Tape, rolling firmly. Alternatively, use a hot air gun or similar to activate adhesive and firmly roll lap to achieve continuity.

Pouring of Concrete

Ensure the plastic release liner is removed from all areas of Preprufe membrane and tape.

It is recommended that concrete be poured within 56 days (42 days in hot climates) of application of the membrane. Following proper ACI guidelines, concrete must be placed carefully and consolidated properly to avoid damage to the membrane. Never use a sharp object to consolidate the concrete.

Removal of Formwork

Preprufe membranes can be applied to removable formwork, such as slab perimeters, elevator and lift pits, etc. Once the concrete is poured the formwork must remain in place until the concrete has gained sufficient compressive strength to develop the surface bond. Preprufe membranes are not recommended for conventional twin-sided wall forming systems.

A minimum concrete compressive strength of 1500 psi (10 N/mm²) is recommended prior to stripping formwork supporting Preprufe membranes. Premature stripping may result in displacement of the membrane and/or spalling of the concrete.

Refer to Grace Tech Letter 17 for information on removal of formwork for Preprufe.

Figure 1



Figure 2






Figure 3

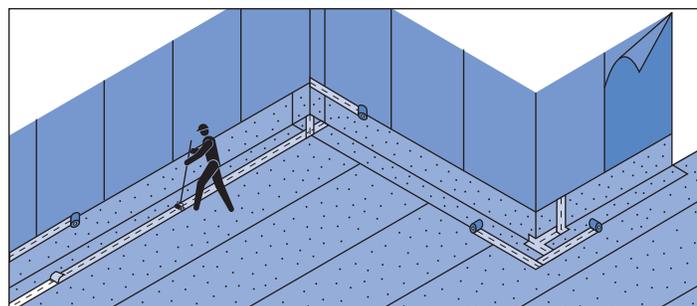


Detail Drawings


Details shown are typical illustrations and not working details. For a list of the most current details, visit us at graceconstruction.com.

For technical assistance with detailing and problem solving please call toll free at 866-333-3SBM (3726).


Wall base detail against permanent shutter

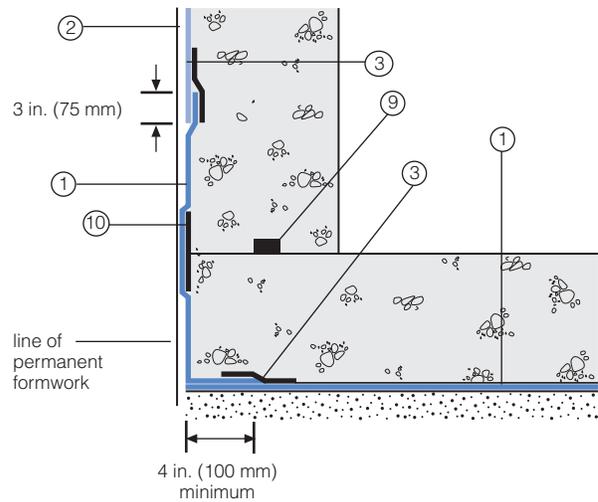


Bituthene wall base detail (Option 1)

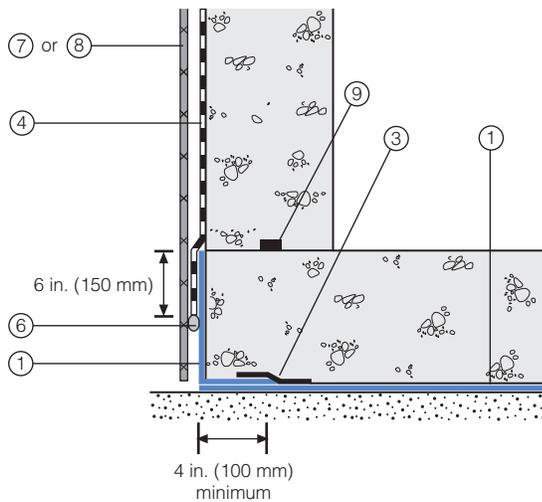


Procor wall base detail (Option 1)

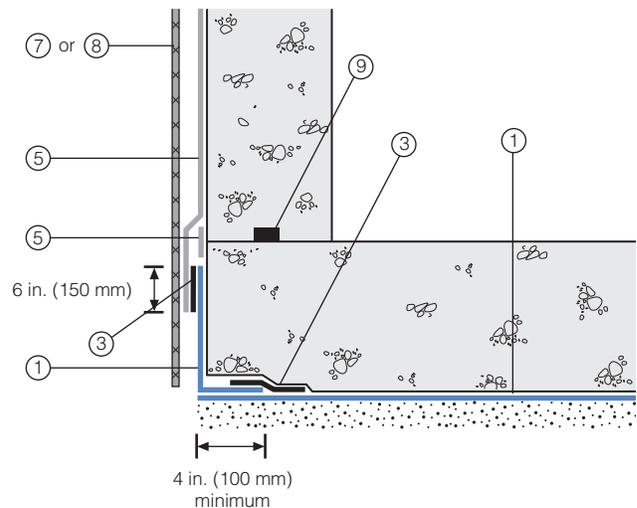

Bituthene wall base detail (Option 2)

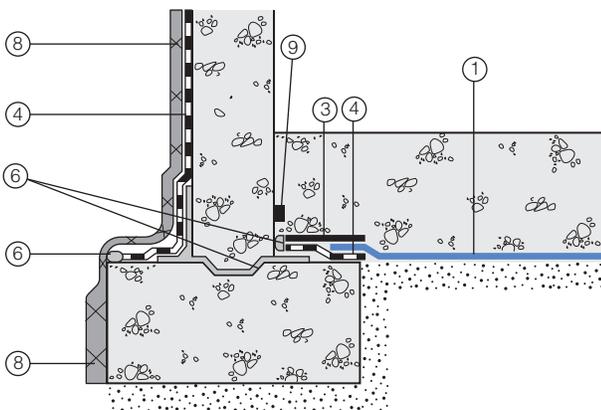

Procor wall base detail (Option 2)

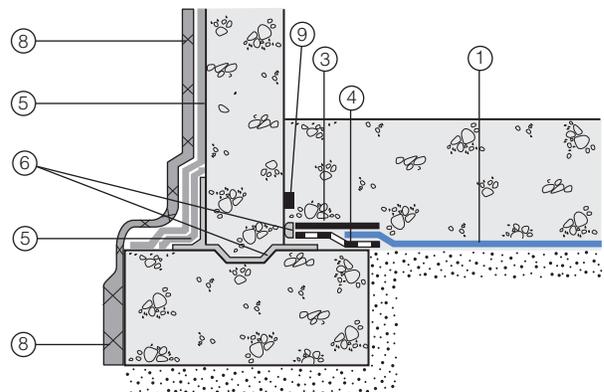

- 1 Preprufe 300R
- 2 Preprufe 160R
- 3 Preprufe Tape
- 4 Bituthene

- 5 Procor
- 6 Bituthene Liquid Membrane
- 7 Protection

- 8 Hydroduct®
- 9 Adcor ES
- 10 Preprufe CJ Tape

Supply

Dimensions (Nominal)	Preprufe 300R Membrane	Preprufe 160R Membrane	Preprufe Tape (LT or HC*)
Thickness	0.046 in. (1.2 mm)	0.032 in. (0.8 mm)	
Roll size	4 ft x 98 ft (1.2 m x 30 m)	4 ft x 115 ft (1.2 m x 35 m)	4 in. x 49 ft (100 mm x 15 m)
Roll area	392 ft ² (36 m ²)	460 ft ² (42 m ²)	
Roll weight	108 lbs (50 kg)	92 lbs (42 kg)	4.3 lbs (2 kg)
Minimum side/end laps	3 in. (75 mm)	3 in. (75 mm)	3 in. (75 mm)
* LT denotes Low Temperature (between 25°F (-4°C) and 86°F (+30°C)) HC denotes Hot Climate (50°F (>+10°C))			
Ancillary Products			
Bituthene Liquid Membrane—1.5 US gal (5.7 liter) or 4 US gal (15.1 liter)			

Physical Properties

Property	Typical Value 300R	Typical Value 160R	Test Method
Color	white	white	
Thickness	0.046 in. (1.2 mm)	0.032 in. (0.8 mm)	ASTM D3767
Lateral Water Migration Resistance	Pass at 231 ft (71 m) of hydrostatic head pressure	Pass at 231 ft (71 m) of hydrostatic head pressure	ASTM D5385, modified ¹
Low temperature flexibility	Unaffected at -20°F (-29°C)	Unaffected at -20°F (-29°C)	ASTM D1970
Resistance to hydrostatic head	231 ft (71 m)	231 ft (71 m)	ASTM D5385, modified ²
Elongation	500%	500%	ASTM D412, modified ³
Tensile strength, film	4000 psi (27.6 MPa)	4000 psi (27.6 MPa)	ASTM D412
Crack cycling at -9.4°F (-23°C), 100 cycles	Unaffected, Pass	Unaffected, Pass	ASTM C836
Puncture resistance	221 lbs (990 N)	100 lbs (445 N)	ASTM E154
Peel adhesion to concrete	5 lbs/in. (880 N/m)	5 lbs/in. (880 N/m)	ASTM D903, modified ⁴
Lap peel adhesion	5 lbs/in. (880 N/m)	5 lbs/in. (880 N/m)	ASTM D1876, modified ⁵
Permeance to water vapor transmission	0.01 perms (0.6 ng/(Pa × s × m ²))	0.01 perms (0.6 ng/(Pa × s × m ²))	ASTM E96, method B
Water absorption	0.5%	0.5%	ASTM D570

Footnotes:

- Lateral water migration resistance is tested by casting concrete against membrane with a hole and subjecting the membrane to hydrostatic head pressure with water. The test measures the resistance of lateral water migration between the concrete and the membrane.
- Hydrostatic head tests of Preprufe Membranes are performed by casting concrete against the membrane with a lap. Before the concrete cures, a 0.125 in. (3 mm) spacer is inserted perpendicular to the membrane to create a gap. The cured block is placed in a chamber where water is introduced to the membrane surface up to the head indicated.
- Elongation of membrane is run at a rate of 2 in. (50 mm) per minute.
- Concrete is cast against the protective coating surface of the membrane and allowed to properly dry (7 days minimum). Peel adhesion of membrane to concrete is measured at a rate of 2 in. (50 mm) per minute at room temperature.
- The test is conducted 15 minutes after the lap is formed (per Grace published recommendations) and run at a rate of 2 in. (50 mm) per minute.

Specification Clauses

Preprufe 300R or 160R shall be applied with its adhesive face presented to receive fresh concrete to which it will integrally bond. Only Grace Construction Products approved membranes shall be bonded to Preprufe 300R/160R. All Preprufe 300R/160R system materials shall be supplied by Grace Construction Products, and applied strictly in accordance with their instructions. Specimen performance and formatted clauses are also available.

NOTE: Use Preprufe Tape to tie-in Procor with Preprufe.

Health and Safety

Refer to relevant Material Safety data sheet. Complete rolls should be handled by a minimum of two persons.

www.graceconstruction.com

For technical assistance call toll free at 866-333-3SBM (3726)

Adcor is a trademark and Preprufe, Bituthene and Hydroduct are registered trademarks of W. R. Grace & Co.—Conn. Procor is a U.S. registered trademark of W. R. Grace & Co.—Conn., and is used in Canada under license from PROCOR LIMITED.

We hope the information here will be helpful. It is based on data and knowledge considered to be true and accurate and is offered for the users' consideration, investigation and verification, but we do not warrant the results to be obtained. Please read all statements, recommendations or suggestions in conjunction with our conditions of sale, which apply to all goods supplied by us. No statement, recommendation or suggestion is intended for any use which would infringe any patent or copyright. W. R. Grace & Co.—Conn., 62 Whittemore Avenue, Cambridge, MA 02140. In Canada, Grace Canada, Inc., 294 Clements Road, West, Ajax, Ontario, Canada L1S 3C6.

This product may be covered by patents or patents pending.
PF-111H Printed in U.S.A. 07/12

Copyright 2012. W. R. Grace & Co.—Conn.
FA/PDF

GRACE

Section 071324

Pre-Applied Sheet Membrane Waterproofing

PART 1 — GENERAL

1.01 SUMMARY

- A. The Work of this Section includes, but is not limited to, pre-applied sheet membrane waterproofing that forms an integral bond to poured concrete for the following applications:
 - 1. Vertical Applications: Membrane applied against soil retention system prior to placement of concrete foundation walls;
 - 2. Horizontal Applications: Membrane applied on prepared subbase prior to placement of concrete slabs.
- B. Related sections include, but are not limited to, the following:
 - 1. Section 031000 - Concrete Forming
 - 2. Section 312000 – Earth Moving
 - 3. Section 031500 – Concrete Accessories
 - 4. Section 031500 – Hydrophilic Waterstop
 - 5. Section 316200 - Driven Piles
 - 6. Section 316400 - Caissons
 - 1. Section 032000 - Concrete Reinforcing
 - 2. Section 033000 – Cast-In-Place Concrete

NOTE TO SPECIFIER: For vertical applications, coordinate with concrete formwork section to require one-sided wall forming system to minimize punctures to the sheet membrane waterproofing during formwork installation.

1.02 SUBMITTALS

- A. Submit manufacturer's product data, installation instructions and membrane samples for approval.

1.03 REFERENCE STANDARDS

- A. The following standards and publications are applicable to the extent referenced in the text.
- B. American Society for Testing and Materials (ASTM):
 - C 836 Standard Specification for High Solids, Cold Liquid-Applied Elastomeric Waterproofing Membrane for Use with Separate Wearing Course
 - D 412 Standard Test Methods for Rubber Properties in Tension
 - D 570 Standard Test Method for Water Absorption of Plastics
 - D 903 Standard Test Method for Peel or Stripping Strength of Adhesive Bonds
 - D 1876 Standard Test Method for Peel Release of Adhesives (T-Peel)
 - D 1970 Standard Specification for Self-Adhering Polymer Modified Bituminous Sheet Materials Used as Steep Roofing Underlayment for Ice Dam Protection

- D 3767 Standard Practice for Rubber - Measurements of Dimensions
- D 5385 Standard Test Method for Hydrostatic Pressure Resistance of Waterproofing Membranes
- E 96 Standard Test Methods for Water Vapor Transmission of Materials
- E 154 Standard Test Methods for Water Vapor Retarders Used in Contact with Earth Under Concrete Slabs, on Walls, or as Ground Cover

1.04 QUALITY ASSURANCE

- A. Manufacturer: Sheet membrane waterproofing system shall be manufactured and marketed by a firm with a minimum of 20 years experience in the production and sales of sheet membrane waterproofing. Manufacturers proposed for use but not named in these specifications shall submit evidence of ability to meet all requirements specified, and include a list of projects of similar design and complexity completed within the past 5 years.
- B. Installer: A firm which has at least 3 years experience in work of the type required by this section.
- C. Materials: For each type of material required for the work of this section, provide primary materials which are the products of one manufacturer.
- D. Pre-Installation Conference: A pre-installation conference shall be held prior to commencement of field operations to establish procedures to maintain optimum working conditions and to coordinate this work with related and adjacent work. Agenda for meeting shall include review of special details and flashing.
- E. Schedule Coordination: Schedule work such that membrane will not be left exposed to weather for longer than that recommended by the manufacturer.

1.05 DELIVERY, STORAGE AND HANDLING

- A. Deliver materials in labeled packages. Store and handle in strict compliance with manufacturer's instructions. Protect from damage from weather, excessive temperature and construction operations. Remove and dispose of damaged material in accordance with applicable regulations.

1.06 PROJECT CONDITIONS

- A. Perform work only when existing and forecasted weather conditions are within the limits established by the manufacturer of the materials used. Proceed with installation only when the substrate construction and preparation work is complete and in condition to receive sheet membrane waterproofing.

1.07 WARRANTY

- A. Sheet Membrane Waterproofing: Provide written five year material warranty issued by the membrane manufacturer upon completion of work.

PART 2 — PRODUCTS

2.01 MATERIALS

- A. Pre-applied Integrally Bonded Sheet Waterproofing Membrane: Preprufe® 300R Membrane [or Preprufe 300LT Membrane for application temperatures between 25°F (-4°C) and 60°F (+16°C)] by Grace Construction Products, a 1.2mm (0.046 in) nominal thickness composite sheet membrane comprising 0.8 mm (0.030 in.) of high density polyethylene film, and layers of specially formulated synthetic adhesive layers. The membrane shall form an integral and permanent bond to poured concrete to prevent water migration at the interface of the membrane and structural concrete. Provide membrane with the following physical properties:

NOTE TO SPECIFIER: Preprufe 300R and Preprufe 300LT can both be installed at temperatures 25°F (-4°C) and above. For temperatures 25°F (-4°C) to 55°F (13°C) Grace Technical Bulletin #16 states the use of Preprufe LT Tape is recommended at all sidelaps when using Preprufe 300R. Alternatively, contractors may elect the use of Preprufe 300LT which does not require the use of Preprufe LT Tape at sidelaps in temperature ranges 25°F (-4°C) to 55°F (13°C). For this reason, Grace suggests that both products be incorporated into the specification.

PHYSICAL PROPERTIES FOR PREPRUFE 300R (or 300LT) MEMBRANE:

Property	Test Method	Typical Value
Color		White
Thickness	ASTM D 3767 Method A	1.2 mm (0.046 in.) nominal
Lateral Water Migration Resistance	ASTM D 5385 Modified ¹	Pass at 71 m (231 ft) of hydrostatic head pressure
Low Temperature Flexibility	ASTM D 1970	Unaffected at -29°C (-20°F)
Elongation	ASTM D 412 Modified ²	500%
Crack Cycling at -23°C (-9.4°F), 100 Cycles	ASTM C 836	Unaffected, Pass
Tensile Strength, film	ASTM D 412	27.6 MPa (4,000 lbs/in. ²)
Peel Adhesion to Concrete	ASTM D 903 Modified ³	880 N/m (5.0 lbs/in.)
Lap Adhesion	ASTM D 1876 Modified ⁴	880 N/m (5.0 lbs/in.)
Resistance to Hydrostatic Head	ASTM D 5385 Modified ⁵	71 m (231 ft)
Puncture Resistance	ASTM E 154	990 N (221 lbs)
Permeance	ASTM E 96 Method B	0.6 ng/Pa x s x m ² (0.01 perms)
Water Absorption	ASTM D 570	0.5%

Footnotes:

1. Lateral water migration resistance is tested by casting concrete against membrane with a hole and subjecting the membrane to hydrostatic head pressure with water. The test measures the resistance of lateral water migration between the concrete and the blind side waterproofing membrane. A hydrostatic head pressure of 71 m (231 ft) of water is the limit of the apparatus.
2. Elongation of membrane is run at a rate of 50 mm (2 in.) per minute.
3. Concrete is cast against the protective coating surface of the membrane and allowed to cure (7 days minimum). Peel adhesion of membrane to concrete is measured at a rate of 50 mm (2 in.) per minute at room temperature.
4. The test is conducted 15 minutes after the lap is formed as per manufacturer's instructions and run at a rate of 50 mm (2 in.) per minute.
5. Hydrostatic head tests are performed by casting concrete against the membrane with a lap. Before the concrete sets a 3 mm (0.125 in.) spacer is inserted perpendicular to the membrane to create a gap. The cured block is placed in a chamber where water is introduced to the membrane surface up to a head of 71 m (231 ft) of water which is the limit of the apparatus.

- B. Pre-applied Integrally Bonded Sheet Waterproofing Membrane: Preprufe® 160R Membrane [or Preprufe 160LT Membrane for application temperatures between 25°F (-4°C) and 60°F (+16°C)] by Grace Construction Products, a 1.0mm (0.032 in) nominal thickness composite sheet membrane comprising 0.4 mm (0.016 in.) of high density polyethylene film, and layers of specially formulated synthetic adhesive layers. The membrane shall form an integral and permanent bond to poured concrete to prevent water migration at the interface of the membrane and structural concrete. Provide membrane with the following physical properties:

NOTE TO SPECIFIER: Preprufe 160R and Preprufe 160LT can both be installed at temperatures 25°F (-4°C) and above. For temperatures 25°F (-4°C) to 55°F (13°C) Grace Technical Bulletin #16 states the use of Preprufe LT Tape is recommended at all sidelaps when using Preprufe 160R. Alternatively, contractors may elect the use of Preprufe 160LT which does not require the use of Preprufe LT Tape at sidelaps in temperature ranges 25°F (-4°C) to 55°F (13°C). For this reason, Grace suggests that both products be incorporated into the specification.

PHYSICAL PROPERTIES FOR PREPRUFE 160R (or 160LT) MEMBRANE:

Property	Test Method	Typical Value
Color		White
Thickness	ASTM D 3767 Method A	1.0 mm (0.032 in.) nominal
Lateral Water Migration Resistance	ASTM D5385, Modified ¹	Pass at 71 m (231 ft) of hydrostatic head pressure
Low Temperature Flexibility	ASTM D 1970	Unaffected at -29°C (-20°F)
Elongation	ASTM D 412 Modified ²	500%
Crack Cycling at -23°C (-9.4°F), 100 Cycles	ASTM C 836	Unaffected, Pass
Tensile Strength, film	ASTM D 412	27.6 MPa (4,000 lbs/in. ²)
Peel Adhesion to Concrete	ASTM D 903 Modified ³	880 N/m (5.0 lbs/in.)
Lap Adhesion	ASTM D 1876 Modified ⁴	880 N/m (5.0 lbs/in.)
Resistance to Hydrostatic Head	ASTM D 5385 Modified ⁵	Pass at 71 m (231 ft)
Puncture Resistance	ASTM E 154	445 N (100 lbs)
Permeance	ASTM E 96 Method B	0.6 ng/Pa x s x m ² (0.01 perms)
Water Absorption	ASTM D 570	0.5%

Footnotes:

- Lateral water migration resistance is tested by casting concrete against membrane with a hole and subjecting the membrane to hydrostatic head pressure with water. The test measures the resistance of lateral water migration between the concrete and the blind side waterproofing membrane. A hydrostatic head pressure of 71 m (231 ft) of water is the limit of the apparatus.*
- Elongation of membrane is run at a rate of 50 mm (2 in.) per minute.*
- Concrete is cast against the protective coating surface of the membrane and allowed to cure (7 days minimum). Peel adhesion of membrane to concrete is measured at a rate of 50 mm (2 in.) per minute at room temperature.*
- The test is conducted 15 minutes after the lap is formed as per manufacturer's instructions and run at a rate of 50 mm (2 in.) per minute.*
- Hydrostatic head tests are performed by casting concrete against the membrane with a lap. Before the concrete sets a 3 mm (0.125 in.) spacer is inserted perpendicular to the membrane to create a gap. The cured block is placed in a chamber where water is introduced to the membrane surface up to a head of 71 m (231 ft) of water which is the limit of the apparatus.*

- C. Waterstop: Adcor™ ES hydrophilic non-bentonite waterstop by Grace Construction Products for non-moving concrete construction joints.

PHYSICAL PROPERTIES FOR GRACE ADCOR™ ES HYDROPHYLIC WATERSTOP:

Property	Typical Value
Color	Green
Size	1.0 in. x ½ in. x 16 ft. rolls (25.4 mm x 12.7 mm x 4.9 m)
Hydrostatic Head Resistance	70 m (231 ft)
Wet - Dry Cycling [25 Cycles @ 231 ft. (70 m)]	No Effect
Adhesion to Concrete using Adcor ES Adhesive	Excellent

- D. Preformed Soil Retention Wall Tieback Cover: Preprufe Tieback Cover by Grace Construction Products as a prefabricated detail for soil retention wall tiebacks.
- E. Preformed Inside and Outside Corners: Preprufe Preformed Corners by Grace Construction Products as prefabricated inside and outside corners.
- F. Tape for covering cut edges, roll ends, penetrations and detailing: Preprufe Tape LT (for temperatures between 25°F (-4°C) and 86°F (+30°C)) and Preprufe Tape HC (for use in Hot Climates, minimum 50°F (10°C))
- G. Miscellaneous Materials: accessories specified or acceptable to manufacturer of pre-applied waterproofing membrane.

PART 3 — EXECUTION

3.01 EXECUTION

- A. The installer shall examine conditions of substrates and other conditions under which this work is to be performed and notify the Contractor, in writing, of circumstances detrimental to the proper completion of the work. Do not proceed with work until unsatisfactory conditions are corrected.

3.02 SUBSTRATE PREPARATION

- A. It is essential to create a sound and solid substrate to eliminate movement during the concrete pour. Substrates must be regular and smooth with no gaps or voids greater than 0.5 in. (12 mm). Grout around all penetrations such as utility conduits, etc. for stability.
1. Horizontal Surfaces - The substrate must be free of loose aggregate and sharp protrusions. Avoid curved or rounded substrates. When installing over earth or crushed stone, ensure substrate is well compacted to avoid displacement of substrate due to traffic or concrete pour. The surface does not need to be dry, but standing water must be removed.
 2. Vertical Surfaces - Use concrete, plywood, insulation or other approved facing to sheet piling to provide support to the membrane. Board systems such as timber lagging must be close butted to provide support and not more than 0.5 in. (12 mm) out of alignment.

3.03 INSTALLATION, HORIZONTAL APPLICATIONS

- A. Strictly comply with installation instructions in manufacturer's published literature, including but not limited to, the following:
1. Place the membrane HDPE film side to the substrate with the clear plastic release liner facing towards the concrete pour. End laps should be staggered to avoid a build-up of layers.
 2. Leave the plastic release liner in position until overlap procedure is completed.
 3. Accurately position succeeding sheets to overlap the previous sheet 3 in. (75 mm) along the marked selvedge. Ensure the underside of the succeeding sheet is clean, dry and free from contamination before attempting to overlap.
 4. Peel back the plastic release liner from between the overlaps as the two layers are bonded together. Ensure a continuous bond is achieved without creases and roll firmly with a heavy roller.
 5. Completely remove the plastic liner to expose the protective coating. Any initial tack will quickly disappear.

3.04 INSTALLATION, VERTICAL APPLICATIONS

- A. Strictly comply with installation instructions in manufacturer's published literature, including but not limited to, the following:
1. Mechanically fasten the membrane vertically using fasteners appropriate to the substrate with the clear plastic release liner facing towards the concrete pour. The membrane may be installed in any convenient length.
 2. Fastening through the selvedge using a small and low profile head fastener so that the membrane lays flat and allows firmly rolled overlaps.
 3. Immediately remove the plastic release liner.
 4. Ensure the underside of the succeeding sheet is clean, dry and free from contamination before attempting to overlap.
 5. Roll firmly to ensure a watertight seal.
 6. Overlap all roll ends and cut edges by a minimum 3 in. (75 mm) and ensure the area is clean and free from contamination, wiping with a damp cloth if necessary.
 7. Allow to dry and apply Preprufe Tape LT (or HC in hot climates) centered over the lap edges and roll firmly.
 8. Immediately remove printed plastic release liner from the tape.

3.05 WATERSTOP INSTALLATION

- A. Strictly comply with installation instructions in manufacturer's published literature, including but not limited to, the following:
1. Secure Adcor ES using masonry nails 1½ in. - 2 in. (40 mm – 50 mm) long with a washer ¾ in. (20 mm) in diameter. Hilti EM6-20-12 FP8 shot fired fixings with ¼ in. (6 mm) nuts and ¾ in. (20 mm) diameter washers may also be used. Fixings should be spaced at a maximum of 12 in. (300 mm) centers with a minimum spacing that ensures proper contact to substrate.
 2. On irregular concrete faces, or on vertical surfaces, apply a ½ in. (12 mm) bead of Adcor ES Adhesive as bedding for Adcor ES.

3. Adcor ES joints should overlap a minimum of 4 in. (100 mm), ensuring full contact between jointed pieces.

3.06 PROTECTION

- A. Protect membrane in accordance with manufacturer's recommendations until placement of concrete. Inspect for damage just prior to placement of concrete and make repairs in accordance with manufacturer's recommendations.

END OF SECTION

W.R. Grace & Co.-Conn. 62 Whittemore Avenue Cambridge, MA 02140

Preprufe and Hydroduct are registered trademarks of W.R. Grace & Co.-Conn.

We hope the information here will be helpful. It is based on data and knowledge considered to be true and accurate and is offered for the users' consideration, investigation and verification, but we do not warrant the results to be obtained. Please read all statements, recommendations or suggestions in conjunction with our conditions of sale, which apply to all goods supplied by us. No statement, recommendation or suggestion is intended for any use which would infringe any patent or copyright. W. R. Grace & Co.-Conn., 62 Whittemore Avenue, Cambridge, MA 02140. In Canada, W. R. Grace & Co. Canada, Ltd. 294 Clements Road, West, Ajax, Ontario, Canada L1S 3C6.

This product may be covered by patents or patents pending.

Copyright 2012, W.R. Grace & Co.-Conn.

Document Code: GSWP-001B

Updated: 7/2012

Appendix 4
Imported Backfill Limits

TABLE 1
Soil Cleanup Objectives

Contaminant	CAS Number	Protection of Public Health				Protection of Ecological Resources	Protection of Ground-water
		Residential	Restricted-Residential	Commercial	Industrial		
METALS							
Arsenic	7440-38 -2	16 _f	16 _f	16 _f	16 _f	13 _f	16 _f
Barium	7440-39 -3	350 _f	400	400	10,000 _d	433	820
Beryllium	7440-41 -7	14	72	590	2,700	10	47
Cadmium	7440-43 -9	2.5 _f	4.3	9.3	60	4	7.5
Chromium, hexavalent ^h	18540-29-9	22	110	400	800	1 _e	19
Chromium, trivalent ^h	16065-83-1	36	180	1,500	6,800	41	NS
Copper	7440-50 -8	270	270	270	10,000 _d	50	1,720
Total Cyanide ^h		27	27	27	10,000 _d	NS	40
Lead	7439-92 -1	400	400	1,000	3,900	63 _f	450
Manganese	7439-96 -5	2,000 _f	2,000 _f	10,000 _d	10,000 _d	1600 _f	2,000 _f
Total Mercury		0.81 _j	0.81 _j	2.8 _j	5.7 _j	0.18 _f	0.73
Nickel	7440-02 -0	140	310	310	10,000 _d	30	130
Selenium	7782-49 -2	36	180	1,500	6,800	3.9 _f	4 _f
Silver	7440-22 -4	36	180	1,500	6,800	2	8.3
Zinc	7440-66 -6	2200	10,000 _d	10,000 _d	10,000 _d	109 _f	2,480
PESTICIDES / PCBs							
2,4,5-TP Acid (Silvex)	93-72-1	58	100 _a	500 _b	1,000 _c	NS	3.8
4,4'-DDE	72-55-9	1.8	8.9	62	120	0.0033 _e	17
4,4'-DDT	50-29-3	1.7	7.9	47	94	0.0033 _e	136
4,4'-DDD	72-54-8	2.6	13	92	180	0.0033 _e	14
Aldrin	309-00-2	0.019	0.097	0.68	1.4	0.14	0.19
alpha-BHC	319-84-6	0.097	0.48	3.4	6.8	0.04 _g	0.02
beta-BHC	319-85-7	0.072	0.36	3	14	0.6	0.09
Chlordane (alpha)	5103-71 -9	0.91	4.2	24	47	1.3	2.9
delta-BHC	319-86-8	100 _a	100 _a	500 _b	1,000 _c	0.04 _g	0.25
Dibenzofuran	132-64-9	14	59	350	1,000 _c	NS	210
Dieldrin	60-57-1	0.039	0.2	1.4	2.8	0.006	0.1
Endosulfan I	959-98-8	4.8 _i	24 _i	200 _i	920 _i	NS	102
Endosulfan II	33213-65-9	4.8 _i	24 _i	200 _i	920 _i	NS	102
Endosulfan sulfate	1031-07 -8	4.8 _i	24 _i	200 _i	920 _i	NS	1,000 _c
Endrin	72-20-8	2.2	11	89	410	0.014	0.06
Heptachlor	76-44-8	0.42	2.1	15	29	0.14	0.38
Lindane	58-89-9	0.28	1.3	9.2	23	6	0.1
Polychlorinated biphenyls	1336-36 -3	1	1	1	25	1	3.2
SEMI-VOLATILES							
Acenaphthene	83-32-9	100 _a	100 _a	500 _b	1,000 _c	20	98
Acenaphthylene	208-96-8	100 _a	100 _a	500 _b	1,000 _c	NS	107
Anthracene	120-12-7	100 _a	100 _a	500 _b	1,000 _c	NS	1,000 _c
Benz(a)anthracene	56-55-3	1 _f	1 _f	5.6	11	NS	1 _f
Benzo(a)pyrene	50-32-8	1 _f	1 _f	1 _f	1.1	2.6	22
Benzo(b) fluoranthene	205-99-2	1 _f	1 _f	5.6	11	NS	1.7
Benzo(g,h,i) perylene	191-24-2	100 _a	100 _a	500 _b	1,000 _c	NS	1,000 _c
Benzo(k) fluoranthene	207-08-9	1	3.9	56	110	NS	1.7
Chrysene	218-01-9	1 _f	3.9	56	110	NS	1 _f
Dibenz(a,h) anthracene	53-70-3	0.33 _e	0.33 _e	0.56	1.1	NS	1,000 _c
Fluoranthene	206-44-0	100 _a	100 _a	500 _b	1,000 _c	NS	1,000 _c
Fluorene	86-73-7	100 _a	100 _a	500 _b	1,000 _c	30	386
Indeno(1,2,3-cd) pyrene	193-39-5	0.5 _f	0.5 _f	5.6	11	NS	8.2
m-Cresol	108-39-4	100 _a	100 _a	500 _b	1,000 _c	NS	0.33 _e
Naphthalene	91-20-3	100 _a	100 _a	500 _b	1,000 _c	NS	12
o-Cresol	95-48-7	100 _a	100 _a	500 _b	1,000 _c	NS	0.33 _e
p-Cresol	106-44-5	34	100 _a	500 _b	1,000 _c	NS	0.33 _e
Pentachlorophenol	87-86-5	2.4	6.7	6.7	55	0.8 _e	0.8 _e
Phenanthrene	85-01-8	100 _a	100 _a	500 _b	1,000 _c	NS	1,000 _c
Phenol	108-95-2	100 _a	100 _a	500 _b	1,000 _c	30	0.33 _e
Pyrene	129-00-0	100 _a	100 _a	500 _b	1,000 _c	NS	1,000 _c

TABLE 1
Soil Cleanup Objectives

Contaminant	CAS Number	Protection of Public Health				Protection of Ecological Resources	Protection of Ground-water
		Residential	Restricted-Residential	Commercial	Industrial		
VOLATILES							
1,1,1-Trichloroethane	71-55-6	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	0.68
1,1-Dichloroethane	75-34-3	19	26	240	480	NS	0.27
1,1-Dichloroethene	75-35-4	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	0.33
1,2-Dichlorobenzene	95-50-1	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	1.1
1,2-Dichloroethane	107-06-2	2.3	3.1	30	60	10	0.02 ^d
cis-1,2-Dichloroethene	156-59-2	59	100 ^a	500 ^b	1,000 ^c	NS	0.25
trans-1,2-Dichloroethene	156-60-5	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	0.19
1,3-Dichlorobenzene	541-73-1	17	49	280	560	NS	2.4
1,4-Dichlorobenzene	106-46-7	9.8	13	130	250	20	1.8
1,4-Dioxane	123-91-1	9.8	13	130	250	0.1 ^e	0.1 ^e
Acetone	67-64-1	100 ^a	100 ^b	500 ^b	1,000 ^c	2.2	0.05
Benzene	71-43-2	2.9	4.8	44	89	70	0.06
Butylbenzene	104-51-8	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	12
Carbon tetrachloride	56-23-5	1.4	2.4	22	44	NS	0.76
Chlorobenzene	108-90-7	100 ^a	100 ^a	500 ^b	1,000 ^c	40	1.1
Chloroform	67-66-3	10	49	350	700	12	0.37
Ethylbenzene	100-41-4	30	41	390	780	NS	1
Hexachlorobenzene	118-74-1	0.33 ^e	1.2	6	12	NS	3.2
Methyl ethyl ketone	78-93-3	100 ^a	100 ^a	500 ^b	1,000 ^c	100 ^a	0.12
Methyl tert-butyl ether	1634-04 -4	62	100 ^a	500 ^b	1,000 ^c	NS	0.93
Methylene chloride	75-09-2	51	100 ^a	500 ^b	1,000 ^c	12	0.05
n-Propylbenzene	103-65-1	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	3.9
sec-Butylbenzene	135-98-8	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	11
tert-Butylbenzene	98-06-6	100 ^a	100 ^a	500 ^b	1,000 ^c	NS	5.9
Tetrachloroethene	127-18-4	5.5	19	150	300	2	1.3
Toluene	108-88-3	100 ^a	100 ^a	500 ^b	1,000 ^c	36	0.7
Trichloroethene	79-01-6	10	21	200	400	2	0.47
1,2,4-Trimethylbenzene	95-63-6	47	52	190	380	NS	3.6
1,3,5-Trimethylbenzene	108-67-8	47	52	190	380	NS	8.4
Vinyl chloride	75-01-4	0.21	0.9	13	27	NS	0.02
Xylene (mixed)	1330-20 -7	100 ^a	100 ^a	500 ^b	1,000 ^c	0.26	1.6

All soil cleanup objectives (SCOs) are in parts per million (ppm). NS=Not specified. See Technical Support Document (TSD). Footnotes

a The SCOs for residential, restricted-residential and ecological resources use were capped at a maximum value of 100 ppm. See TSD section 9.3.

b The SCOs for commercial use were capped at a maximum value of 500 ppm. See TSD section 9.3.

c The SCOs for industrial use and the protection of groundwater were capped at a maximum value of 1000 ppm. See TSD section 9.3.

d The SCOs for metals were capped at a maximum value of 10,000 ppm. See TSD section 9.3.

e For constituents where the calculated SCO was lower than the contract required quantitation limit (CRQL), the CRQL is used as the SCO value.