

**CITY OF NEW YORK
DEPARTMENT OF BUILDINGS**

Pursuant to Administrative Code Section 27-131, the following equipment or material has been found acceptable for use in accordance with the Report of Materials and Equipment Acceptance (MEA) Division.

Patricia J. Lancaster, A.I.A., Commissioner

MEA 261-03-E

Report of Materials and Equipment Acceptance Division

Manufacturer – Aurora Pump, 800 Airport Road, North Aurora, IL 60542.

Trade Name(s) – Aurora Pump.

Product - Models 3-383-7A, 3-383-7B, 4-383-7B, 2-383-9C, 3-383-9A, 3-383-9, 4-383-9, 4-383-9B, 4-383-9C, 4-383-10, 4-383-10B, 4-383-13 Vertical Inline Fire Pumps. Models 8-421-21A, 6-481-15C, 6-483-15C, 5-485-12, 6-485-12 Horizontal Split Case Fire Pumps.

Pertinent Code Sections –Subchapter 17 and Reference Standard RS17.

Prescribed Test(s) – UL 448, FM Approval Standard Class 1371, FM Approval Standard Class 1311.

Laboratory – Factory Mutual Research Corporation and Underwriters Laboratories Inc.

Test Report(s) – UL File Ex4017, UL File Ex 2638 and UL letter dated July 10, 2003.

“In-Line Centrifugal Fire Pumps”		
Pump	UL Project No.	Date Issued
3-383-7A	95NK5431	6/13/95, revised 12/21/95
3-383-7B	95NK5431	6/13/95, revised 12/21/95
4-383-7B	95NK5431	6/13/95, revised 12/21/95
2-383-9C	94NK21952	1/5/95
3-383-9A	94NK21952	1/5/95
3-383-9	94NK21952	1/5/95
4-383-9	94NK21952	1/5/95
4-383-9B	95NK5431	6/14/95, revised 12/21/95
4-383-9C	96NK8404	5/20/96
4-383-10	95NK29444	6/14/95, revised 12/21/95
4-383-10B	97NK38862	2/17/98
4-383-13	95NK29444	6/14/95, revised 12/21/95

"Split-Case Centrifugal Fire Pumps"		
Pump	UL Project No.	Date Issued
8-481-21A	91NK28519	3/13/92, revised 4/22/92
6-481-15C	02NK39122	10/7/02
6-483-15C	02NK39122	10/7/02
5-485-12	01NK7384	7/3/01
6-485-12	01NK7384 01NK48417	7/2/01, revised 2/4/02


"In-Line Centrifugal Fire Pumps"		
Pump	FM J.I. No.	Date Issued
3-383-7A	0Z4A5.AH	8/18/95
3-383-7B	0Z4A5.AH	8/18/95
4-383-7B	0Z4A5.AH	8/18/95
	2Z2A8.AH	2/5/96
	2Z0A3.AH	10/6/96
2-383-9C	1Y7A2.AH	12/5/94, revised 1/27/95
3-383-9A	1Y7A2.AH	12/5/94, revised 1/27/95
3-383-9	1Y7A2.AH	12/5/94, revised 1/27/95
4-383-9	1Y7A2.AH	12/5/94, revised 1/27/95
4-383-9B	0Z4A5.AH	8/18/95
4-383-9C	0B5A9.AH	5/17/96
4-383-10	2Z2A8.AH	2/5/96
4-383-10B	2D1A2.AH	4/28/98
4-383-13	2Z2A8.AH	2/5/96
"Split-Case Centrifugal Fire Pumps"		
8-481-21A	0W7A6.AH	7/9/93
	2V1A2.AH	3/9/92
6-481-15C	3014982	9/30/02
6-483-15C	3014982	9/30/02
5-485-12	3008545	1/3/03
6-485-12	3008545	1/3/02

Description – Aurora Pump Fire Pumps are designed to supply water to facility fire suppression systems at specified flow rated and pressures.

AURORA MODEL 383 PUMPS

INLINE FIRE PUMP

Section **911** Page **201**
 Date **November, 2000**
 Supersedes Section 911 Page 201
 Dated April, 2000

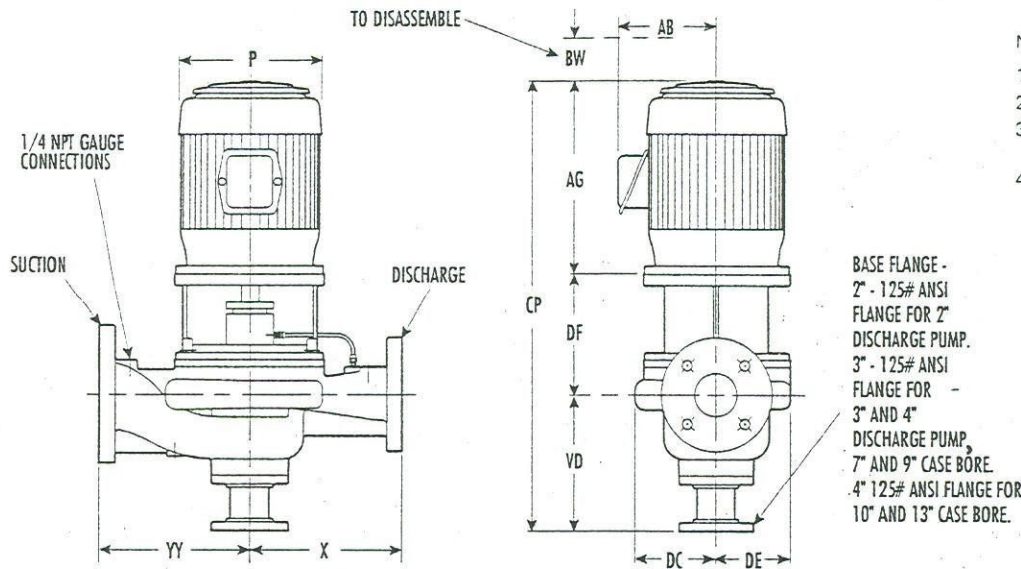

NOTES:

1. All dimensions in inches.
2. Dimensions may vary $\pm 1/4$.
3. Not for construction purposes unless certified.
4. Suction and discharge flanges are 125# ANSI as standard. 250# suction and discharge or 125# suction/250# discharge available as option for 9 inch and 10 inch case bore pumps only.

PUMP SIZE DISCH SUCT CASE BORE	GPM PUMP RATING	X	YY	BW (MIN)	VD	DF		DC	DE	PUMP WT.(LBS)		
						184JP	213JP THRU 365JP			184JP	213JP THRU 256JP	284JP THRU 365JP
3 x 3 x 7A	100, 150, 200	9-1/2	9-1/2	4-1/2	10-1/4	8	8-13/16	5-3/16	6-1/8	140	153	159
3 x 3 x 7B	250	9-1/2	9-1/2	4-1/2	10-1/4	—	8-13/16	5-3/16	6-1/8	—	153	159
4 x 4 x 7B	300, 400, 450, 500	11	11	4-1/2	11-1/4	—	9-5/16	5-9/16	7-5/16	—	191	197
2 x 2 x 9C	50, 100	9-1/2	9-1/2	4-1/2	9-1/4	7-13/16	8-5/8	5-3/4	6-1/4	117	130	—
3 x 3 x 9A	150, 200	11	11	4-1/2	10-1/4	7-15/16	8-3/4	6	6-3/4	152	165	170
3 x 4 x 9	250	11	11	4-1/2	9-7/8	8-1/4	8-7/8	5-3/4	6-1/2	178	191	196
4 x 5 x 9	300, 400, 450	11	11	4-1/2	11	8-3/8	9	6	7-1/8	—	227	232
4 x 5 x 9B	300, 400, 450, 500	11	11	4-1/2	11	8-3/8	9	6	7-1/8	—	227	232
4 x 5 x 9C	500	11	11	4-1/2	11	—	9	6	7-1/8	—	—	232
4 x 6 x 10	400, 450, 500	14	14	5	13-1/16	—	9-1/16	7	8-1/2	—	—	351
4 x 6 x 10B	750	14	14	5	13-1/16	—	9-1/16	7	8-1/2	—	—	351
4 x 6 x 13	750	16	16	5-3/8	13-13/16	—	9-3/16	9	10-1/2	—	—	421

O.D.P. FRAME	AG APPROX	P	AB APPROX	MOTOR WT. (LBS)	CP							
					2x2x9C	3x3x9A	3x4x9	4x5x9 4x5x9B&C	3x3x7A 3x3x7B*	4x4x7B	4x6x10 4x6x10B	4x6x13
184JP	15	10-3/8	7	95	32-1/8	33-1/4	33-1/8	34-3/8	28-5/8	—	—	—
213JP	17	12-1/4	7-5/8	135	35	36	35-3/4	37	36	—	—	—
215JP	17	12-1/4	7-5/8	155	35	36	35-3/4	37	36	37-3/4	—	—
254JP	21	13	8-7/8	195	39	40	39-3/4	41	40	41-5/8	—	—
256JP	21	13	9-1/4	256	39	40	39-3/4	41	—	41-5/8	—	—
284JP	22	15-3/4	11-3/8	271	—	41	40-3/4	42	—	42-5/8	—	—
286JP	22	15-3/4	11-3/8	320	—	41	40-3/4	42	—	42-5/8	44-1/8	—
324JP	24	17-3/4	13-1/4	420	—	43	—	44	—	—	46-1/8	46-1/4
326JP	24	17-3/4	13-1/4	460	—	—	—	44	—	—	46-1/8	46-1/4
364JP	26	20	16	600	—	—	—	—	—	—	48-1/8	48-1/4
365JP	26	20	16	750	—	—	—	—	—	—	48-1/8	48-1/4

* - Not available with 184JP Frame.

AURORA MODEL 481 PUMPS





SINGLE-STAGE FIRE SERVICE

Section 912 Page 201

Date July 2001

Supersedes Section 912 Page 201

Dated March 2001

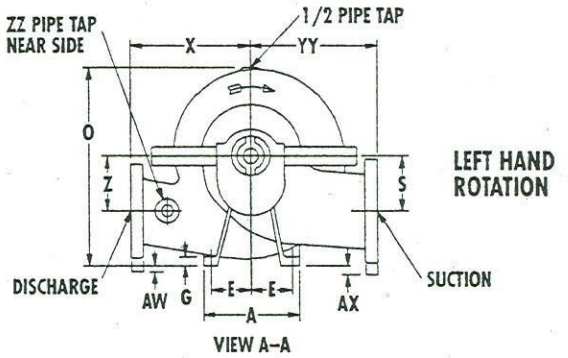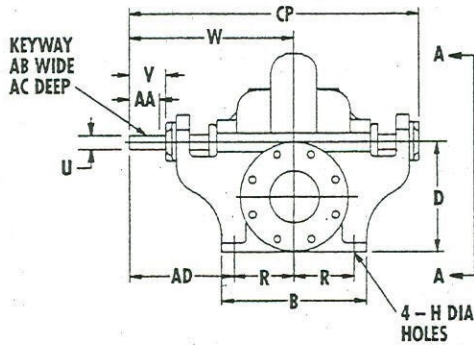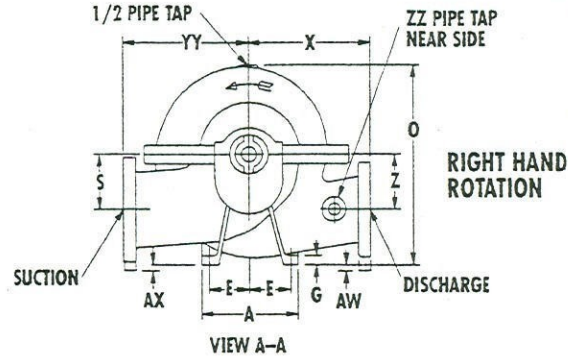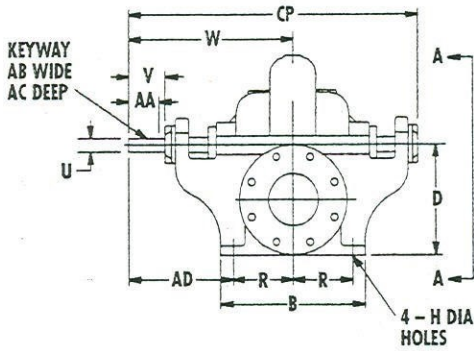

PUMP SIZE			SUCTION	POWER SERIES	A	B	D	E	G	H	O	R	S	U	V	W	X	Z	AA	AB	AC	AD	AW	AX	CP	YY	ZZ
DISCH	MODEL	CASE BORE			203	254	203	89	19	16	406	102	102	1-1/8	2-7/8	13-1/2	9-3/4	4	2-1/8	1/4	1/8	9-1/2	-	-	24	10	
2-1/2	481	10B	3	2	8	10	8	3-1/2	3/4	5/8	16	4	4	1-1/8	2-7/8	13-1/2	9-3/4	4	2-1/8	1/4	1/8	9-1/2	-	-	24	10	
					(203)	(254)	(203)	(89)	(19)	(16)	(406)	(102)	(102)	(29)	(73)	(343)	(248)	(102)	(54)	(6)	(3)	(241)	-	-	(610)	(254)	
3	481	10	4	2	8	10	9	3-1/2	3/4	5/8	16-1/4	4	4-1/2	1-1/8	2-7/8	13-1/2	10	4-1/2	2-1/8	1/4	1/8	9-1/2	-	1/2	24	11	
					(203)	(254)	(229)	(89)	(19)	(16)	(413)	(102)	(114)	(29)	(73)	(343)	(254)	(114)	(54)	(6)	(3)	(241)	-	(13)	(610)	(279)	
4	481	11	5	3	10	12	10	4-1/4	7/8	3/4	18-3/8	5	5	1-3/8	3	14-1/2	11-1/4	5	2-3/8	3/8	3/16	9-1/2	-	1/2	26	12-3/4	
					(254)	(305)	(254)	(108)	(22)	(19)	(467)	(127)	(127)	(35)	(76)	(368)	(286)	(127)	(60)	(10)	(5)	(241)	-	(13)	(660)	(324)	
4	481	15	5	3	10	12	11	4-1/4	7/8	3/4	21-1/8	5	5-1/2	1-3/8	3	14-1/2	13	5-1/2	2-3/8	3/8	3/16	9-1/2	-	-	26	14	
					(254)	(305)	(279)	(108)	(22)	(19)	(537)	(127)	(140)	(35)	(76)	(368)	(330)	(140)	(60)	(10)	(5)	(241)	-	-	(660)	(356)	
5	481	11	6	4	10	12	11	4-1/4	7/8	3/4	19-3/4	5	5-1/2	1-1/2	3-1/2	16	11-1/4	5-1/2	2-7/8	3/8	3/16	11	-	3/4	28-1/2	13-1/4	
					(254)	(305)	(279)	(108)	(22)	(19)	(502)	(127)	(140)	(38)	(89)	(406)	(286)	(140)	(73)	(10)	(5)	(279)	-	(19)	(724)	(337)	
5	481	15	6	4	10	12	12-1/2	4-1/4	7/8	3/4	22-1/2	5	6-1/4	1-1/2	3-1/2	16	13-1/4	6-1/4	2-7/8	3/8	3/16	11	-	-	28-1/2	15	
					(254)	(305)	(318)	(108)	(22)	(19)	(572)	(127)	(159)	(38)	(89)	(406)	(337)	(159)	(73)	(10)	(5)	(279)	-	-	(724)	(381)	
5	481	17	6	4	10	12	12-1/2	4-1/4	7/8	3/4	22-1/2	5	6-1/4	1-1/2	3-1/2	16	14	6-1/4	2-7/8	3/8	3/16	11	-	-	28-1/2	15	
					(254)	(305)	(318)	(108)	(22)	(19)	(572)	(127)	(159)	(38)	(89)	(406)	(356)	(159)	(73)	(10)	(5)	(279)	-	-	(724)	(381)	
6	481	11	8	4	10	12	12-1/2	4-1/4	7/8	3/4	21-7/8	5	6-1/4	1-1/2	3-1/2	16	11-3/4	6-1/4	2-7/8	3/8	3-16	11	-	1-1/4	28-1/2	14-1/2	
					(254)	(305)	(318)	(108)	(22)	(19)	(556)	(127)	(159)	(38)	(89)	(406)	(298)	(159)	(73)	(10)	(5)	(279)	-	(32)	(724)	(368)	
6	481	15	8	5	12	14	13-1/2	5	1	7/8	24-7/8	6	6-3/4	1-3/4	4	18	14-1/4	6-3/4	2-7/8	3/8	3/16	12	-	3/4	32	16-3/4	
					(305)	(356)	(343)	(127)	(25)	(22)	(632)	(152)	(171)	(44)	(102)	(457)	(362)	(171)	(73)	(10)	(5)	(305)	-	(19)	(813)	425	
6	481	18	8	5	12	14	14-3/4	5	3/4	7/8	27-1/4	6	8	1-3/4	4	18	16	8	2-7/8	3/8	3/16	12	-	3/4	32	18	
					(305)	(356)	(375)	(127)	(19)	(22)	(692)	(152)	(203)	(44)	(102)	(457)	(406)	(203)	(73)	(10)	(5)	(305)	-	(19)	(813)	(457)	
6	481	20	8	5	12	14	14-3/4	5	1	7/8	27-3/4	6	8	1-3/4	4	18	15-3/4	8	2-7/8	3/8	3/16	12	-	3/4	32	18	
					(305)	(356)	(375)	(127)	(25)	(22)	(705)	(152)	(203)	(44)	(102)	(457)	(400)	(203)	(73)	(10)	(5)	(305)	-	(19)	(813)	(457)	
8	481	12	10	5	12	14	14-3/4	5	1-1/4	7/8	26-3/8	6	8	1-3/4	4	18	17	9	2-7/8	3/8	3/16	12	1-3/4	2	32	17-3/4	
					(305)	(356)	(375)	(127)	(32)	(22)	(670)	(152)	(203)	(44)	(102)	(457)	(432)	(229)	(73)	(10)	(5)	(305)	(44)	(51)	(813)	(451)	
8	481	17	10	5	12	14	14-3/4	5	1-1/4	7/8	27-1/8	6	8	1-3/4	4	18	17	8	2-7/8	3/8	3/16	12	3/4	2	32	17-3/4	
					(305)	(356)	(375)	(127)	(32)	(22)	(689)	(152)	(203)	(44)	(102)	(457)	(432)	(203)	(73)	(10)	(5)	(305)	(19)	(51)	(813)	(451)	
8	481	21	10	6B	20	17	18-1/2	9	1	15/16	32-1/2	7-1/2	9-1/2	2-1/8	5-7/16	21-7/8	18	9-1/2	4-3/4	1/2	1/4	14-3/8	-	-	38	21	
					(508)	(432)	(470)	(229)	(25)	(24)	(826)	(191)	(241)	(54)	(138)	(556)	(457)	(241)	(121)	(13)	(6)	(365)	-	-	(965)	(533)	
10	481	15	12	6B	15	22	25	6-1/2	1	7/8	38-1/2	10	13-1/2	2-1/8	5-7/16	21-7/8	17	13-1/2	4-3/4	1/2	1/4	11-7/8	-	-	38	20	
					(381)	(559)	(635)	(165)	(25)	(22)	(978)	(254)	(343)	(54)	(138)	(556)	(432)	(343)	(121)	(13)	(6)	(301)	-	-	(965)	(508)	
10	481	18	12	6B	15	22	25	6-1/2	1	7/8	39-1/2	10	13-1/2	2-1/8	5-7/16	21-7/8	18	13-1/2	4-3/4	1/2	1/4	11-7/8	-	-	38	22	
					(381)	(559)	(635)	(165)	(25)	(22)	(1003)	(254)	(343)	(54)	(138)	(556)	(457)	(343)	(121)	(13)	(6)	(301)	-	-	(965)	(559)	
12	481	18	14	7	15	22	24	6-1/2	1	7/8	40-1/8	10	15	2-1/2	6-5/8	25-1/4	18	15	5	5/8	5/16	15-1/4	-	-	43-7/8	23	
					(381)	(559)	(610)	(165)	(25)	(22)	(1019)	(254)	(381)	(64)	(168)	(641)	(457)	(381)	(127)	(16)	(8)	(387)	-	-	(1114)	(584)	

NOTES

1. All dimensions are in inches (mm).
2. Dimensions may vary $\pm 3/8"$ (10).
3. Not for construction purposes unless certified.



STD. 125# SUCTION AND DISCHARGE FLANGES	OPT. 125# SUCTION FLANGE, 250# DISCHARGE FLANGE	OPT. 250# SUCTION AND DISCHARGE FLANGES
---	---	---

Section 912 Page 202





AURORA MODEL 483 PUMPS

SINGLE STAGE FIRE PUMPS

Date April 2003

Supersedes Section 912 Page 202

Dated July 2001

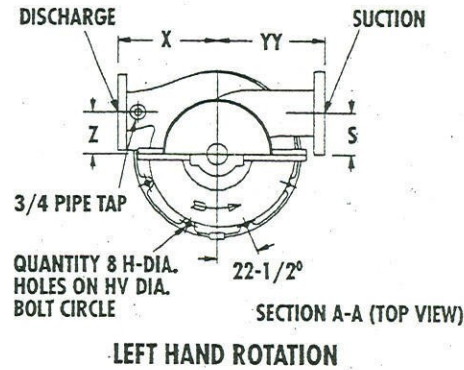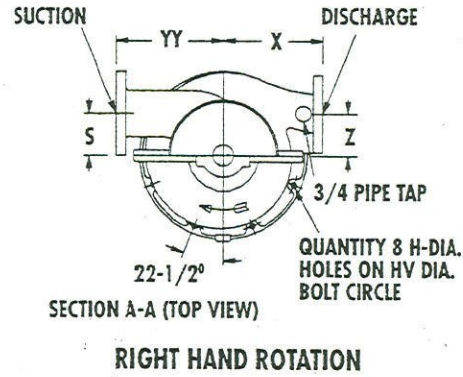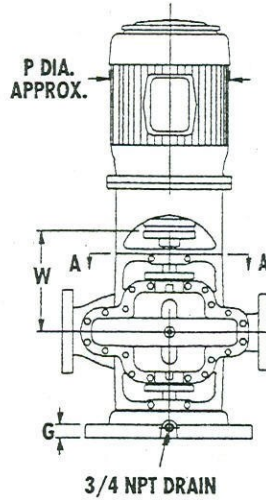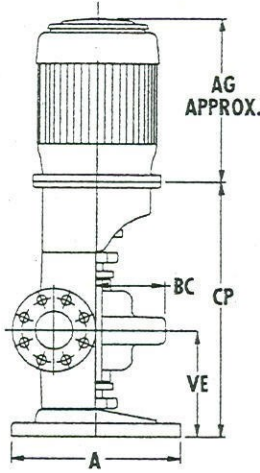

BASE	1	2	3
A	18 (457)	22 (559)	30 (762)
G	1-3/4 (44)	1-3/4 (44)	2 (51)
H	3/4 (19)	3/4 (19)	7/8 (22)
HW	16-1/4 (413)	20 (508)	28 (711)

PUMP SIZE		SUCTION	POWER SERIES	BASE	S	W	X	Z	BC	VE	YY	MOTOR FRAME													
DISCH	MODEL											CASE BORE	125# SUCTION AND DISCHARGE FLANGES	OPTIONAL 125# SUCTION AND 250# DISCHARGE FLANGES	OPTIONAL 250# SUCTION AND 250# DISCHARGE FLANGES	213HP	215HP	254HP	256HP	284HP	286HP	324HP	326HP	364HP	365HP
2-1/2	483	10	3	2	1	4 (102)	13-1/2 (343)	9-3/4 (248)	4 (102)	8 (203)	13 (330)	10 (254)	30	30	30	30	32	32	32	32					
3	483	10	4	2	1	4-1/2 (114)	13-1/2 (343)	10 (254)	4-1/2 (114)	7-3/16 (183)	13 (330)	11 (279)	30	30	30	30	32	32	32	32					
4	483	11	5	3	2	5 (127)	14-1/2 (368)	11-1/4 (286)	5 (127)	8-5/16 (211)	14 (356)	12-3/4 (324)			33	33	35	35	35	35	35	35	35	35	
4	483	15	5	3	2	5-1/2 (140)	14-1/2 (368)	13 (330)	5-1/2 (140)	9 (229)	14 (356)	14 (356)			33	35	35	35	35	35	35	35	35	35	
5	483	11	6	4	2	5-1/2 (140)	16 (406)	11-1/4 (286)	5-1/2 (140)	8-3/4 (222)	15 (381)	13-1/4 (337)			35	35	37	37	37	37	37	37	37	37	
5	483	15	6	4	2	6-1/4 (159)	16 (406)	13-1/4 (337)	6-1/4 (159)	10-1/16 (256)	15 (381)	15 (381)					37	37	37	37	37	37	37	37	
5	483	17	6	4	2	6-1/4 (159)	16 (406)	14 (356)	6-1/4 (159)	10-1/16 (256)	15 (381)	15 (381)					37	37	37	37	37	37	37	37	
6	483	11	8	4	2	6-1/4 (159)	16 (406)	11-3/4 (298)	6-1/4 (159)	9-1/4 (935)	15 (381)	14-1/2 (368)			35	37	37	37	37	37	37	37	37	37	
6	483	15	8	5	3	6-3/4 (171)	18 (457)	14-1/4 (362)	6-3/4 (171)	11-5/16 (287)	17 (432)	16-3/4 (425)					41	41	41	41	41	41	41	41	
6	483	18	8	5	3	8 (203)	18 (457)	16 (406)	8 (203)	12-1/2 (318)	17 (432)	18 (457)					41	41	41	41	41	41	41	41	
6	483	20	8	5	3	8 (203)	18 (457)	15-3/4 (400)	8 (203)	12-15/16 (239)	17 (432)	18 (457)					41	41	41	41	41	41	41	41	
8	483	12	10	5	3	8 (203)	18 (457)	17 (432)	9 (229)	11-9/16 (294)	17 (432)	17-3/4 (451)					41	41	41	41	41	41	41	41	
8	483	17B	10	5	3	8 (203)	18 (457)	17 (432)	8 (203)	12-3/8 (314)	17 (432)	17-3/4 (451)											41	41	41

NOTES

- All dimensions are in inches (mm).
- Dimensions may vary ± 3/8" (10).
- Not for construction purposes unless certified.
- Suction and discharge flanges are ANSI standard flat face.
- Motor dimensions "AG" and "P" will vary based on manufacturer and style of motor. Conduit box is shown in approximate location.



AURORA MODEL 485 PUMPS

MULTI-STAGE FIRE SERVICE

Section **912** Page **203**

Date **July 2001**

Supersedes Section 912 Page 203
Dated March 2001

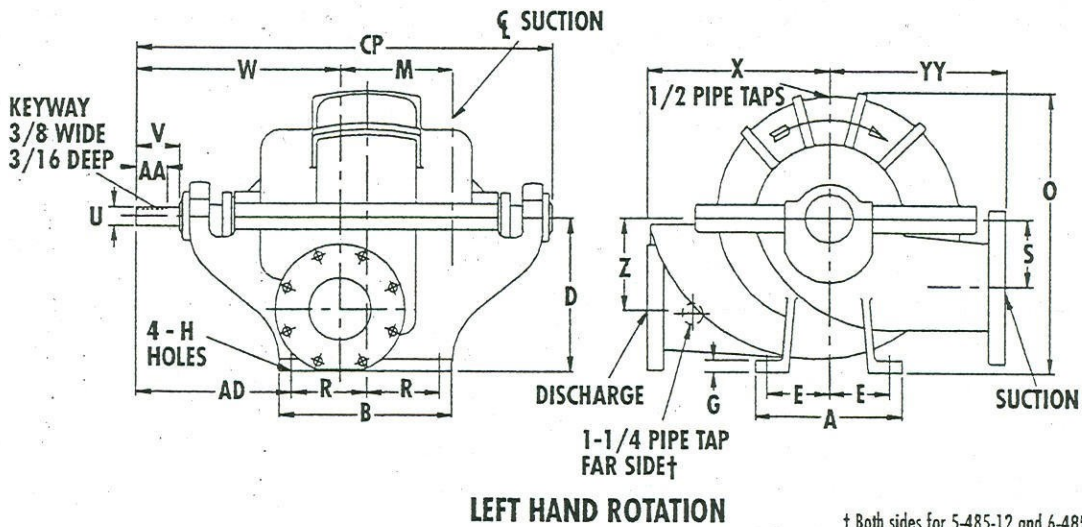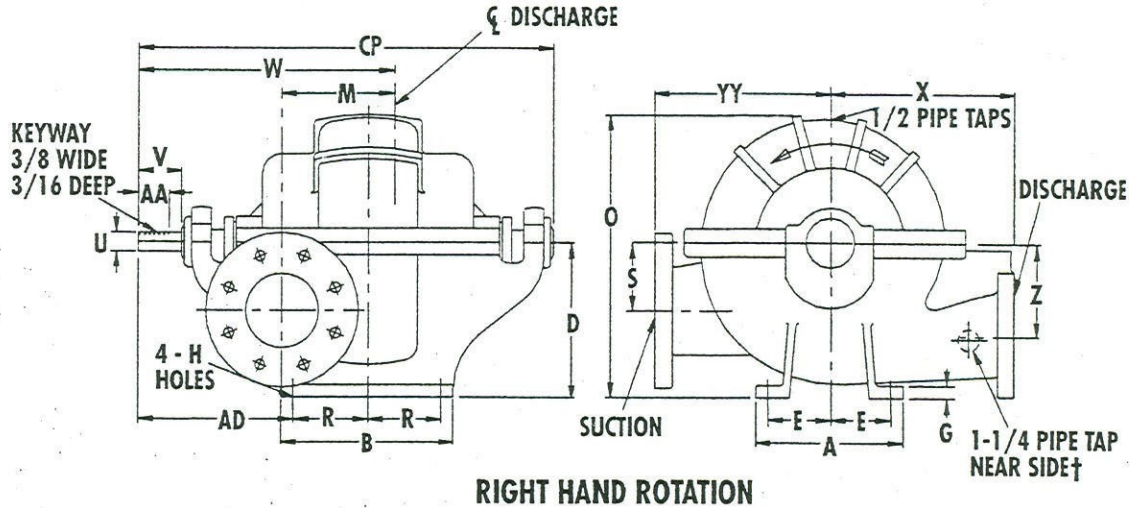

† Both sides for 5-485-12 and 6-485-12

PUMP SIZE		CASE BORE	SUCTION	POWER SERIES	A	B	D	E	G	H	M	O	R	S	U	V	RIGHT HAND ROTATION		LEFT HAND ROTATION		AA	AD	CP	YY
DISCH	MODEL																W	W	X	Z				
4	485	15	5	3	10 (254)	12 (304)	11 (279)	4-1/4 (108)	7/8 (22)	3/4 (19)	7-1/8 (181)	23 (584)	5 (127)	5 (127)	1-3/8 (35)	3 (76)	18-7/8 (479)	15-1/8 (384)	13 (330)	6-1/2 (165)	2 (51)	12 (304)	31 (787)	13-1/2 (343)
5	485	12	5	4A	15 (381)	16 (406)	14 (356)	6-1/2 (165)	1 (25)	7/8 (22)	6-5/8 (168)	24-1/4 (616)	7 (179)	7 (179)	1-1/2 (38)	3-5/8 (92)	20-7/8 (530)	18-1/8 (460)	13 (330)	7 (179)	2-1/2 (64)	12-1/2 (318)	35-3/8 (899)	13 (330)
5	485	15	6	4	12 (304)	14 (356)	12-1/2 (318)	5 (127)	1 (25)	7/8 (22)	9-1/8 (232)	24-1/2 (622)	6 (152)	5-1/2 (140)	1-1/2 (38)	3-1/2 (89)	21-1/8 (537)	16-7/8 (429)	15 (381)	7-1/2 (191)	2 (51)	13 (330)	34-1/2 (876)	15-7/16 (392)
6	485	12	6	5A	16 (406)	19 (483)	15 (381)	7 (179)	1 (25)	7/8 (22)	7-1/2 (191)	26-1/4 (667)	8-1/2 (216)	8 (203)	1-3/4 (44)	4 (102)	22-7/8 (581)	19-5/8 (498)	14 (356)	8 (203)	2-3/4 (70)	12-3/4 (324)	38-1/2 (978)	14 (356)
6	485	17	8	5	12 (304)	14 (356)	14-3/4 (375)	5 (127)	1 (25)	7/8 (22)	11 (279)	28-1/4 (718)	6 (152)	7 (179)	1-3/4 (44)	4 (102)	24-1/2 (622)	17-1/2 (445)	16 (406)	9 (229)	2-7/8 (73)	15 (381)	38 (965)	16-1/2 (419)

NOTES

- All dimensions are in inches (mm).
- Dimensions may vary ± 3/8" (10).
- Not for construction purposes unless certified.
- Suction & discharge flanges ANSI Standard flat face.

STD. *125# SUCTION FLANGE, *250# DISCHARGE FLANGE	OPT. *250# SUCTION AND DISCHARGE FLANGES
---	--

* 150# AND 300# OR 300# AND 300# SUCTION AND DISCHARGE DUCTILE IRON FOR 5-485-12 AND 6-485-12

Recommendation - That the above units be accepted on condition that all uses, locations, and installations comply with the New York City Building Code, and on further condition that:

1. Pumps rated below 250 GPM shall be considered "pressure maintain pump" and shall comply with all conditions numerated in this resolution.
2. Each fire pump shall be provided with its own controller. No other electrical equipment, including any jockey pump (pressure maintain pump) shall be powered from such controller.
3. Fire pump motors shall be provided with a separate service-disconnecting switch. Heavy wall rigid steel conduit with threaded fittings or an approved two-hour fire rated cable shall be the wiring method.
4. Service fuses and/or circuit breakers shall be rated at 600 percent of the full load of motor current. No other over-current protection devices shall be installed between the service switch and the motor. The overload protection at the fire pump controller shall be rated at not less than 300 percent of the full load current of the motor.
5. These pumps shall be supplied at the rated capacity identified at their most efficient point of operation on their certified curve. The motor must be selected to support the pump at its most efficient point on the curve with a minimum of 15 percent safety factor.
6. All uses, arrangements and functions, applications and installations shall comply with the provisions of New York City Building Code, specifically §27-946 and Reference Standard 17-1. Fire pumps shall be tested in accordance with §27-951 (h). Further, the installation and maintenance shall be in accordance with the manufacturer's recommendation, NFPA 20 of 1990, UL Standard and FM test report.

All shipments and deliveries of such equipment shall be provided with a metal tag, suitably placed, certifying that the equipment shipped or delivered is equivalent to those tested and accepted for use, as provided for in Section 27-131 of the Building Code.

Final Acceptance October 9, 2003
Examined By [Signature]