

Revised on March 2024 (Apply/Pay)

**FIRE DEPARTMENT • CITY OF NEW YORK**



**STUDY MATERIAL FOR THE EXAMINATION FOR  
CERTIFICATE OF FITNESS TO  
SUPERVISE THE STORAGE AND HANDLING  
OF CHEMICALS IN THE NYC K-12 SCHOOL LABORATORIES  
D-15**

**(Premises Related)**

***All applicants are required to apply and pay for an exam online before arriving at the FDNY. It can take about 30 minutes to complete.***

Simplified instructions for online application and payment can be found here:

<http://www1.nyc.gov/assets/fdny/downloads/pdf/business/fdny-business-cof-individuals-short.pdf>

Create an Account and Log in to:

<http://fires.fdnyccloud.org/CitizenAccess>

**Important 1:** The D-15 Certificate of Fitness only covers the storage and handling of chemicals.

**Important 2:** If you are also responsible for instructing students and supervising the use of the hazardous material at your school, you are required to obtain the D-14 Certificate of Fitness in addition to the D-15 Certificate of Fitness.

## **TABLE OF CONTENTS**

EXAM SPECIFIC INFORMATION FOR D-15 CERTIFICATE OF FITNESS.....	3
<b>1. DEFINITIONS.....</b>	<b>8</b>
<b>2. PREVENT LABORATORY FIRE/EXPLOSION ACCIDENTS.....</b>	<b>14</b>
<b>3. FIRE DEPARTMENT PERMIT.....</b>	<b>16</b>
<b>4. PORTABLE FIRE EXTINGUISHERS.....</b>	<b>18</b>
<b>5. EMERGENCY PLANNING AND PREPAREDNESS.....</b>	<b>23</b>
<b>6. LABORATORY UNIT DESIGN AND EQUIPMENTS.....</b>	<b>25</b>
<b>A. Signs Requirements.....</b>	<b>25</b>
<b>B. Fume Hoods and Exhaust Systems.....</b>	<b>28</b>
<b>C. Safety Showers, Neutralizing or Absorbing Agents and Curtains.....</b>	<b>29</b>
<b>D. Means of access to an Exit.....</b>	<b>30</b>
<b>E. Storage Room Requirements.....</b>	<b>30</b>
<b>7. CHEMICAL STORAGE, HANDLING, AND WASTE DISPOSAL.....</b>	<b>31</b>
<b>A. General Operations, Housekeeping and Good Work Practices.....</b>	<b>31</b>
<b>B. Prohibitions.....</b>	<b>33</b>
<b>C. Chemical Storage and Handling.....</b>	<b>34</b>
<b>D. Storage of Class I and Class II Liquids in Refrigerators.....</b>	<b>37</b>
<b>E. Liquid Dispensing.....</b>	<b>39</b>
<b>F. Waste, Handling and Disposal.....</b>	<b>40</b>
<b>8. LITHIUM-ION BATTERY SAFETY.....</b>	<b>42</b>
<b>SUMMARY CHECKLIST OF THE MOST COMMON REQUIREMENTS.....</b>	<b>45</b>
<b>APPENDIX I. CLASSIFICATIONS.....</b>	<b>47</b>
<b>A. Class of Flammable and Combustible Liquids.....</b>	<b>47</b>
<b>B. General Rule of Hazard Classes.....</b>	<b>47</b>
<b>C. Class of Organic Peroxide.....</b>	<b>48</b>
<b>APPENDIX II. DOT placards.....</b>	<b>49</b>
<b>APPENDIX III. SAMPLE SAFETY DATA SHEET (SDS).....</b>	<b>52</b>
<b>APPENDIX IV. EXAMPLES OF INCOMPATIBLE CHEMICALS.....</b>	<b>60</b>
<b>APPENDIX V. GENERAL QUANTITY LIMITATIONS.....</b>	<b>63</b>
<b>A. Flammable &amp; Combustible Liquids Quantity Limitation.....</b>	<b>63</b>
<b>B. Other Laboratory Hazardous Material Quantity Limitation.....</b>	<b>64</b>
<b>C. Storage and Use of Limited Quantities of Chemicals, Acids, and Flammables for Instruction Purposes in [Public High] Schools Through the Twelfth Grade.....</b>	<b>65</b>
<b>APPENDIX VI. COMMON HAZARDOUS MATERIALS.....</b>	<b>69</b>
<b>A. CORROSIVE MATERIALS.....</b>	<b>69</b>
<b>B. COMPRESSED AND LIQUEFIED GASES.....</b>	<b>70</b>
<b>C. HIGHLY TOXIC AND TOXIC MATERIALS.....</b>	<b>75</b>
<b>D. FLAMMABLE SOLID.....</b>	<b>76</b>
<b>E. OXIDIZERS AND ORGANIC PEROXIDES.....</b>	<b>77</b>
<b>F. UNSTABLE REACTIVES (INSTABILITY HAZARD).....</b>	<b>79</b>
<b>G. WATER-REACTIVE SOLID &amp; LIQUIDS.....</b>	<b>80</b>
<b>H. PYROPHORICS MATERIALS.....</b>	<b>81</b>

## **EXAM SPECIFIC INFORMATION FOR D-15 CERTIFICATE OF FITNESS**

***Save time and submit application online!***

***All applicants are required to apply and pay for an exam online before arriving at the FDNY. It can take about 30 minutes to complete.***

Simplified instructions for online application and payment can be found here:

<http://www1.nyc.gov/assets/fdny/downloads/pdf/business/fdny-business-cof-individuals-short.pdf>

Create an Account and Log in to:

<http://fires.fdnyccloud.org/CitizenAccess>

### **REQUIREMENTS FOR CERTIFICATE OF FITNESS APPLICATION**

#### **General requirements:**

Review the General Notice of Exam:

<http://www1.nyc.gov/assets/fdny/downloads/pdf/business/general-notice-of-exam-cof.pdf>

#### **Special requirements for the D-15 Certificate of Fitness:**

- D-15 can only be obtained by qualifying for an exemption on the basis of education, experience or other qualifications. **D-15 is only issued via Alternate Issuance Procedures (AIP) after submitting the required documents.**
- **D-15 is only issued to science teachers or lab specialist of NYC public schools.**
- Applicants who do not qualify **MUST** take the computer based FDNY administered examination and obtain a C-14 Certificate of Fitness.

#### **Application fee:**

Application fee is waived for all public-school teachers/lab specialist employed by the NYC DOE.

Revised on March 2024 (Apply/Pay)

### **REQUIREMENTS FOR ALTERNATIVE ISSUANCE PROCEDURE (AIP)**

This Certificate of Fitness can only be obtained by the alternative issuance procedure. Qualified applicants should review and complete the D-15 Certificate of Fitness Alternative Issuance Procedure Application Affirmation Form:

<https://www1.nyc.gov/assets/fdny/downloads/pdf/business/cof-d15-aip.pdf>

The AIP applicants must submit the application, required documents and payment on **FDNY Business**:

<http://www1.nyc.gov/assets/fdny/downloads/pdf/business/fdny-business-cof-individuals-short.pdf>

### **WEBSITE**

Please always check for the latest revised booklet at FDNY website before you apply, the Certificate of Fitness Study Material link, below:

<http://www1.nyc.gov/assets/fdny/downloads/pdf/business/cof-d15-noe-study-materials.pdf>

### **RENEWAL REQUIREMENTS**

#### **General renewal requirements:**

Review the General Notice of Exam:

<https://www1.nyc.gov/assets/fdny/downloads/pdf/business/general-notice-of-exam-cof.pdf>

#### **Special renewal requirements for the D-15 Certificate of Fitness:**

D-15 Certificates of Fitness is valid for three years. The renewal fee is waived.

**The renewal of D-15 certificate should be submitted via FDNY business online.**

The renewal instruction is provided below:

<https://www1.nyc.gov/assets/fdny/downloads/pdf/business/cof-renewal-short.pdf>

### **QUESTIONS?**

**FDNY Business Support Team:** For questions, call 311 and ask for the FDNY Customer Service Center or send an email to [FDNY.BusinessSupport@fdny.nyc.gov](mailto:FDNY.BusinessSupport@fdny.nyc.gov).

## **STUDY MATERIAL**

In addition to the general safety requirements addressed in the Science Safety Manual published by the DOE, this study material includes more safety regulations relating to the safe storage and handling of hazardous materials required by the FDNY that you will be required to know as a NYC School D-15 Certificate of Fitness holder with respect to fire safety regulations in a chemical laboratory and the chemical storage room.

**If the applicant is also responsible for instructing students and supervising the use of the hazardous material at his/her school, the applicant is required to obtain the D-14 Certificate of Fitness.**

**The Certificate of Fitness booklet was prepared in collaboration between the Department of Education (DOE) and the FDNY.**

## **FOREWORD**

New York City gives broad discretionary power to the Fire Commissioner to ensure the safety of persons and property in the City of New York. Certificates of Fitness are developed to ensure that individuals performing the functions of the Certificate holder are competent to fulfill the required duties.

The D-15 supervisor of chemical storage shall ensure **the storage and handling of hazardous materials in school's chemical and biology storage rooms** is conducted in accordance with the Fire Code and the Fire Rules.

In New York City K-12 public schools, this certificate, the D-15 Supervising the Storage and Handling of Chemicals in K-12 Schools Non-Production Science Laboratories Certificate of Fitness, is required when the storage or handling of hazardous material in a laboratory storage unit exceeds 1 gallon of flammable liquid, 1 gallon of combustible liquid or 75 SCF of flammable gas. These individuals must demonstrate that they are knowledgeable of the requirements of all fire safety regulations and procedures required by the FDNY.

The Fire Commissioner understands the unique fire safety needs of K-12 schools, and the D-15 Certificate of Fitness for schools has been developed utilizing the requirements of the C-14 Certificate of Fitness to address key responsibilities. Persons performing the duties of supervising the storage and handling of a chemical laboratory or a chemical storage room in K-12 NYC schools must hold a D-15 Certificate of Fitness. Certificate of Fitness holders must maintain all qualifications and comply with all requirements applicable to such Certificate holders throughout the term of their certificate. D-15 Certificates of Fitness are premises-related and D-15 holders can work only at the school address listed on their Certificates of Fitness.

D-15 Certificate of Fitness holders play a critical role in ensuring a safe and healthful learning environment for the students and teachers. D-15 Certificate of Fitness holders should develop and implement practices and procedures to address and incorporate the safety requirements for storage and handling of hazardous materials.

Revised on March 2024 (Apply/Pay)

The storage of hazardous materials must be under **general supervision** of a D-15/C-14 Certificated of Fitness holder. It means at least one D-15/C-14 Certificate of Fitness holder shall be responsible to ensure the storage of the hazardous materials is in accordance with the Fire Code and other applicable laws.

**Use of any chemical storage room requiring a permit without a responsible D-15/C-14 Certificate of Fitness holder's general supervision violates the law.** The Fire commissioner may direct that the use of the storage room cease until the Certificate of Fitness requirement is fulfilled.

The handling of hazardous materials (e.g. the movement of a material in its container; the removal of the material from its container, etc.) must be under **personal supervision** of a D-15/D-14/C-14 Certificate of Fitness holder. At least one D-15/D-14/C-14 Certificate of Fitness holder shall be present on the floor when any hazardous material exceeding the permit quantities is handled. This requirement ensures that the proper safety procedures are followed when hazardous materials are removed from their shipping containers, and/or when smaller containers intended for the use of students or teachers are filled from a large container.

D-15 Certificates of Fitness are valid for a period not to exceed three years from the date of issuance. At the end of this period, they expire unless the Fire Commissioner approves the renewals. Please be advised that Certificate of Fitness renewals shall be at the discretion of the Fire Commissioner in the interest of public safety. The FDNY may review the Certificate holder's qualifications and fitness to perform the duties of his/her position and may require a Certificate holder to complete a FDNY-approved continuing education program and/or provide other proof of the holder's continuing qualifications and fitness. A copy of the **all FDNY permits shall be posted** in a conspicuous location within the laboratory and Certificates of Fitness shall be readily available on the premises for inspection by FDNY representatives.

In 2008, the DOE, published the safety guide *Science Safety Manual* to be used by all individuals who are responsible for implementing laboratory programs in their schools. It provides the guidelines for school staff the general safety information for the students. In addition, this FDNY D-15 study material focuses more on the fire safety regulations regulated by the Fire Code. It is to provide reasonable requirements and standards for fire and life safety and property protection. D-15 Certificate of Fitness holder must be familiar with the *Science Safety Manual* and this *D-15 study material* to supervise the storage and handling of hazardous materials for the non-production chemical laboratory in the NYC public schools.

The storage and handling of hazardous materials for the non-production chemical laboratory is required to comply with the following FDNY code and rule sections:

- Non-production chemical laboratories: **[Fire Code Section 2706]**
- Standard on fire protection for laboratories using chemicals: **[NFPA 45, 2004 edition]**
- Flammable and combustible liquids: **[Fire Code Chapter 34]**
- Flammable gases: **[Fire Code Chapter 35]**
- Flammable solids systems and facilities: **[Fire Code Chapter 36]**
- Compressed gases: **[Fire Code Chapter 30]**

Revised on March 2024 (Apply/Pay)

- Corrosive materials: **[Fire Code Chapter 31]**
- Cryogenic liquids : **[Fire Code Chapter 32]**
- Highly toxic and toxic materials systems and facilities: **[Fire Code Chapter 37]**
- Organic peroxides storage and facilities: **[Fire Code Chapter 39]**
- Oxidizer systems and facilities: **[Fire Code Chapter 40]**
- Pyrophoric materials systems and facilities: **[Fire Code Chapter 41]**
- Unstable (Reactive) materials systems and facilities: **[Fire Code Chapter 42]**
- Water-reactive solids and liquids systems and facilities: **[Fire Code Chapter 44]**
- Former laboratory rule for pre-existing laboratories **[Rule Section 4827-01(g)(1), 4827-01(g)(2)]**

## **1. DEFINITIONS**

**BASEMENT:** A story partly below the grade plane and having less than one-half its clear height (measured from finished floor to finished ceiling) below the grade plane.

**BOILING POINT:** The temperature at which the vapor pressure of a liquid equals the atmospheric pressure of 14.7 pounds per square inch (psia) or 760 mm of mercury. Where a boiling point is unavailable for the material in question or for mixtures which do not have a constant boiling point, for the purposes of this classification, the 20-percent evaporated point of a distillation performed in accordance with ASTM D 86 shall be used as the boiling point of the liquid.

**CHEMICAL:** An element, chemical compound or mixture of elements or compounds or both.

**CHEMICAL NAME:** The scientific designation of a chemical in accordance with the nomenclature system developed by the International Union of Pure and Applied Chemistry (IUPAC), the Chemical Abstracts Service rules of nomenclature, or a name that will clearly identify a chemical for the purpose of conducting an evaluation.

**CLOSED CONTAINER:** A container sealed by means of a lid or other device capable of preventing the escape of liquid, vapor or dusts in the ordinary course of storage, handling or use.

**COMBUSTIBLE LIQUID:** Any liquid that has a closed-cup flash point at or above 100°F, as determined by the standard test procedures.

**CONTAINER:** For solid and liquid hazardous materials, a vessel of 60 gallons or less in capacity used for storage or transportation. For compressed gases, a container, pressure vessel or tank designed for pressures greater than one atmosphere at 68°F. Pipes, piping systems, engines and engine fuel tanks associated with solid or liquid hazardous materials or compressed gases, shall not be deemed to be containers if in active use.

**CORROSIVE MATERIALS:** A liquid, solid, or gas that causes permanent injury (“full thickness destruction”) to human skin at a rate specified by the Department of Transportation (DOT) regulations. Or a liquid that can corrode ¼ inch of steel or aluminum within the course of a year.

**DESIGN PRESSURE:** The maximum gauge pressure that a pressure vessel, device, component or system is designed to withstand safely under the temperature and conditions of use.

**DISPENSING:** The pouring or transferring by other means of any material from a container, tank or similar vessel, which would release dusts, fumes, mists, vapors or gases to the atmosphere, unless such release is prevented by a device, equipment or system designed for that purpose.

**EXCESS FLOW CONTROL:** A fail-safe system or other approved device, equipment or system designed to shut off flow caused by a rupture in a pressurized piping system.



**EXHAUSTED ENCLOSURE:** A device, typically consisting of a hood equipped with a fan that serves to capture and exhaust fumes, mist, vapors and gases generated at a workstation or other local environment. An exhausted enclosure does not include a room provided with general ventilation.

**EXPLOSION;** An effect produced by the sudden violent expansion of gases, whether or not accompanied by a shock wave or disruption, of enclosing materials, including the effects of the following sources of explosion:

1. Chemical changes such as rapid oxidation, deflagration or detonation, decomposition of molecules and runaway polymerization (usually detonations).
2. Physical changes such as pressure tank ruptures.
3. Atomic changes (nuclear fission or fusion).

**FACE VELOCITY:** The rate of flow or velocity of air moving into the chemical fume hood entrance or face, as measured at the plane of the chemical fume hood face.

**FIRE SEPARATION:** A horizontal or vertical fire resistance-rated assembly of materials that have protected openings and are designed to restrict the spread of fire.

**FLAMMABLE GAS:** Any substance that exists in the gaseous state at normal atmospheric temperature and pressure and is capable of being ignited and burned when mixed with the proper proportions of air, oxygen, or other oxidizers.

**FLAMMABLE LIQUID:** Any liquid that has a closed-cup flash point below 100°F, as determined by the standard test procedures.

**FLAMMABLE SOLID:** A solid, other than a blasting agent or other explosive, whether in elemental or alloy form, that is capable of causing fire through friction, absorption of moisture, spontaneous chemical change, or heat retained from manufacturing or processing, or which has an ignition temperature below 212°F or which burns so vigorously and persistently when ignited as to create a serious hazard. Examples include Aluminum powder, Camphor, Magnesium, Matches, Naphthalene, Nitrocellulose, Phosphorus, Sulfur and Picric Acid (wetted with not less than 10% water).

**FLAMMABLE VAPORS OR FUMES:** The concentration of flammable constituents in air that exceeds 25 percent of their lower flammable limit (LFL).

**FLASH POINT:** The minimum temperature in degrees Fahrenheit at which a liquid will give off sufficient vapors to form an ignitable mixture with air near the surface or in the container, but will not sustain combustion. The flash point of a liquid shall be determined by appropriate test procedure and apparatus as specified in ASTM D 56, ASTM D 93 or ASTM D 3278.

**GAS CABINET:** A fully enclosed, noncombustible enclosure used to provide an isolated environment for compressed gas containers in storage or use, including any doors and access ports for exchanging containers and accessing pressure-regulating controls.

**GENERAL SUPERVISION:** Supervision by the holder of any certificate of fitness who is responsible for performing the duties set forth in the Fire Code but need not be personally present on the premises at all times. The storage of any hazardous material in quantities requiring a permit shall be under the general supervision of a certificate of fitness holder.

**HANDLING:** The movement of a material in its container, the removal of the material from its container, or any other action or process that may affect the material, other than its storage or use.

**HAZARDOUS LOCATIONS CLASSIFICATIONS DESCRIPTIONS FOR CLASS 1 DIVISION 2:** Where ignitable concentrations of flammable gases, vapors, or liquids are present within the atmosphere under abnormal operating conditions.

**HAZARDOUS MATERIALS:** Those chemicals or substances that are physical hazards or health hazards as defined and classified in the Fire Code, whether the materials are in usable or waste condition.

**HAZARDOUS WASTES:** Those chemicals or substances in waste condition that are physical hazards or health hazards as defined and classified in this definition section.

**HEALTH HAZARD:** A classification of a chemical for which there is statistically significant evidence that acute or chronic health effects are capable of occurring in exposed persons. The term “health hazard” includes chemicals that are toxic, highly toxic and corrosive.

**IMPAIRMENT COORDINATOR:** The person designated by the owner who is responsible for ensuring that proper notification and safety precautions are taken when a fire protection system is out of service. The role of impairment coordinator in schools will always be assigned to either the Custodian Engineer or the Building Manager if they are on the premises. There may be a limited number of locations where the landlord has the responsibility to designate the impairment coordinator.

**INCOMPATIBLE MATERIALS:** Materials that, if mixed or combined, could explode, generate heat, gases or other byproducts, or react in a way hazardous to life or property.

**LABORATORY CHEMICAL:** A material with a health, flammability and/or instability (reactivity) hazard ranking of 2, 3 or 4 as defined in NFPA 704.

**LABORATORY UNIT:** An enclosed space of a minimum one-hour fire rated construction, designed or used as a non-production laboratory. Laboratory units may include one or more separate laboratory work areas, and accessory storage rooms or spaces within or contiguous with the laboratory unit, such as offices and lavatories.

**LABORATORY WORK AREA:** a room of space for testing, analysis, research, instruction, or similar activities that involve the use of chemicals.

Revised on March 2024 (Apply/Pay)

**LC50:** LC stands for "Lethal Concentration". A LC50 value is the amount of a gas, dust or mists that it takes to kill 50% of test animals (for example, mice or rats) in one dose. Like LD50 various tests and animals may be utilized. In addition the duration of exposure may vary. For the purposes of the Fire Code this is a one hour test utilizing rats.

**LD50:** LD stands for "Lethal Dose". A LD50 value is the amount of a solid or liquid material that it takes to kill 50% of test animals (for example, mice or rats) in one dose. It is a standard measurement of the short-term poisoning potential (acute toxicity) of a solid or liquid material. LD50 values are expressed in terms of the tests and animal used (i.e. LD50 (oral, rat), LD50 (skin, mouse)) other animals (dogs, hamsters, cats, guinea-pigs, rabbits, and monkeys) are sometimes utilized but the Fire Code is very specific regarding test species (oral-rats and skin-rabbits). The LD50 value is expressed as the weight of chemical administered per kilogram body weight of the animal, the test animal used and route of exposure. So, the example "LD50 (oral, rat) 5 mg/kg" means that 5 milligrams of that chemical for every 1 kilogram body weight of the rat, when administered in one dose by mouth, causes the death of 50% of the test group.

**LECTURE BOTTLE:** A small compressed gas container up to a size of approximately 2 in. X 13 in.

**LIQUID:** A material having a melting point that is equal to or less than 68°F and a boiling point that is greater than 68°F at 14.7 psia. When not otherwise identified, the term "liquid" includes both flammable and combustible liquids.

**LOWER EXPLOSIVE LIMIT (LEL):** See "Lower flammable limit."

**LOWER FLAMMABLE LIMIT (LFL):** The minimum concentration of vapor in air at which propagation of flame will occur in the presence of an ignition source. The LFL is sometimes referred to as LEL or lower explosive limit.

**MATERIAL SAFETY DATA SHEET (MSDS):** A document prepared in accordance with the regulations of the United States Department of Labor, as set forth in 29 CFR Part 1910.1200 or a federally approved state OSHA plan which sets forth information concerning a hazardous material.

**NON-PRODUCTION LABORATORY:** A building or portion thereof wherein chemicals or gases are stored, handled or used on a non-production basis for testing, research, experimental, instructional or educational purposes.

**NORMAL TEMPERATURE AND PRESSURE (NTP):** A temperature of 70°F and a pressure of 1 atmosphere.

**ORGANIC PEROXIDE:** An organic compound having a double oxygen or peroxy (-O-O-) in its chemical structure. Organic peroxides can present an explosion hazard (detonation or deflagration), can be shock sensitive, can be susceptible to decomposition into various unstable compounds over an extended period of time. The materials are divided in to six classes from Classes I through V and unclassified detonable class, with decreasing levels of hazard from Class I through Class V.

**OUT OF SERVICE SYSTEM:** This is a fire protection system that is not fully functional; or whose operation is impaired or is otherwise not in good working order.

**OXIDIZER:** A material that readily yields oxygen or other oxidizing gas, such as bromine, chlorine and fluorine, or that readily reacts to promote or initiate combustion of combustible materials. The materials are divided in to 4 classes, with increasing level of hazard from Classes 1 through 4.

**PERSONAL SUPERVISION:** Supervision by the holder of any certificate of fitness who is required to be personally present on the premises, or other proximate location acceptable to the Fire Department, while performing the duties for which the certificate is required.

**PHYSICAL HAZARD:** A chemical for which there is evidence that it is a combustible or flammable liquid; a flammable solid or gas; an explosive; an organic peroxide; an oxidizer; a pyrophoric material; an unstable (reactive) material; a water-reactive solid or liquid; or a cryogenic liquid.

**PRE-EXISTING LABORATORY:** Non-production laboratories approved by the Fire Department prior to July 1, 2008 do not have to, and in some case could not, comply the design and installation requirements of the 2008 Fire Code. Such laboratories are considered to be "pre-existing laboratories" and are required to comply with the design and installation requirements in effect at the time the laboratory was established. Throughout this study material you will see references and requirements that are applicable to "pre-existing laboratories". It is important that you understand what this means. Generally, original permits for laboratories issued by Fire Department prior to July 1 2008 would be subjected to compliance with the former rule requirement. Generally, original permits for laboratories issued after July 1 2008 would be subject to compliance with the new fire code. Therefore, it is possible that there can be two different kinds of non-production chemical laboratories in the same building, both supervised by one certificate of fitness holder. The certificate of fitness holder will have the responsibility of distinguishing and ensuring compliance with the different code requirements.

On the other hand, both new and pre-existing laboratories are required to comply with the operational and maintenance requirements of the 2008 Fire Code. Operational and maintenance requirements include such things as permits, certificate of fitness, signage, housekeeping, periodic testing and portable fire extinguishers.

**PYROPHORIC MATERIAL:** A material that is so chemically unstable that it may ignite spontaneously at a temperature at or below 130°F.

**REDUCED FLOW VALVE:** A valve equipped with a restricted flow orifice and inserted into a compressed gas container that is designed to reduce the maximum flow from the valve under full-flow conditions. The maximum flow rate from the valve is determined with the valve allowed to flow to atmosphere with no other piping or fittings attached.

Revised on March 2024 (Apply/Pay)

**SAFETY CAN:** An approved container with a capacity of not more than 5-gallons and equipped with a spring-closing lid and spout cover designed to relieve internal pressure when exposed to fire.

**SASH:** A movable panel or panels set in the hood entrance.

**SOLID:** A material that has a melting point and decomposes or sublimates at a temperature greater than 68°F.

**STANDARD CUBIC FEET (SCF):** Cubic feet of gas at normal temperature and pressure (NTP).

**STORAGE CABINET:** A cabinet for the storage of flammable and combustible liquids constructed in accordance with section 6.3 of NFPA 30.

**UNSTABLE(REACTIVE) MATERIAL:** A material, other than an explosive, that will vigorously polymerize, decompose, condense or become self-reactive and undergo other violent changes, including explosion, when exposed to heat, friction or shock, or in the absence of an inhibitor, or in the presence of contaminants, or in contact with incompatible materials. The materials are divided in to 4 classes, with increasing level of hazard from Classes 1 through 4.

**WATER-REACTIVE MATERIAL:** A material (solid, liquid, or gas) that has a dangerous chemical reaction when reacting with water. Upon coming in contact with water, a water reactive material may explode, violently react, produce flammable, toxic, or other hazardous gases, and/or generate enough heat to cause ignition of the material or nearby materials. Water-reactive materials are divided in to Classes 1 through 3, with increasing levels of hazard from Class 1 to Class 3.

## **2. PREVENT LABORATORY FIRE/EXPLOSION ACCIDENTS**

**Although most school laboratory accidents do not involve fires and/or explosions (as compared to cuts from broken glass, chemical spills and exposure to hazardous materials) those accidents resulting from the mishandling and/or mislabeling of hazardous materials can be catastrophic, resulting in multiple injuries to students and teachers, many causing permanent disfigurement, property damage to the school building, with millions of dollars in payouts from ensuing lawsuits**

There are some flammable liquids which have the potential to be particularly dangerous unless specific precautions are taken. The United States Chemical Safety Board (CSB) knows of at least 12 methanol-related fires in science demonstrations since 2000, four of which have occurred this year.

### **01/02/2014 Rainbow fire experiment incident, New York, NY**

Two students at a public high school were badly burned when the teacher was demonstrating a “rainbow experiment”. The rainbow experiment involves burning various metal flakes to create multicolored flames. The rainbow experiment also injured children in Ohio in 2006.

### **09/03/2014 Fire tornado experiment incident, Reno, NV**

Thirteen people, mostly children, were burned by a methanol-fueled flash fire during a science demonstration called the "Fire Tornado" at a museum in Reno. A green-colored "Fire Tornado" results from a methanol flame near boric acid, a common ant and roach killer.

### **09/03/2014 Lab fire incident, Denver, CO**

Four students were injured during a chemistry-class demonstration at a charter high school. The teacher added methanol from a large container to a small flame — which flashed back into the container and then out about 12 feet, striking a student in the chest.

### **10/20/2014 Chemical explosion, Raymond, IL**

Three Cub Scouts and an adult were injured when a parent poured methanol onto boric acid near an open flame.

### **Lessons to be learned from the four incidents:**

In the words of American Chemical Society (ACS) safety experts, “The ‘Rainbow’ demonstration performed **on an open bench using a flammable solvent is a high risk operation.**”

The recent incidents of methanol fires in schools are just one example of what can happen when lab demonstrations are adopted and used – with the best of educational intentions – but without **a thorough review of the hazards and the development of robust safety procedures.**

**All schools and science educators should discontinue any use of bulk methanol – or other similar flammables – in lab demonstrations that involve combustion, open flames, or ignition sources.**

In addition, as noted in the January 14, 2014 edition of *Principals' Weekly*, **the NYCDOE suspended the use of the “rainbow experiment”**. Principals of schools serving grades 9-12 were also notified about this decision separately in an email from Deputy Chancellor Kathleen Grimm sent on January 10, 2014. Furthermore, the New York State Education Department (NYSED) provided additional information in an email to all principals across the State on January 14. Furthermore, the New York State Education Department (NYSED) provided additional information in an email to all principals across the State on January 14, 2014. In accordance with those prior decisions and based upon recent recommendations from the [United States Chemical Safety Board](#), the NYC public school teachers and staff must comply with the following directives:

- **The rainbow experiment is suspended indefinitely** –staff should not use the experiment in schools;
- **All schools cannot store bulk quantities** (two liters or more) **of methanol** or other similar flammables;
- All schools must use metal cabinets that are appropriate for storing flammable materials; and
- No staff is permitted to remove or dispose of methanol or other similar flammables without being supervised by a D-14/D-15/C-14 Certificate of Fitness holder.

If you have questions regarding the safe removal of bulk quantities of methanol or other similar flammables, contact [Bernie Orlan](#).

There are safer alternative ways to demonstrate the same scientific phenomena, and many teachers are already using them. **Any other use of methanol or other flammables should be either avoided completely or restricted to minimal amounts**, which have been safely dispensed at remote locations. **Bulk containers of flammable liquids must never be positioned or handled near viewing audiences**, especially when there are potential ignition sources present. There are well-known safer alternatives to the rainbow demonstration where no methanol is used, if you would like guidance regarding alternative demonstrations and experiments, contact [Dr. Denise McNamara](#). **Safety must be the absolute priority in all demonstrations.**

### **What should we do to prevent chemical fire/explosion accidents?**

- (1) Review the demonstration and lab activity scheduled for the day with particular attention to all recommended safety precautions.
- (2) Follow all procedures and precautions noted in the DOE approved Science Safety Manual.
- (3) Make sure you are wearing the appropriate personal protective equipment (i.e., chemical splash goggles, laboratory aprons or coats, and gloves) whenever handling hazardous materials in the storage room.
- (4) Know the location of and how to use all safety and emergency equipment (i.e., safety shower, eyewash, first-aid kit, fire blanket, fire extinguishers and mercury spill kits).
- (5) Never allow the containers storing flammable or combustible liquids to be left open. The vapors can escape from the container and may exceed 25 percent of

the lower flammable limit. The accumulation of the vapor will be easily ignited. Always cap the containers to reduce the vapors.

- (6) Identify any malfunctioning safety equipment, never use defective equipment
- (7) Only that amount of hazardous material required for a specific experiment should be brought into a laboratory or demonstration room.
- (8) Review the planned demonstrations and experiments planned with the teachers to ensure that everyone understands the potential hazards associated with the demonstration or experiment
- (9) Avoid any high risk open flame experiment or demonstration. If it is required, the instructor must keep students away from the demonstration table as far as possible (e.g. 10 feet to 15 feet). A safety shield is recommended to be placed between the students, teacher, and the demonstration.
- (10) Ensure chemicals are correctly identified with legible labels
- (11) Ensure chemicals are properly stored and separated where required for safety
- (12) A well-ventilated room can greatly reduce the risk of explosion.
- (13) Make sure no flammable/combustible solvents are in the surrounding area when lighting a flame.
- (14) Use fume hoods or snorkels whenever possible
- (15) Never heat a flammable liquid with a flame. Extremely harmful fires happen when additional flammable solvent is added to a hot vessel over a flame during a flame test.
- (16) Avoid the use of open flames where flammable or combustible materials will be involved. The flammable or combustible materials should be kept at least 20 feet away.
- (17) Use hot plates instead of Bunsen burners for most basic lab procedures that require heating. If Bunsen burners are used, exercise extreme caution. Always check Bunsen burners and other gas emitting equipment for leaks and cracks. Know where the master switch is to turn off all the gas to the room.

### **3. FIRE DEPARTMENT PERMIT**

A permit is required to maintain a non-production chemical laboratory or storage room in which more than **1 gallon of flammable or combustible liquid** or **75 SCF of flammable gas** are handled, stored in testing, research, experimental or instructional work. This permit will be issued by the Fire Commissioner after the location has been inspected and approved as acceptable for such practices.

**The FDNY permit must be posted in every laboratory requiring permit.** The Certificate of Fitness holder is responsible for ensuring that all required permits are posted in visible locations. The holder is responsible for complying with the requirements of the Fire code. **The Certificate of Fitness holder MUST NOT store or handle any flammable/combustible liquid exceeding 1 gallon or flammable gas exceeding 75 SCF in any laboratory without FDNY permit** (for example, many science demo rooms do not have FDNY permit).


Permits are valid for 12 months only. Every permit or renewal shall require an inspection and shall expire after twelve months. Permits are not transferable and any change in occupancy, operation, tenancy or ownership shall require that a new permit



Revised on March 2024 (Apply/Pay)

be issued. Current permits (or a legible copy) shall be readily available for inspection by any representative of the Fire Department.

### Fire Department Permit Sample

FIRE DEPARTMENT, CITY OF NEW YORK			<b>PERMIT</b>		BUREAU OF FIRE PREVENTION							
ACCOUNT NUMBER	TYPE	A.P.	D.O.	ADM. CO.	ISSUANCE DATE	PERMIT EXPIRES						
88888888	10	J	27	E777	2/29/08	2/11						
PREMISES ADDRESS				ACCOUNT NAME								
HANSEN BLDG HA19-84 111 ELM AVENUE BROOKLYN, NY 11227-4905				UNIVERSITY LABORATORY								
ITEM CODE	SUB CODE	QTY	DESCRIPTION		FLOOR NO.	FEE						
745	01	1	LAB = OR < 2500 SQ FT RENEWAL		19	105.00						
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="text-align: center;">PERMIT TYPE</td> </tr> <tr> <td style="text-align: center;">1</td> </tr> </table>					PERMIT TYPE	1	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;">           1=REGULAR            2=SUPPLEMENTAL            3=DUPLICATE         </td> <td style="width: 40%; text-align: right;">           UNIVERSITY LABORATORY OF THE BOROS            111 ELM AVENUE            BROOKLYN, NY 11227-4905         </td> </tr> <tr> <td> </td> <td style="text-align: right;">105.00</td> </tr> </table>		1=REGULAR 2=SUPPLEMENTAL 3=DUPLICATE	UNIVERSITY LABORATORY OF THE BOROS 111 ELM AVENUE BROOKLYN, NY 11227-4905		105.00
PERMIT TYPE												
1												
1=REGULAR 2=SUPPLEMENTAL 3=DUPLICATE	UNIVERSITY LABORATORY OF THE BOROS 111 ELM AVENUE BROOKLYN, NY 11227-4905											
	105.00											
		LAB UNIT HA19-84, TYPE 2 SFTY SHWR ACCESS, WTR REACT MTL C-14 COF, TYP D EXTGR REQD		BY ORDER OF THE COMMISSIONER								
2008049502												

**Permit demonstrates to the satisfaction of the Fire Department that the design, installation, operation and maintenance of the laboratory or the storage room have been complied with the Fire Code.** In addition to the requirements of Fire Code, all applicants for a permit must meet the requirements of the Department of Buildings. Other agencies such as NYCDOH, NYCDEP, NYSDEC, OSHA, and USEPA may have additional requirements.

#### 4. PORTABLE FIRE EXTINGUISHERS

**Fire extinguishers must be provided in each laboratory and storage area.** The Certificate of Fitness holder should verify that the required fire extinguisher:

- (1) is in good working order
  - a. it is fully charged and operable
  - b. it has not been actuated or tampered with
  - c. there is no obvious or physical damage
- (2) is located in conspicuous, unobstructed, readily accessible location (it is highly recommended that there is an extra fire extinguisher to be placed on the teacher's demonstration table before starting a laboratory class).

Generally, dry-chemical extinguishers are installed in laboratories and storage areas. These extinguishers or extinguishers suitable for more than one class of fire are most effective when they are discharged at the base of the fire. However, the Fire Commissioner may require other types of extinguishers depending on the nature of the chemicals used in the laboratory.

Fire extinguishers must be located in conspicuous locations where they will be readily accessible and immediately available for use. These locations must be along normal paths of travel. Fire extinguishers having a gross weight 40 pounds or less must be installed so that the top of the extinguisher is not more than 5 ft above the floor. Hand-held fire extinguishers having a gross weight exceeding 40 pounds shall be installed so that their tops are not more than 3.5 feet above the floor. The clearance between the floor and the bottom of installed hand-held extinguishers shall not be less than 4 inches. In other words, **no fire extinguisher is allowed to be on the floor.**



- (1) For the fire extinguisher having 40 pounds or less, its top must not be more than 5 ft above the floor
- (2) The fire extinguishers must be accessible and unobstructed.



- (1) The bottom of the fire extinguisher must be at least 4 in above the floor.
- (2) The fire extinguisher must be properly mounted.



In the event of a fire extinguisher has been discharged, a fully charged replacement is required before work can resume. Portable fire extinguishers are important in preventing a small fire from growing into a catastrophic fire, however, they are not intended to fight large or spreading fires. **By the time the fire has spread, fire extinguishers, even if used properly, will not be adequate to extinguish the fire. Such fires should be extinguished by the building fire extinguishing systems or trained firefighters only.**



**In case of fire, 911 must be called.** Fire extinguishers must be used in accordance with the instructions painted on the side of the extinguisher. They clearly describe how to use the extinguisher in case of an emergency. The Certificate of Fitness holder should be familiar with the use of portable fire extinguishers. When it comes to using a fire-extinguisher just remember the acronym P.A.S.S. to help make sure you use it properly. P.A.S.S. stands for Pull, Aim, Squeeze, Sweep. An example of these instructions is depicted in the picture.

The Certificate of Fitness holder must be familiar with the different types of fire extinguishers that are present. He/she must know how to operate the extinguishers in a safe and efficient manner. He/she must know the difference between the various types of extinguishers and when they should be used. A description of the five classes of fires and the appropriate extinguishers are described below.

**Class A fires** occur when ordinary combustible materials are ignited. For example, wood, cardboard, and most plastics fires are Class A fires. Water type extinguishers should be used to extinguish these fires. The water type extinguishers cool the fire while quenching the flame.









**Class B fires** occur when flammable liquids such as gasoline, kerosene, grease and oil are ignited. These fires must be extinguished by smothering the flame. The flame may be smothered using CO<sub>2</sub>, dry chemical or foam extinguishers. Water type extinguishers should not be used for class B fires. However, personnel should be aware that CO<sub>2</sub> and dry chemical extinguishers are likely to be ineffective against oxidizer-based (e.g. oxidizer or organic peroxide) fires. All laboratories are required to have the minimum fire extinguisher rating of 20-B with maximum travel distance of 50 ft.

**Class C fires** occur when electrical equipment catches fire. These fires must be fought with fire extinguishers that do not conduct electricity. Fire extinguishers for the protection of delicate electronic chemical extinguishers must be used to extinguish electrical fires. Foam and water type extinguishers must not be used to extinguish electrical fires. After shutting off the electrical equipment, extinguishers for Class A or B fires may be used. As a result, the fire extinguisher shall be sized and located on the basis of the anticipated either Class A or Class B hazard.

**Class D fires** occur when they involve combustible metals, such as magnesium, titanium, potassium, sodium, and lithium. For metallic or pyrophoric material fires, do not use water, foam or carbon dioxide as an extinguishing agent. Dousing metallic fires with inappropriate extinguisher may generate flammable gas, an extremely dangerous explosion hazard, particularly if fire is in a confined environment. Use extinguishers designed for class D fires only.

The use of the markings to identify a fire extinguisher's suitability is particularly important: the markings are shown in the table below.

Markings to Indicate Extinguisher Suitability According to Class of Fire:

	Letter-Shaped Symbol Markings	Recommended Marking System
Class A: Ordinary Combustibles	 Ordinary Combustibles	
Class B: Flammable Liquids	 Flammable Liquids	
Class C: Electrical Fires	 Electrical Equipment	
Class D: Combustible Metals	 Combustible Metals	

Symbols may also be painted on the extinguisher. The symbols with the shaded background and the slash indicate that the extinguisher must not be used for that type of fire. Examples of these symbols are shown on the following picture. The Certificate of Fitness holder must understand these symbols.

Examples of fire extinguishers



Note: Do not use an ammonium based dry chemical fire extinguisher on chlorine-based oxidizers. The reaction between the chlorine, the oxidizer and the ammonium salts in the fire extinguishing agent may produce an explosive compound ( $NCl_3$ ). Generally, operation instructions are clearly painted on the side of the fire extinguisher. They clearly describe how to use the extinguisher in case of an emergency.

**PORTABLE FIRE EXTINGUISHER INSPECTIONS**

**MONTHLY**

The portable fire extinguishers are required to be checked monthly. The owner of the business is responsible to select a person to do a monthly inspection. This monthly inspection is called a "quick check".

The **QUICK CHECK** should check if:

- (1) the fire extinguisher is fully charged;
- (2) it is in its designated place;
- (3) it has not been actuated or tampered with;
- (4) there is no obvious or physical damage or condition to prevent its operation.

The information of the monthly inspection record must include the date of the inspection, the name/initials of the person who did the inspection. This monthly quick check record must be kept on the back of the PFE tag or by an approved electronic method that provides a permanent record.

**ANNUALLY**

At least annually all Portable Fire Extinguishers must be checked by a W-96 Certificate of Fitness holder from FDNY approved company. After each annual inspection W-96 COF holder will replace the PFE tag. The information of the annual inspection record must be indicated on the new PFE tag.

**PORTABLE FIRE EXTINGUISHER TAGS**

Installed portable fire extinguishers must have an FDNY standard PFE tag affixed. This tag will have important information about the extinguisher. By November 15, 2019, all portable fire extinguishers must have the new PFE tags. The FDNY will only recognize new PFE tags and will be issuing violations to business that have PFE installed without a proper tag.

The color of the fire extinguishers may be changed by the FDNY every few years. The FDNY recommends two ways to verify the tag’s legitimacy:

1. Hologram:

A real hologram strip shown on the tag is 3 inches long by ¼ inch wide. Counterfeit tags will NOT have a high quality silver hologram. The hologram on a counterfeit tag will NOT change color as it is moved against the light.

2. QR code

IF you scan the QR code, it should direct you to the updated FDNY approved fire extinguisher company list. You can use the company list to verify if the company printed on the list is currently approved by the FDNY.

If your PFE tags cannot be verified via these two methods, contact your supervisor. If you suspect your PFE is a counterfeit, contact FDNY immediately by e-mail:

[Tags.Decal@fdny.nyc.gov](mailto:Tags.Decal@fdny.nyc.gov)



PFE tag (This tag is released for 2021-2023)

## **5. EMERGENCY PLANNING AND PREPAREDNESS**

### **A. Emergency Plans**

The plans for laboratory emergencies to be prepared in all the public schools. The emergency plan must include the following procedures in the event of a chemical emergency, fire, or explosion:

- (1) Procedures for sounding the alarm;
- (2) Procedures for notifying and coordinating with the Fire Department and other emergency response agencies;
- (3) Procedures for evacuating and accounting for personnel including primary and secondary evacuation routes, as applicable;
- (4) Procedures for establishing requirements for rescue and medical duties for those requiring or performing these duties;
- (5) Procedures and schedules for conducting regular emergency drills;
- (6) Procedures for shutting down and isolating equipment under emergency conditions to include the assignment of personnel responsible for maintaining critical functions or for shut down of process operations;
- (7) Appointment and training of personnel to carry out assigned duties, including steps to be taken at the time of initial assignment, as responsibilities or response actions change, and at the time anticipated duties change;
- (8) Aisles designated as necessary for movement of personnel and emergency response;
- (9) Maintenance of fire protection equipment; and
- (10) Safe procedures for startup to be taken following the abatement of an emergency.

All laboratory users, including, but not limited to, instructors and students, must be trained on the emergency plan prior to laboratory use and at least annually thereafter. Records for such training must be maintained on the premises for a minimum of 3 years.

### **B. Emergency Procedures**

- (1) Fire notification

**In case of fire, it is required to immediately notify the emergency operator (911).**

The New York City Fire Department will respond. No supervisor or other person shall issue any directive or take any action to prevent or delay the reporting of a fire or other emergency to the Fire Department. You should also notify the Custodian Engineer or designee, who is the fire safety person familiar with the building and who will meet the responding emergency units upon their arrival, and direct them quickly to the fire area.

The Certificate of Fitness holder must know the locations of manual fire alarm system pull stations and portable fire extinguishers and how to operate them. In addition to calling 911, you should also activate the fire alarm system manual pull station. Activation of the manual pull station will sound the alarm in the building and typically will notify the Fire Department.

The Certificate of Fitness holder should know how to respond when an individual's clothing has caught fire. The most important instruction for the case of clothing fires:

immediately drop to the floor and roll. If the person is panicking and running, other people in the area should immediately knock that person to the floor and roll that person around to smother the flames. In all cases, immediately seek medical attention.

(2) Spill notification

In case of a major spill, the Certificate of Fitness holder must notify the Fire Department by calling 911 immediately.

**C. Penalties for Non-compliance with Fire Code**

All applicants and certificate holders are required to promptly notify the Fire Department and the Department of Education of any change in the applicant's or certificate holder's residence address, any change in work location when such location is required for and/or indicated on such certificate or permit and such other information as the Department may require. Certificate of Fitness holders and permit holders must ensure that all requirements of the Fire Code and Fire Department Rules are met. Failure to comply with these provisions may subject Certificate of Fitness holder and/or permit holders to enforcement action, including violations. Generally, violation orders will go to the school principal, while Notices of Violation will be sent to the Department of Education. **The Certificate of Fitness may be revoked if the C of F holder is negligent in failing to comply with the requirements of the NYC Fire Code and Rules.**




## 6. LABORATORY UNIT DESIGN AND EQUIPMENTS

### A. Signs Requirements.

#### (1) NFPA 704 Diamond Sign

It is highly recommended that in addition to identify the lab; hazard diamond signs should be posted. These signs should be conspicuously affixed at entrances to locations where hazardous materials are handled, including dispensing, in quantities requiring a permit, including locations where such materials are dispensed, and at such other locations as may be designated by the commissioner.

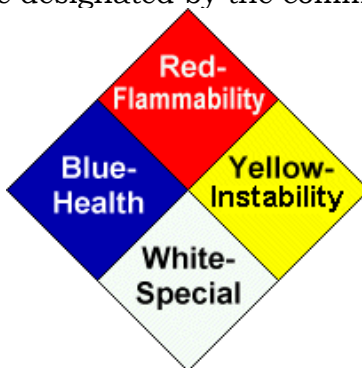

The NFPA National Fire Protection Association ([www.nfpa.org](http://www.nfpa.org)), a private, non-profit organization that produces technical data related to fire protection and prevention, including the widely used NFPA diamond containing codes representing chemical hazards. 704 diamond (sometimes called the "fire diamond") is a standard placard used to quickly identify a chemical's level of hazard. The diamond sign is divided into 4 quadrants:

- Within the blue, red, and yellow quadrants a number from 0 to 4 indicates the degree of risk associated with the chemical. The higher the number, the higher the risk.
- For some chemicals, the white quadrant contains symbols indicating special hazards.

The meaning of each code number and symbol is shown on the following page.

**Where more than one chemical is present in a building or specific area,** professional judgment shall be exercised to indicate ratings using the following methods:

- Composite Method. Where many chemicals are present, a single sign shall **summarize the maximum ratings contributed by the material(s) in each category and the special hazard category for the building and/or the area.** That is, it shows the highest value in each hazard category for any chemical at that location. **It may be that one chemical poses the highest health hazard, while another poses the highest flammability hazard.**
- Individual Method. Where only a few chemicals are present or where only a few chemicals are of concern to emergency responders (taking into account factors including physical form, hazard rating, and quantity), individual signs shall be displayed. The chemical name shall be displayed below each sign.

- Composite-Individual Combined Method. A single sign shall be used to summarize the ratings via the Composite Method for buildings or other areas containing numerous chemicals. Signs based on the Individual Method shall be used for rooms or smaller areas within the building containing small numbers of chemicals.

**Interpreting NFPA 704 Codes**

<b>Quadrant</b>	<b>Code</b>	<b>Meaning</b>
<b><u>Health Hazard</u></b>	4	Materials that, under emergency conditions, can be lethal.
	3	Materials that, under emergency conditions, can cause serious or permanent injury.
	2	Materials that, under emergency conditions, can cause temporary incapacitation or residual injury.
	1	Materials that, under emergency conditions, can cause significant irritation.
	0	Materials that, under emergency conditions, would offer no hazard beyond that of ordinary combustible materials
<b><u>Flammability Hazard</u></b>	4	Materials that rapidly or completely vaporize at atmospheric pressure and normal ambient temperature or that are readily dispersed in air and burn readily.
	3	Liquids and solids that can be ignited under almost all ambient temperature conditions. Materials in this degree produce hazardous atmospheres with air under almost all ambient temperatures or, though unaffected by ambient temperatures, are readily ignited under almost all conditions.
	2	Materials that must be moderately heated or exposed to relatively high ambient temperatures before ignition can occur. Materials in this degree would not under normal conditions form hazardous atmospheres with air, but under high ambient temperatures or under moderate heating could release vapor in sufficient quantities to produce hazardous atmospheres with air.
	1	Materials that must be preheated before ignition can occur. Materials in this degree require considerable preheating, under all ambient temperature conditions, before ignition and combustion can occur.
	0	Materials that will not burn under typical fire conditions, including intrinsically noncombustible materials such as concrete, stone, and sand.
<b><u>Instability (Reactivity) Hazard</u></b>	4	Materials that in themselves are readily capable of detonation or explosive decomposition or explosive reaction at normal temperatures and pressures.
	3	Materials that in themselves are capable of detonation or explosive decomposition or explosive reaction but that require a strong initiating source or must be heated under confinement before initiation.

Quadrant	Code	Meaning
	2	Materials that readily undergo violent chemical change at elevated temperatures and pressures.
	1	Materials that in themselves are normally stable but that can become unstable at elevated temperatures and pressures.
	0	Materials that in themselves are normally stable, even under fire conditions.
<b>Special Hazard</b>	<b>“W”</b>	The materials that react violently or explosively with water (water reactivity rating of 2 or 3).
	<b>“OX”</b>	The materials that possess oxidizing properties. The severity of the hazard posed by an oxidizer can be divided in to 4 classes from Classes 1 through 4. The adding of the quantification of the oxidation helps to better define the hazard. For example, for the material categorized as a Class 2 oxidizer (e.g. calcium chlorite) can be marked <b>“OX 2”</b> to better define the hazard.

(2) “No Smoking” sign.



“No Smoking” signs when provided shall be in English as a primary language and conspicuously posted in the following locations:

- a.) In rooms or areas where hazardous materials are stored.
- b.) Within 25 feet of outdoor hazardous material storage and handling areas, including dispensing areas.
- c.) Facilities or areas within facilities in which smoking has been entirely prohibited.

The Fire Department has published an approved “No Smoking” sign. It is set forth in Fire Department rule (as the figure). However, the Fire Department does not mandate that this design be used. Other legible, durable signs, clearly communicating the “no smoking” requirement, may be used,

but are subject to Fire Department enforcement action if found to be inadequate.

(3) Other relevant signs, such as DOT are shown in Appendix II.

## **B. Fume Hoods and Exhaust Systems**



Approved fume hoods and exhaust systems which are installed to limit work place exposure to hazardous or noxious fumes, vapors or dusts. In general, fresh air is drawn in from the open side of the fume hood, and expelled outside the building (ducted type fume hood). Although commonly used outside N.Y.C., hoods made safe through filtration and fed back into the room are not allowed to be used in the city.


The hoods are designed for use when working with chemicals and must NOT be used for the storage of chemicals. Users should be periodically reminded to open hood sashes slowly and to allow hood sashes to be open only when needed. Chemical fume hoods shall be located in areas of minimum air turbulence, so people walking past the hood or place irrelevant activities should be minimized. The Certificate of Fitness holder must make sure that these systems are maintained in good working

order and make sure that the face velocity of chemical fume hoods, exhaust systems, and laboratory special exhaust systems are inspected and tested annually by qualified inspectors.

With the exception of educational facilities, fume hood installations in pre-existing laboratories were required to provide a minimum average face velocity of 100 feet per minute (fpm) with a minimum face velocity at any point no less than 75 fpm. While no maximum face velocity or sash test height criteria was adopted, nationally recognized standards did recognize fume hoods with maximum face velocity limits ranging from 120 to 150 fpm and sash heights in the 12 to 18 inch range as acceptable. For new laboratories, NFPA 45 requires fume hoods to be evaluated using ASHRAE Standard 110, Method of Testing Performance of Laboratory Fume Hoods. ASHRAE Standard 15 indicates that face velocities of 80 to 120 fpm will generally provide the required containment. NFPA Standard 45, however, does not mention a required sash height that should be used when tested for face velocity.

In order to allow that pre-existing fume hoods be permitted to meet the lower minimum average fume hood face velocities specified in NFPA Standard 45, and for the sake of uniformity, fume hood installations in pre-existing laboratories would be required to meet an average face velocity range of 80 to 150 fpm at a sash height range of 12 to 18 inches. The new labs, however, are required to meet an upper limit of 120 fpm or pass an ASHRAE 110 test. Fume hoods operating outside of this range would be required to be repaired, replaced, or otherwise altered to meet the required range, unless acceptable to the Fire Department based upon an evaluation by a qualified professional of the fume hood's performance. Fume hoods failing to satisfy any of the above criteria should be removed from service until such time as a remedy is established. Fume hoods taken out of service should be marked as such (e.g. "DO NOT USE").

The physical condition of the hood interior, sash, and ductwork need to be visually inspected if they are clean, dry, tight, and friction-free. An annual label (inspection record) for recording inspection interval, last inspection date, average face velocity, and inspector's name shall be affixed to each hood.

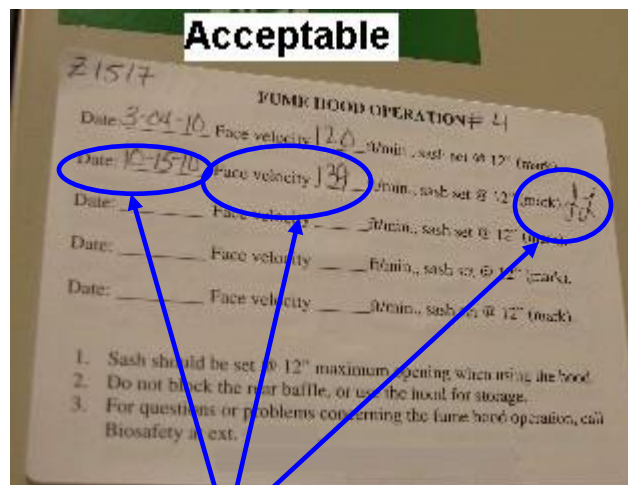

An annual inspection record with "Date", "Face velocity" and "Inspector's name".

Keep the hood sash closed as much as possible when the fume hood is not in use.



**Special requirements for Chemical fume hood using perchloric acid:**

When perchloric acid is heated above ambient temperatures, it will give off vapors that can condense and form explosive perchlorates. In order to decrease the potential hazard, the heating process must be only used in a chemical fume hood specially designed for perchloric acid operations or in a hood that the vapors can be trapped and scrubbed before they are released into the hood. The hood, exhaust ductwork, and fan shall be acid resistant, nonreactive, and impervious to perchloric acid. A water spray system shall be provided for washing down the hood interior behind the baffle and the entire exhaust system after each use, the effective washing down method has been recommended in the *CRC Handbook of Laboratory Safety*.

**C. Safety Showers, Neutralizing or Absorbing Agents and Curtains**

Where more than 5 gallons of corrosive liquids or flammable liquids are stored or handled, fixed overhead or flexible hand-held safety showers must be available in the laboratory, or outside the laboratory within 25 feet of laboratory/storage-room entrance door. Additionally, neutralizing or absorbing agents shall be provided. Safety showers shall be tested annually and a record of such maintenance must be maintained on the premise.



Curtain and drapes used in laboratories must be documented as “flame proof” (chemically treated) or “inherently flame resistant”. Documentation must be provided by a person holding a “flame proofing certificate of fitness”.

#### **D. Means of access to an Exit**

It shall be unlawful to obstruct or impede access to any required means of egress. All required means of egress, including each exit, exit access and exit discharge, shall be continuously maintained free from obstructions and impediments to immediate use in the event of fire or other emergency. Emergency lighting facilities shall be provided for any laboratory work area requiring a second means of access to an exit.

#### **E. Storage Room Requirements**

**Use chemical storage room only for storing chemicals.** Storage rooms shall be equipped with a continuously operated ventilation system that provides at least 6 room air changes per hour and vents to the outdoors. Chemicals shall not be used and all incompatible materials must be separated within the storage room.

## **7. CHEMICAL STORAGE, HANDLING, AND WASTE DISPOSAL**

### **A. General Operations, Housekeeping and Good Work Practices**

Poor operations, housekeeping & work practices are one of the leading causes of hazardous material incidents, work place accidents and fires. Before performing any chemical reaction, evaluation shall be made for hazards that can be encountered or generated during the course of the work. The evaluation must include (1) the hazards associated with the properties and the reactivity of the materials used and any intermediate and end products that can be formed; (2) the hazards associated with the operation of the equipment at the operating conditions; (3) and the hazards associated with the proposed reactions, for example, oxidation and polymerization. Poor housekeeping can result in fire accidents, lost tools/supplies, damaged equipment and contribute to higher operating costs. Good housekeeping minimizes fire, accidents, reduces waste & disposal costs, increases efficiency and generally results in cheaper production costs. Areas kept in neat & organized condition provides a positive impression on inspectors. The following is some guidance on good practices.

#### **(1) General Housekeeping and Standards:**

- Access doors, aisles and exit doors clear of obstructions. Keep storage of items out of hallways and stairwells. The Fire Code contains various requirements for aisle spacing depending upon stacking arrangements.
- Secure storage areas to minimize liability and hazards of intrusion or dumping.
- Be familiar with the use, limitations and location of emergency equipment such as emergency eyewashes, safety showers, fire alarms, exits and fire extinguishers.
- Be aware of Fire Code storage requirements for permit and certificates of fitness.
- Safety Data Sheet (SDS) information should be readily available. An example of SDS could be referred to Appendix III.
- The following areas shall require special consideration:
  - Handling and storage of chemicals, flammable and combustible liquids, and gases
  - Open flame and spark-producing equipment hot work authorization
  - Arrangements and use of portable electric cords

#### **(2) Work Areas:**

- Empty, but not clean, containers should be handled as having the same hazards as non-empty containers. In some cases, the **residual vapors are more dangerous than the liquids**. For example, gasoline vapors are more flammable than liquid gasoline.
- Keep work areas clean and free of obstructions.
- Limit the amount of hazardous materials to the minimum needed for an operation and **keep process containers covered when not being used**.
- Clean surfaces (counter tops, bench tops, fume hoods and floors) of drips and residues.
- Clean spilled chemicals immediately. Small spills can be cleaned up by properly trained employees with the appropriate spill response supplies and dispose of all wastes properly.

- Any release of hazardous material into a sewer, water way, ground or atmosphere shall be subjected to comply with all requirement of federal, state, or local regulations.
- Routinely inspect and address potential sources of leaks and spills including tanks, pipes, hoses and container storage areas. Spill control equipment & containment structures should be inspected periodically.
- Good housekeeping shall be maintained so as to avoid accumulations of the combustible dust.
- Do not handle or use of any liquid where the liquid may come in contact with any electrical receptacle, switch or control.
- All furniture, casework, and equipment in laboratory units shall be arranged so that means of access to an exit can be reached easily from any point.

### (3) Safety Procedures

School principals, in conjunction with the Custodian Engineer are responsible for ensuring the periodic inspection, testing, and maintenance of the following systems:

- Utilities (Steam, gas, electrical)
- Air supply and exhaust systems
- Fire protection equipment
- Detectors and alarms
- Compressed gas regulators and pressure relief valves
- Waste disposal systems
- Fire doors
- Emergency lighting and exit signs
- Electrically operated equipment



If the Certificate of Fitness holder is aware that any of the above systems are not operational, they shall immediately notify the Custodian Engineer and the Principal.

### (4) Separation of incompatible materials

Incompatible materials, shall be separated while in storage except for stored materials in individual containers each having a capacity of not more than 5 pounds or 0.5 gallon. Separation shall be accomplished by:

- Segregating incompatible materials in storage by a distance of not less than 20 feet.  
Or
- Storing liquid and solid materials in hazardous material storage cabinets. Materials that are incompatible shall not be stored in the same cabinet.  
Or
- Storing compressed gases in gas cabinets or exhausted enclosures in accordance with the Fire Code. Materials that are incompatible shall not be stored within the same cabinet or exhausted enclosure.  
Or
- Isolating incompatible materials in storage by a noncombustible partition extending not less than 18 inches above and to the sides of the stored material.



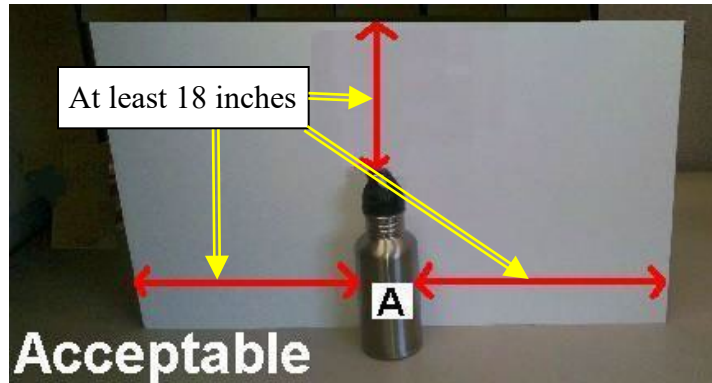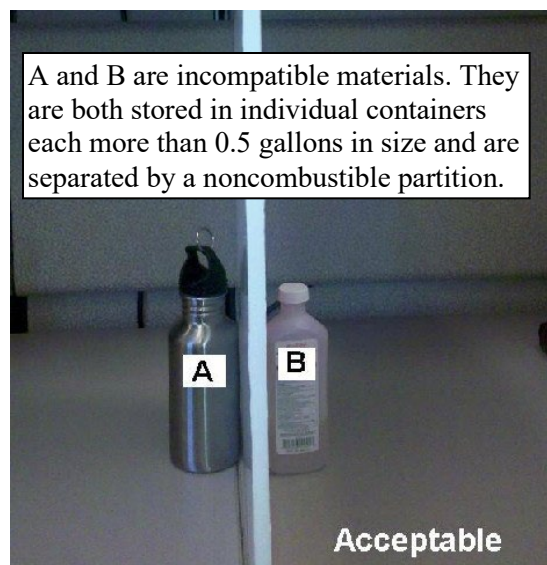

Some examples of incompatible chemicals are shown in the Appendix IV. The chemicals in the right column should not be allowed to come in contact the chemicals in the left column. The SDS's should be consulted regarding specific incompatibilities. When you dilute corrosives, especially for concentrated strong corrosives, always add the corrosive material to water slowly while stirring; never the reverse. The exothermic reaction from the dilution can cause the water to flash to steam resulting in possible thermal and chemical burns due to splashing. The list representing the commonly used laboratory chemicals and their incompatibilities with other chemicals could be referred to Appendix IV.

## **B. Prohibitions**

It shall be unlawful in any non-production laboratory or any accessory storage of laboratory chemicals in a storage room to:

1. Store or handle or use any explosive.
2. Store, handle or use any unclassified detonable organic peroxide, detonable pyrophoric material, detonable unstable (reactive) material or detonable water-reactive material.
3. Store, handle or use any Class 4 unstable (reactive) material.
4. Store, handle or use any Class 4 oxidizing material.
5. Store, handle or use below grade any flammable gas.
6. Use an open flame for heating or distilling any flammable solid, flammable liquid or flammable gas.
7. Store flammable liquids in basements, cellars or other areas below grade.
8. Store combustible liquids in basements, cellars or other areas below grade not provided that such area below grade is protected throughout by the required fire protection system

For the pre-existing laboratories in the schools K to 12<sup>th</sup> grade, there are other prohibitions that must be complied with as follows:

It shall be unlawful to manufacture or store in a school any:

- a) Acetylide of copper; or other metallic acetylide
- b) Amide or amine explosive;
- c) blasting powder
- d) Chloride of nitrogen;
- e) Colored fire in any form;
- f) Cymogene or any volatile product of petroleum (except rhigoline) or coal tar having a boiling point lower than sixty degrees Fahrenheit;
- g) Flashlight powders;
- h) Fulminate or any fulminating compound (e.g. fulminate of mercury);
- i) Guncotton;
- j) Gunpowder in any form;
- k) Liquid acetylene;
- l) Liquefied chlorine;
- m) Nitro-glycerine, except in official U. S. pharmacopoeia solution, or in the form of pills, tablets, or granules containing not more than one-fiftieth of a grain each;
- n) Picrates;
- o) Potassium chlorate in admixture with organic substances or with phosphorus or sulphur; provided that this restriction shall not apply to the manufacture or storage of tablets of chlorate of potash intended for use solely for medicinal purposes;
- p) Smokeless powder.

### **C. Chemical Storage and Handling**

General Storage Requirements:

- Containers that are not in use should be in good condition, **stored in an upright position** and **closed when not in use**.
- Chemicals should be stored per manufacturer's recommendations and in such a way to minimize the potential for tipping, tearing, puncture, or breakage.



#### **Unstable Shelves and Heavy Chemicals: The Cause of Explosion and Fire**

A collapsed shelf in a solvent storage cabinet is implicated in the fire incident. The fire destroyed a university chemical laboratory completely including all of the research, laboratory notes, and other work by the supervisor and his students. The fire also damaged the adjacent laboratory.

- Flammable/combustible material must be stored away from open flame or other ignition sources.
- Don't stack equipment against containers.
- Segregate incompatible materials/wastes by hazard category to prevent reactions (e.g. acids and bases). Organize chemicals first by COMPATIBILITY — not alphabetic succession.
- Know the characteristic of the material begin stored or handled and possible interaction with other material stored or handled.
- No flammable gas is allowed be stored below grade.
- Under the new fire code, no Class I liquids, or flammable solids can be stored below the ground level. Additionally, Class II and Class IIIA liquids are only allowed in below grade sprinklered areas and Class IIIB liquids are allowed in below grade areas provided the areas are sprinklered.
- Safety cans should be considered for storage of flammable solvents instead of glass containers.
- Avoid storing any chemicals on the floor, especially chemicals stored in glass containers. If you must store containers of liquids on the floor, it is highly recommended that they should be away from pedestrian traffic and they are in secondary containments to control spills in case any container is accidentally broken.
- Avoid placing chemicals on shelving that is above eye level.
- Storage shall be maintained 2 feet or more below the ceiling in areas of buildings not protected by a sprinkler system, or a minimum of 18 inches below sprinkler head deflectors in areas protected by a sprinkler system.



- Piles of chemicals should be stacked in a secure manner, properly labeled in closed containers.



- Raise drums off floor to prevent corrosion from concrete "sweating" or storage in "wet" areas (i.e. pools).

- 

← Raise drums off floor.

- Storage area should be checked periodically for container integrity, leaks, older stock, faded/missing labels etc.
- Defective containers shall be promptly removed from service or disposed of in approved manner.



← A leaking container

→ Rusty surface!



Chemicals shall be handled and stored as per the manufactures' recommendations and safety data sheet (SDS). The transportation of hazardous chemicals in laboratory buildings provides the greatest potential for chemical exposure to the building occupants. Spills occurring outside storerooms and laboratories may lead to hazardous concentrations of vapors and gases being distributed throughout the building. As a result, chemical quantities outside of storage shall be maintained at the lowest possible level necessary for the work performed and Class I flammable liquids shall not be transferred from one vessel to another in any exit access corridor. Hazardous chemicals shall be handled in such a manner as to limit a spill scenario to less than 5 gallons.

If the materials need to be transported between different floors, use of elevator for transport of hazardous materials should be accomplished by the minimum number of persons. In addition, it is not encouraged to use stairway to transport any amount of those materials.

All containers used for the storage of chemicals (including water) and gases must be clearly labeled. These labels must indicate the container's contents. **Containers of materials that might become hazardous during prolonged storage shall be dated when first opened.** There are several chemicals that can increase in hazard potential if subjected to long-term storage. For example, exposure to air or light can cause the formation of peroxides (See Appendix VI). Another example is picric acid, which becomes highly shock-sensitive when its normal water content is allowed to evaporate. Reactive monomers that have been inhibited to reduce the chance of unintentional polymerization can become unstable when the inhibitor is consumed. At the end of 6 months, chemicals that can increase in hazard potential over time shall be evaluated


(such as picric acid for dryness) or tested (such as isopropyl ether for peroxide formation) for continued safe use and can be re-dated and retained for an additional 6-month period after it is found to be safe. The Certificate of Fitness holder must periodically check the labels to make sure that they are still legible. When the label on a container is not legible and its contents cannot be identified, the Certificate of Fitness holder must treat its contents as hazardous waste. The Certificate of Fitness holder must then make arrangements to have the contents of the container disposed of in a safe manner according to the federal, state, and local regulations.



#### **D. Storage of Class I and Class II Liquids in Refrigerators**

The flammable liquids stored in refrigerated equipment shall be stored in closed containers. Protection against the ignition of flammable vapors in refrigerated equipment is available through two types of laboratory refrigerators:

- (1) Explosion-proof model: It is designed to protect against ignition of flammable vapors both inside and outside the refrigerated storage compartment.
- (2) Flammable liquids storage refrigerator: The intent is to eliminate ignition of vapors inside the storage compartment by sources also within the compartment. And its design are intended to control or limit the damage should an exothermic reaction occur within the storage compartment and also reduce the potential for ignition of floor-level vapors.

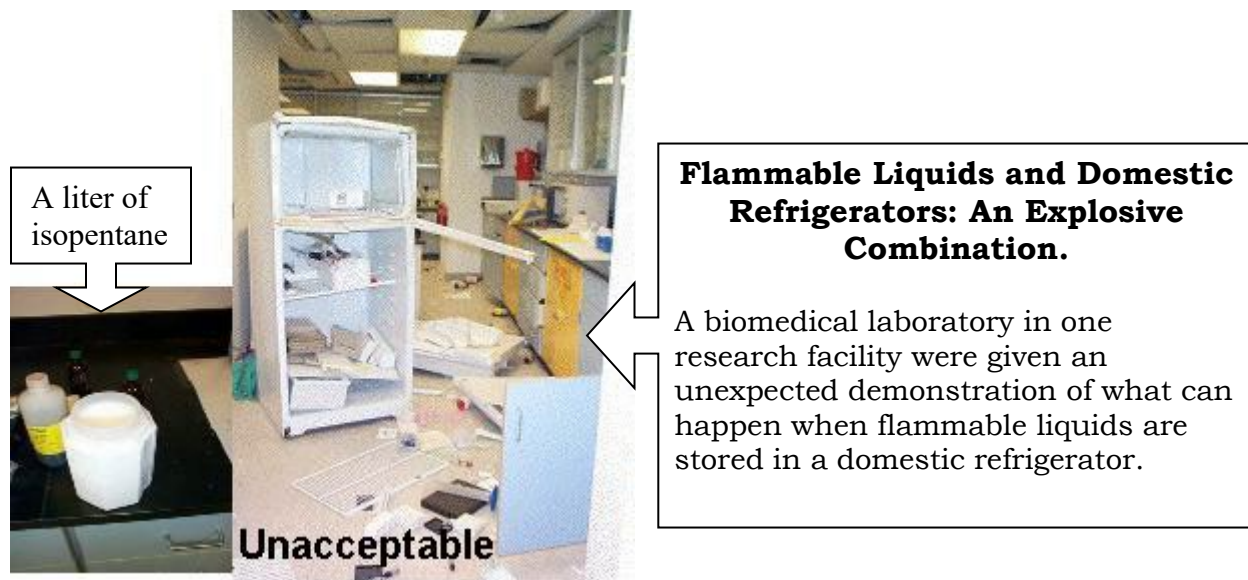



Ordinary domestic refrigerators are allowed to be installed in chemical laboratories but are not permitted to store flammable liquids. The following signs shall be posted on all ordinary domestic refrigerators that are installed in chemical laboratories:

DO NOT STORE FLAMMABLE SOLVENTS  
IN THIS REFRIGERATOR.

OR

STORE NO FLAMMABLE LIQUIDS

Examples of signs for different refrigerators

Domestic Refrigerator (Store No Flammables)	Laboratory-safe Refrigerator (Flammable Materials Storage)
<p><b>Acceptable</b></p> 	 <p><b>Acceptable</b></p>

Well segregated chemicals in the refrigerator!

Do not store food with chemicals!



**E. Liquid Dispensing**

*(1) Pressurized liquid dispensing containers*

Pressurized liquid dispensing containers used for flammable and combustible liquids shall be listed or labeled for their intended use by a nationally recognized testing laboratory. Non-metallic containers larger than 1 gal must not be used. Containers shall be pressurized only with nitrogen or inert gas; air shall not be used.

Prior to pressurizing the system, all fittings and connections shall be secure and leak free.

(2) Dispensing Class I liquids

Dispensing of Class I liquids to or from containers shall be performed either in a separate area outdoors or inside liquid storage areas specifically designed and protected for dispensing Class I flammable liquids. However, if the amount is less than or equal to 5 gal in capacity, it can also be performed in a chemical fume hood or in an area provided with ventilation adequate to prevent accumulations of flammable vapor/air mixtures from exceeding 25 percent of the lower flammable limit.


Class I liquids must not be transferred between conductive containers of greater than 1 gal capacity unless the containers are electrically interconnected by direct bonding or by indirect bonding through a common grounding system. When dispensing Class I liquids involves nonconductive containers larger than 1 gal, which can be difficult to bond or ground, special dispensing procedures commensurate with the electrical characteristics of the liquid must be developed and implemented.

(3) Dispensing tools

Avoiding splashing or turbulence is also important for reducing ignition opportunity by using of a stirring rod or pouring liquids down the side of the container or using squeeze bottles. Smaller size containers, low flow rates during pouring/filling and good ventilation system could also reduce the risk.

Pyrophoric liquids dispensed in a chemical fume hood shall be from sure-seal-type bottles with syringes or double-tipped needles in accordance with the manufacturer's recommendation and nationally established laboratory safety practices.

**F. Waste, Handling and Disposal**

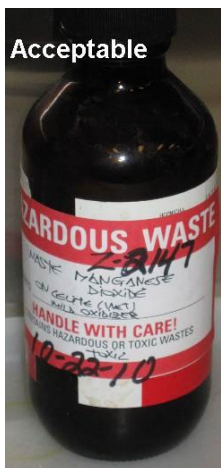

Before a chemical material is used, the user shall determine that information and facilities are available for safe disposal of hazardous materials and waste products. Waste chemicals shall not be combined or mixed with other waste chemicals unless they have been evaluated for compatibility by a qualified person. Hazardous waste chemicals containers shall be labeled as “Hazardous Waste” and the ones stored in laboratory work areas should not be allowed to accumulate. Waste quantities shall be subject to the maximum container sizes and type in accordance with the maximum allowable container capacity table mentioned before. **Flammable chemical waste will count towards flammable storage limits.** All hazardous waste shall be stored or handled according to the federal, state, local regulations.

For your quick reference, *the DOE disposal protocol of hazardous waste:*

- a) Identify the chemicals you want removed using colored self-adhesive labels. Do not remove the chemicals yourself; merely attach the colored “dots.”
- b) List these chemicals on the Chemical Removal Request Form distributed by the Department of Education.



Revised on March 2024 (Apply/Pay)

- c) Make two copies of the list. Keep the original for your own records; give one copy to the assistant principal and the other to the custodian.
- d) The custodian will prepare a work order PO18 using the Trade Code 75 and attach the list of the chemicals.
- e) The custodian will then fax the PO18 form listing the chemicals to M. Pedram at (718) 610-0320 via the Passport System and request a pick up.

## 8. LITHIUM-ION BATTERY SAFETY

### Lithium-ion safety

Lithium-ion batteries are rechargeable batteries found in electric bikes, scooters, cars, laptops, tablets, phones, and many other common household devices.


Lithium-ion battery fires have caused deaths, serious injuries, and devastating damage to property around the city. It's important to follow rules for safe storage, charging, and disposal for these types of batteries.

If you own a lithium-ion powered device or plan to buy one, the FDNY has important safety tips that you should follow. These tips apply to all devices powered by lithium-ion batteries, including phones, tablets, laptops, e-cigarettes, toys, high-tech luggage, and even robotic vacuum cleaners.

**Immediately stop** using or charging battery and call 911 if you notice:

- Fire or Smoke
- Overheating
- Change in color or shape
- Odd noises
- Leaking
- Strange smell

### **ALWAYS:**

- purchase and use devices certified by a Nationally Recognized Testing Laboratory (NRTL). 
- follow the manufacturer's instructions for:
  - charging and storage.
  - correct battery, cord, and power adapter
- **keep exit path clear at all times.**
- plug directly into a wall electrical outlet for charging.
- keep batteries and devices at room temperature.
- store and/or charge batteries away from anything flammable.
- keep away from heat sources.
- bring batteries to a **NYC Battery Recycling Center**. Visit [nyc.gov/batteries](https://nyc.gov/batteries) for more information.

### **NEVER:**

- use aftermarket batteries or chargers.
- use damaged or altered batteries
- plug into a power strip or overload an outlet.
- overcharge or leave battery charging overnight.
- charge a battery or device under your pillow, on your bed, or near a couch.
- leave e-bikes or e-scooters unattended while charging.
- block your primary way in or out of a room/space with e-bikes, e-scooters, wheelchairs, etc.
- place batteries in Trash or Recycling bin. **It is ILLEGAL.** Visit [nyc.gov/batteries](https://nyc.gov/batteries) for disposal locations and information.

**In the event of a Fire,  
Leave and CLOSE the door.  
Call 911 once you are  
in a safe location.**



### **Charging Lithium Ion**

Lithium-ion batteries do not have to be fully charged; partial charge is the most suitable.

When **charging more than five (5)** personal mobility devices or their removable batteries, it must be in a **dedicated room with ventilation** and a self-closing door.

For a total battery capacity of 20 kilowatt-hours (kWh), a 2-foot separation between charging batteries is required. For a total battery capacity up to 50 kWh, a 3-foot separation is needed.

Chargers must only be used with a compatible battery pack. The original equipment manufacturer (OEM) charger interplays with the battery pack using the battery management system (BMS). The wrong battery/charger combination may not work safely. For example, the 100% cutoff to prevent overcharging, which damages batteries, may not work which can easily create hazardous conditions such as fires, explosions and/or injuries.

Always check with the manufacturer or retailer of the personal mobility device, an authorized repair shop or a testing laboratory such as Underwrites Laboratories (UL) to see if replacement is recommended or listed and safe for use with that device. Using unauthorized parts, including batteries and/or chargers, may cause damage, fire and possibly void your warranty.

### **Extinguishing Lithium-ion**

Water may not prevent a battery from burning and spreading. Battery cells are known to explode and quickly spread to another battery. It can spread to another devices.




**Fire Extinguishers**  
**do not work**  
on lithium-ion batteries fires.

**Unexpected Re-ignition.**

Reignition is common. Lithium-Ion Batteries are known to unexpectedly re-ignite (without warning) minutes, hours and even days after all visible fire has been put out.

Lithium-ion batteries can enter an uncontrollable, self-heating state. This can result in the release of gas, cause fire and possible explosion.

These batteries may continue to generate heat even when there is no visible sign of fire. Once heat reaches a certain level fire may reignite on the battery and surrounding area.

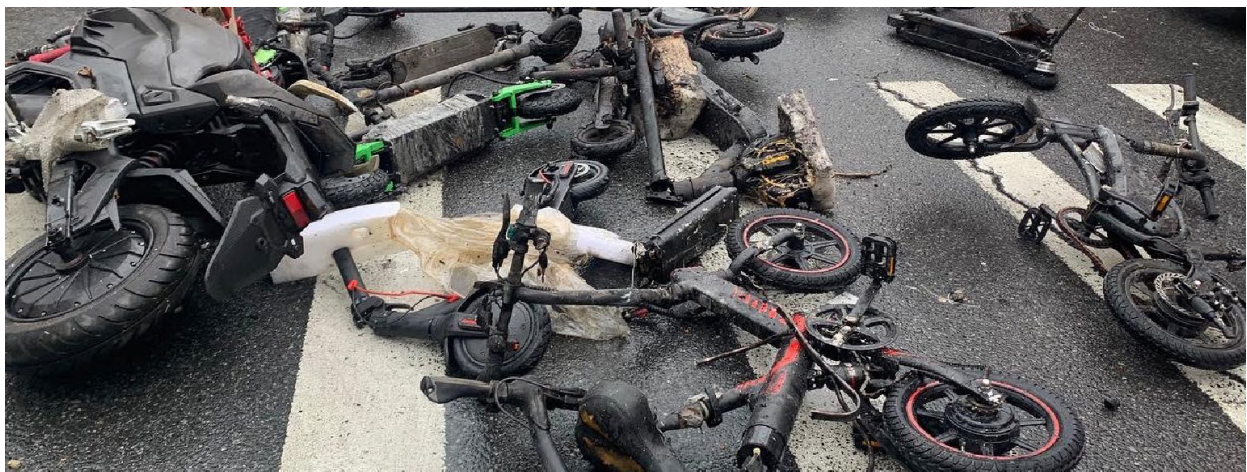

**SUMMARY CHECKLIST OF THE MOST COMMON REQUIREMENTS**

Business name: _____ Address: _____ City & State: _____ Phone #: _____	<b>Supervising the storage and handling chemicals in NYC public k-12 schools</b>	Date: _____ C of F Holder's Name: _____ Signature: _____ C of F #: _____ Exp Date: _____
---	--	--

SECTION A.		
<u>General Requirement</u>	<u>Responses</u>	<u>Recommended Action</u>
1. Is there a valid fire permit for the laboratory?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No, no more than 1 gal. of flammable/combustible liquids or 75 SCF flammable gas allowed!
SECTION B.		
<u>Laboratory Safety</u>	<u>Responses</u>	<u>Recommended Action</u>
1. Have you checked if all portable fire extinguishers are available, operable, unobstructed, clearly marked and attached with the FDNY standardized tag?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
2. Have you checked if all exit ways are free and unobstructed?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
3. Have you checked if the emergency phone numbers and the evacuation plan are updated and clearly posted in appropriate locations?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
4. Have you checked if the SDS sheets are maintained correctly and are readily available to lab staff and emergency personnel?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
5. Have you checked if the electrical cords are in good condition?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
6. Have you checked if the inspection record is affixed to each hood, and each fume hood is maintained in good working order?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
7. Have you checked if the inspection record is affixed to each safety shower and each shower is unobstructed and can work properly?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
8. Have you checked if neutralizing or absorbing agents are provided at all areas used for the storage of acids?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
9. Have you checked if your work areas neat; Food/drink absent?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply

SECTION C.		
<u>Signs and Warning Placards</u>	<u>Responses</u>	<u>Recommended Action</u>
1. Have you checked if the appropriate warning signs are properly posted?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
SECTION D.		
<u>Chemical Storage and Handling</u>	<u>Responses</u>	<u>Recommended Action</u>
1. Is there any prohibited hazardous material stored/used in the laboratory?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If Yes: correct and comply
2. Have you checked if the maximum storage limit is complied?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
3. Have you checked if all chemical containers are properly labeled?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
4. Have you checked if all containers are in good conditions?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
5. Have you checked if all chemicals are properly safety segregated?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
6. Have you checked if all gas containers are properly secured and clearly labeled?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
7. Have you checked if peroxide forming chemicals not expired or tested after expiration date?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply
8. Have you checked if the water-reactive chemicals are stored in suitable receptacles, properly identified and away from water?	<input type="checkbox"/> Yes <input type="checkbox"/> No	If No: correct and comply

*Additional Comments:*

Section/Item #	Description of Deficiencies

## APPENDIX I. CLASSIFICATIONS

### A. Class of Flammable and Combustible Liquids

For the pre-existing laboratory, there are only two categories of flammable and combustible liquids separated by their flash point, one is flammable liquids (flash point is below 100°F) and the other is combustible liquids (flash point is at or above 100°F). However, for the new fire code, there are 3 classes of flammable liquids and 3 classes of combustible liquids defined as the following table.

Table. Class of Flammable and Combustible Liquids

		<b>Flash point</b>	<b>Boiling point</b>	<b>Examples</b>
<b>Flammable liquids (Class I liquids)</b>	<b>Class IA</b>	< 73°F	< 100°F	Acetaldehyde, Ethyl ether, Gasoline, Methyl formate, Pentane
	<b>Class IB</b>	< 73°F	≥ 100°F	Acetone, Benzene, Carbon disulfide, Cyclohexane, Ethanol, Methyl alcohol, Toluene
	<b>Class IC</b>	≥ 73°F but < 100°F	Not Applicable	Amylacetate, Butyl alcohol, Hydrazine, Styrene, Xylene
<b>Combustible liquids (Class II &amp; III liquids)</b>	<b>Class II</b>	≥ 100°F but < 140°F	Not Applicable	Acetic acid, Formaldehyde, Glacial acetic acid, Hydrazine, Naphtha, Stoddard solvent
	<b>Class IIIA</b>	≥ 140°F but < 200°F	Not Applicable	Cyclohexanol, Formic acid, Naphthalene, Nitrobenzene, Octyl alcohol
	<b>Class IIIB</b>	≥ 200°F	Not Applicable	Formalin, Glycerine, Picric acid, Propylene glycol

### B. General Rule of Hazard Classes

Some hazard classes are assigned numerical designations based upon their hazard potential. For example, oxidizers and unstable (reactive) materials are classified as Class 1, 2, 3 or 4 materials; water-reactive solids and liquids are classified as Class 1, 2 or 3 materials; and organic peroxides are classified as Class I, II, III IV or V materials. The following chart explains the severity of each class:







<b>Arabic Numeral</b>		<b>Roman Numeral</b>
4	<b>HIGHEST HAZARD</b>	I
3		II
2		III
1		IV
0	<b>LOWEST HAZARD</b>	V






**C. Class of Organic Peroxide**



- **Class V.** Organic peroxides that burn with less intensity than ordinary combustibles or do not sustain combustion and that pose no reactivity hazard.
- **Class IV.** Organic peroxides that burn in the same manner as ordinary combustibles and that pose a minimal reactivity hazard.
- **Class III.** Organic peroxides that burn rapidly and that pose a moderate reactivity hazard.
- **Class II.** Organic peroxides that burn very rapidly and that pose a severe reactivity hazard
- **Class I.** Organic peroxides that are capable of deflagration but not detonation.
- **Unclassified detonable:** Organic peroxides that are capable of detonation and pose an extremely high-explosion hazard through rapid explosive decomposition.



**APPENDIX II. DOT placards**

Class	Label	Examples
Class 1 : Explosives	 <p>EXPLOSIVES 1.3* 1</p>	Ammonium nitrate; Hydrated picric acid which becomes explosive upon drying
Class 2 :Gases	 <p>FLAMMABLE GAS 2</p>	Hydrogen; Methane
Division 2.2 Non-flammable, non-toxic compressed gases	 <p>NON-FLAMMABLE GAS 2</p>	Carbon Dioxide; Oxygen
Division 2.3 Gases toxic by inhalation	 <p>INHALATION HAZARD 6</p>	Diborane; Fluorine; Nitrogen dioxide
Class 3 : Flammable liquids	 <p>FLAMMABLE LIQUID 3</p>	Methanol; Ethanol; Esters; Ethers; Ketones
Class 4: Flammable solids	 <p>FLAMMABLE SOLID 4</p>	Naphthalene; Finely divided metal (e.g., aluminum, cadmium, chromium, titanium, zinc)

Class	Label	Examples
Division 4.2 Spontaneously combustible materials		Acetic acid; Cumene; Phenol; Propionic acid
Division 4.3 Dangerous when wet materials		Acetyl chloride; Aluminum; Calcium carbide; Chloride (anhydrous); Chlorosulfonic acid; Magnesium; Phosphorus pentachloride; Sodium; Stannic chloride; Thionyl chloride
<hr/> Class 5 : Oxidizers and Organic peroxides		
Division 5.1 Oxidizers		Ammonium nitrate; Bromine; Calcium nitrate; Chromic acid; Fluorine; Nitric acid; Oxygen; Peroxide; Perchloric acid; Potassium chlorate; Potassium nitrate; Sodium dichromate; Sodium nitrate; Sulfuric acid
Division 5.2 Organic peroxides		Benzoyl peroxide; Hydrogen peroxide; Ethyl methyl ketone peroxide
Class 6: Toxic materials and Infectious substances		Acrolein; Arsenic salts; Calcium cyanide; Nicotine; Hydrocyanic acid; Organic mercury compounds

Class	Label	Examples
Class 7: Radioactive materials		Any material having a specific activity greater than 0.002 microcuries per gram ( $\mu\text{Ci/g}$ )
Class 8: Corrosive materials		Acids (Acetic acid; Citric acid; Formic acid; Oxalic acid) Bases (Ammonium hydroxide; Calcium hydroxide; Potassium hydroxide; Sodium hydroxide)

## APPENDIX III. SAMPLE SAFETY DATA SHEET (SDS)

---

### SECTION 1: PRODUCT AND COMPANY IDENTIFICATION

---

**Material Name**

Squeaky Clean Solution

**Product Code**

Not available.

**Synonyms**

Not available.

**Product Use**

Aqueous alkaline cleaning solution for the removal of grease, oil, dirt, dust, grime, and other soils from a variety of metal and non-metal surfaces. If this product is used in combination with other products, refer to the Safety Data Sheet for those products.

**Restrictions on Use**

For professional use only.

**MANUFACTURER**

The AK™ Company  
4 North MM Street  
Princeton, NJ 08543  
Phone: (800) 333-3333  
www.cc.com

**SUPPLIER**

SK Systems, Inc.  
20 North C Road Suite 2  
Richardson, TX 75080  
Phone: 1-800-999-9999  
www.sk.com

**IMPORTER/DISTRIBUTOR**

SKCanada Inc.  
2 Re Road  
Brampton, Ontario, Canada L1A 1B2  
Phone: 1-800-999-9999

**Emergency Telephone Number**

Medical: 1-888-234-1828 Chemical: 1-800-424-9300 (CHEMTREC)

**Issue Date**

March 6, 2017

**Supersedes Issue Date**

May 11, 2015

**Original Issue Date**

July 9, 1999

---

### SECTION 2: HAZARDS IDENTIFICATION

---

**Classification in accordance with Schedule 1 of Canada's Hazardous Products Regulations (HPR) (SOR/2015-17) and paragraph (d) of 29 CFR 1910.1200 in the United States**

Acute Toxicity - Oral - Category 4  
Skin Corrosion/Irritation - Category 1A  
Serious Eye Damage/Eye Irritation - Category 1  
Skin Sensitization - Category 1A  
Health Hazard Not Otherwise Classified. - Category 1

**GHS Label Elements****Symbol(s)****Signal Word**

Danger.

Revised on March 2024 (Apply/Pay)

**Hazard Statement(s)**

Harmful if swallowed.  
Causes severe skin burns and eye damage.  
May cause allergic skin reaction.

**Precautionary Statement(s)**

**Prevention**

Do not breathe mist/vapors/spray. Wear protective gloves/protective clothing/eye protection/face protection. Wash thoroughly after handling. Contaminated work clothing should not be allowed out of the workplace. Do not eat, drink or smoke when using this product.

**Response**

IF SWALLOWED: Rinse mouth. Do NOT induce vomiting. Immediately call a POISON CENTER or doctor. IF ON SKIN (or hair): Take off immediately all contaminated clothing. Rinse skin with water/shower. If skin irritation or rash occurs: Get medical advice/attention. Wash contaminated clothing before reuse. IF INHALED: Remove person to fresh air and keep at rest in a position comfortable for breathing. Immediately call a POISON CENTER or doctor. IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing. Immediately call a POISON CENTER or doctor.

**Storage**

Store in a well-ventilated place. Keep container tightly closed. Store locked up. Do not store below 40°F.

**Disposal**

Dispose of contents/container in accordance with local/regional/national/international regulations. Statement of Unknown Toxicity 85% of the mixture consists of ingredient(s) of unknown acute toxicity.

**Other hazards**

May cause digestive tract irritation.

---

**SECTION 3: COMPOSITION / INFORMATION ON INGREDIENTS**

---

CAS	Component Name	Percent
7732-18-5	Water	90-99
497-19-8	Disodium carbonate	0.95-1.05
68439-46-3	Alcohols, C9-11, ethoxylated	0.67-0.74
26896-20-8	Neodecanoic acid	0.78-0.86
1310-73-2	Sodium hydroxide	0.33-0.36

---

**SECTION 4: FIRST AID MEASURES**

---

**Eyes:**

IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing. Immediately call a POISON CENTER or doctor.

**Skin:**

IF ON SKIN (or hair): Take off immediately all contaminated clothing. Rinse skin with water/shower. Immediately call a POISON CENTER or doctor. Wash contaminated clothing before reuse.

**Ingestion:**

IF SWALLOWED: Rinse mouth. If swallowed, do NOT induce vomiting. Immediately call a POISON CENTER or doctor.

**Inhalation:**

IF INHALED: Remove victim to fresh air and keep at rest in a position comfortable for breathing. Immediately call a POISON CENTER or doctor.

**Most Important Symptoms/Effects**

**Acute**

Harmful if swallowed. Toxic if inhaled. Causes skin burns, eye damage, allergic skin reaction. May cause respiratory irritation. May cause digestive tract irritation.

**Delayed**

Repeated exposure may cause skin dryness or cracking.

Revised on March 2024 (Apply/Pay)

### **Indication of any immediate medical attention and special treatment needed**

Treat symptomatically and supportively.

---

## **SECTION 5: FIRE-FIGHTING MEASURES**

---

### **Extinguishing Media**

#### **Suitable Extinguishing Media**

Use extinguishing agents appropriate for surrounding fire.

#### **Unsuitable Extinguishing Media**

Do not use high-pressure water streams.

#### **Special Hazards Arising from the Chemical**

Negligible fire hazard.

#### **Hazardous Combustion Products**

Decomposition and combustion materials may be toxic. Burning may produce Carbon monoxide, Nitrogenoxide, sulfur oxides.

#### **Advice for firefighters**

Containers may rupture or explode if exposed to heat.

#### **Fire Fighting Measures**

Move container from fire area if it can be done without risk. Keep storage containers cool with water spray.

Heated containers may rupture. "Empty" containers may retain residue and can be dangerous. Product is not sensitive to mechanical impact or static discharge.

#### **Special Protective Equipment and Precautions for Firefighters**

A positive-pressure, self-contained breathing apparatus (SCBA) and full-body protective equipment are required for fire emergencies.

---

## **SECTION 6: ACCIDENTAL RELEASE MEASURES**

---

### **Personal Precautions, Protective Equipment and Emergency Procedures**

Wear personal protective clothing and equipment, see Section 8.

#### **Methods and Materials for Containment and Cleaning Up**

Spilled product is slippery. Do not breathe dust or vapors. Do not touch or walk through spilled product. Keep unnecessary and unprotected personnel from entering. Ventilate area and avoid breathing vapor or mist. Contain spill as a liquid for possible recovery, or sorb with compatible sorbent material and shovel with a clean, spark proof tool into a sealable container for disposal. Additionally, for large spills: Dike far ahead of liquid spill for collection and later disposal.

#### **Environmental Precautions**

Prevent material from entering drains or sewers.

---

## **SECTION 7: HANDLING AND STORAGE**

---

### **Precautions for Safe Handling**

Keep away from sparks or flame. Do not breathe dust or vapors. Contaminated work clothing should not be allowed out of the workplace. Wear protective gloves/protective clothing/eye protection/face protection.

Wash thoroughly after handling.

#### **Conditions for Safe Storage, Including any Incompatibilities**

Keep container tightly closed when not in use and during transport. Store containers in a cool, dry place. Do not pressurize, cut, weld, braze, solder, drill, or grind containers. Keep containers away from heat, flame, sparks, static electricity, or other sources of ignition. Empty product containers may retain product residue and can be dangerous. Do not store below 40°F.

#### **Incompatible Materials**

Strong acids, reducing agents, oxidizers.

---

**SECTION 8: EXPOSURE CONTROLS/PERSONAL PROTECTION**

---

**Component Exposure Limits**

<b>Sodium hydroxide</b>	<b>1310-73-2</b>
Canada	2 mg/m <sup>3</sup> Ceiling
ACGIH, OSHA, NIOSH	2 mg/m <sup>3</sup> Ceiling

**ACGIH - Threshold Limit Values - Biological Exposure Indices (BEI)**

There are no biological limit values for any of this product's components.

**ENGINEERING CONTROLS:**

Provide general ventilation needed to maintain concentration of vapor or mist below applicable exposure limits. Where adequate general ventilation is unavailable, use process enclosures, local exhaust ventilation, or other engineering controls to control airborne levels below applicable exposure limits.

**Individual Protection Measures, such as Personal Protective Equipment**

**Eye/face protection**

Wear safety glasses. Additional protection like goggles, face shields, or respirators may be needed dependent upon anticipated use and concentrations of mists or vapors. Eye wash fountain and emergency showers are recommended. Contact lens use is not recommended.

**Respiratory Protection**

A respiratory protection program which meets USA's OSHA General Industry Standard 29 CFR 1910.134 or Canada's CSA Standard Z94.4-M1982 requirements must be followed whenever workplace conditions warrant a respirator's use. Consult a qualified Industrial Hygienist or Safety Professional for respirator selection guidance.

**Glove Recommendations**

Where skin contact is likely, wear gloves impervious to product; use of natural rubber (latex) or equivalent gloves is not recommended. To avoid prolonged or repeated contact where spills and splashes are likely, wear appropriate chemical-resistant face shield, boots, apron, whole body suits or other protective clothing.

When product is heated and skin contact is likely, wear heat-resistant gloves, boots, and other protective clothing.

**Protective Materials**

Personal protective equipment should be selected based upon the conditions under which this material is used. A hazard assessment of the work area for PPE requirements should be conducted by a qualified professional pursuant to regulatory requirements. The following PPE should be considered the minimum required: Safety glasses, gloves, lab coat or apron.

---

**SECTION 9: PHYSICAL AND CHEMICAL PROPERTIES**

---

<b>Appearance</b>	Light amber clear liquid	<b>Physical State</b>	Liquid
<b>Odor</b>	Mild	<b>Color</b>	Clear, light amber
<b>Odor Threshold</b>	N/A	<b>pH</b>	11.5 (aqueous solution)
<b>Melting Point</b>	0°C	<b>Boiling Point</b>	100°C
<b>Boiling Point Range</b>	N/A	<b>Freezing point</b>	N/A
<b>Evaporation Rate</b>	(equal to water)	<b>Flammability (solid, gas)</b>	N/A
<b>Autoignition Temperature</b>	N/A	<b>Flash Point</b>	>100°C
<b>Lower Explosive Limit</b>	N/A	<b>Decomposition temperature</b>	N/A
<b>Upper Explosive Limit</b>	N/A	<b>Vapor Pressure</b>	17.5mmHg@20°C
<b>Vapor Density (air=1)</b>	N/A	<b>Specific Gravity (water=1)</b>	1

Revised on March 2024 (Apply/Pay)

<b>Water Solubility</b>	(complete)	<b>Partition coefficient: noctanol/ water</b>	N/A
<b>Viscosity</b>	N/A	<b>Solubility (Other)</b>	N/A
<b>Density</b>	N/A	<b>Molecular Weight</b>	N/A
<b>Volatile Organic Compounds (As Regulated)</b>	0 WT%; 0 LB/US gal; 0 g/L; As per 40 CFR 51.100(s) Product Vapor Pressure @20°C = 17.5 mmHg. Product does not contain photochemically reactive solvents		

---

## SECTION 10: STABILITY AND REACTIVITY

---

### Reactivity

May react on contact with strong acids.

### Chemical Stability

Stable under normal temperatures and pressures.

### Possibility of Hazardous Reactions

Polymerization is not known to occur under normal temperature and pressures. Not reactive with water.

### Conditions to Avoid

Avoid sparks or flame.

### Incompatible Materials

Avoid oxidizing agents, reducing agents, strong acids.

### Hazardous decomposition products

Oxides of Carbon, Nitrogen and Sulfur. See also SECTION 5: HAZARDOUS COMBUSTION PRODUCTS.

### Thermal decomposition products

Carbon monoxide. Nitrogen oxides (NOx). Sulfur oxides.

---

## SECTION 11: TOXICOLOGICAL INFORMATION

---

### Information on Likely Routes of Exposure

#### Inhalation

May cause respiratory irritation.

#### Skin Contact

Causes burns. May cause allergic skin reaction.

#### Eye Contact

Causes eye damage.

#### Ingestion

Harmful if swallowed. May cause irritation or burns.

### Acute and Chronic Toxicity

#### Component Analysis - LD50/LC50

The components of this material have been reviewed in various sources and the following selected endpoints are published:

##### **Disodium carbonate (497-19-8)**

Oral LD50 Rat 4090 mg/kg; Dermal LD50 Mouse 2210 mg/kg; Inhalation LC50 Rat 2300 mg/m<sup>3</sup> 2 h

##### **Neodecanoic acid (26896-20-8)**

Oral LD50 Rat 2000 mg/kg; Dermal LD50 Rat >3160 mg/kg (no deaths occurred )

Inhalation LC50 Rat >3 mg/L 6 h (no deaths occurred )

##### **Sodium hydroxide (1310-73-2)**

Dermal LD50 Rabbit 1350 mg/kg

### Product Toxicity Data

#### Acute Toxicity Estimate

Not available.

#### Immediate Effects



Revised on March 2024 (Apply/Pay)

Harmful if swallowed. Toxic if inhaled. Causes burns, eye damage, skin burns. May cause allergic skin reaction. May cause respiratory irritation.

**Delayed Effects**

Repeated exposure may cause skin dryness or cracking.

**Irritation/Corrosivity Data**

Causes burns. May cause digestive tract irritation.

**Respiratory Sensitization**

Based on best current information, there is no known human sensitization associated with this product.

**Dermal Sensitization**

May cause allergic skin reaction.

**Component Carcinogenicity**

None of this product's components are listed by ACGIH, IARC, NTP, DFG or OSHA

**Germ Cell Mutagenicity**

Based on best current information, there is no known teratogenicity associated with this product. Experimental evidence suggests that this product does not cause mutagenesis.

**Tumorigenic Data**

No data available

**Reproductive Toxicity**

Based on best current information, there is no known reproductive toxicity associated with this product.

**Specific Target Organ Toxicity - Single Exposure**

No target organs identified.

**Specific Target Organ Toxicity - Repeated Exposure**

No target organs identified.

**Aspiration hazard**

Based on available data, the classification criteria are not met.

**Medical Conditions Aggravated by Exposure**

Individuals with pre-existing respiratory tract (nose, throat, and lungs), eye, and/or skin disorders may have increased susceptibility to the effects of exposure.

---

**SECTION 12: ECOLOGICAL INFORMATION**

---

**Component Analysis - Aquatic Toxicity**

<b>Disodium carbonate</b>	<b>497-19-8</b>
Fish:	LC50 96 h Lepomis macrochirus 300 mg/L [static ]; LC50 96 h Pimephales promelas 310- 1220 mg/L [static ]
Invertebrate:	EC50 48 h Daphnia magna 265 mg/L IUCLID
<b>Neodecanoic acid</b>	<b>26896-20-8</b>
Fish:	LC50 96 h Lepomis macrochirus 32 mg/L [static ]
Invertebrate:	EC50 48 h Daphnia magna 47.11 mg/L IUCLID
<b>Sodium hydroxide</b>	<b>1310-73-2</b>
Fish:	LC50 96 h Oncorhynchus mykiss 45.4 mg/L [static ]

**Invertebrate Toxicity**

No additional information is available.

**Persistence and Degradability**

No information available for the product.

**Bioaccumulative Potential**

No information available for the product.

**Mobility**

No information available for the product.

---

**SECTION 13: DISPOSAL CONSIDERATIONS**

---

---

### Disposal Methods

The U.S. EPA has not published waste numbers for this product's components. Dispose in accordance with federal, state, provincial, and local regulations. Regulations may also apply to empty containers. The responsibility for proper waste disposal lies with the owner of the waste. Contact ArmaKleen regarding proper recycling or disposal.

---

### SECTION 14: TRANSPORT INFORMATION

---

**U.S. DOT Information:** Not regulated for transport.

**IATA Information:** Not regulated for transport.

**TDG Information:** Not regulated for transport

---

### SECTION 15: REGULATORY INFORMATION

---

#### Canada Regulations

##### CEPA - Priority Substances List

None of this product's components are on the list.

##### Ozone Depleting Substances

None of this product's components are on the list

##### Council of Ministers of the Environment - Soil Quality Guidelines

None of this product's components are on the list

##### Council of Ministers of the Environment - Water Quality Guidelines

None of this product's components are on the list

#### U.S. Federal Regulations

This material contains one or more of the following chemicals required to be identified under SARA Section 302 (40 CFR 355 Appendix A), SARA Section 313 (40 CFR 372.65), CERCLA (40 CFR 302.4), TSCA 12(b), and/or require an OSHA process safety plan.

<b>Sodium hydroxide</b>	<b>1310-73-2</b>
CERCLA:	1000 lb final RQ ; 454 kg final RQ

#### SARA Section 311/312 (40 CFR 370 Subparts B and C)

**Acute Health:** Yes **Chronic Health:** No **Fire:** No **Pressure:** No **Reactivity:** No

#### Component Analysis - Inventory

Disodium carbonate (497-19-8), Neodecanoic acid (26896-20-8), Sodium hydroxide (1310-73-2), Water (7732-18-5), Alcohols, C9-11, ethoxylated (68439-46-3),

US	CA
Yes	DSL

Not listed under California Proposition 65.

---

### SECTION 16: TRANSPORT INFORMATION OTHER INFORMATION

---

#### NFPA Ratings

Health: 1 Fire: 0 Reactivity: 0

Hazard Scale: 0 = Minimal; 1 = Slight; 2 = Moderate; 3 = Serious; 4 = Severe

#### Summary of Changes

Revision to comply with WHMIS 2015.

#### Key / Legend

ACGIH - American Conference of Governmental Industrial Hygienists; BOD - Biochemical Oxygen Demand; C - Celsius; CA - Canada; CA/MA/MN/NJ/PA - California/Massachusetts/Minnesota/New Jersey/Pennsylvania\*; CAS - Chemical Abstracts Service; CFR - Code of Federal Regulations (US); CERCLA - Comprehensive Environmental Response, Compensation, and Liability Act; CLP -

Revised on March 2024 (Apply/Pay)

Classification, Labelling, and Packaging; CPR – Controlled Products Regulations; DOT - Department of Transportation; DSL - Domestic Substances List; EPA – Environmental Protection Agency; F - Fahrenheit; IDL - Ingredient Disclosure List; IDLH - Immediately Dangerous to Life and Health; IMDG - International Maritime Dangerous Goods; LEL - Lower Explosive Limit; LLV - Level Limit Value; LOLI - List Of Lists™ - ChemADVISOR's Regulatory Database; MAK - Maximum Concentration Value in the Workplace; MEL - Maximum Exposure Limits; NDSL – Non-Domestic Substance List (Canada); NFPA – National Fire Protection Agency; NIOSH - National Institute for Occupational Safety and Health; NJTSR - New Jersey Trade Secret Registry; NTP - National Toxicology Program; OSHA - Occupational Safety and Health Administration; PEL Permissible Exposure Limit; RCRA - Resource Conservation and Recovery Act; SARA - Superfund Amendments and Safety Data Sheet Material Name: ArmaKleen MPC Cleaning Solution SDS ID: 82783 Limit Value; TSCA - Toxic Substances Control Act; TWA - Time Weighted Average; UEL - Upper Explosive Limit; UN/NA - United Nations /North American; US - United States; WHMIS - Workplace Hazardous Materials Information System (Canada).

**Other Information**

**This document has been prepared in accordance with the SDS requirements of the OSHA Hazard Communication Standard 29 CFR 1910.1200 and Canada's Hazardous Product Regulations (HPR)**  
**Disclaimer:**

User assumes all risks incident to the use of this product. To the best of our knowledge, the information contained herein is accurate.

---

**APPENDIX IV. EXAMPLES OF INCOMPATIBLE CHEMICALS**

SOURCE: Prudent Practices for Handling Hazardous Chemicals in Laboratories, National Research Council, Washington, D.C.,1995.

<b>Chemical</b>	<b>Incompatibles</b>
Acetic acid	Chromic acid, ethylene glycol, hydroxyl-containing compounds, nitric acid, perchloric acid, permanganates, peroxides
Acetone	Concentrated nitric and sulfuric acid mixtures
Acetylene	Bromine, chlorine, copper, fluorine, mercury, silver
Alkali and alkaline earth metals (lithium, sodium, potassium)	Carbon dioxide, carbon tetrachloride or other chlorinated hydrocarbons, halogens, powdered metals (e.g. aluminum or magnesium),water
Ammonia(anhydrous)	Bromine, calcium hypochlorite, chlorine, iodine, hydrofluoric acid (anhydrous),mercury (e.g. in manometers),
Ammonium nitrate	Acids, chlorates, finely divided organic or combustible materials powdered metals, flammable liquids, nitrates, sulfur
Aniline	Hydrogen peroxide, nitric acid
Azides	Acids
Bromine	See Chlorine
Calcium oxide	Water
Carbon (activated)	All oxidizing agents, Calcium hypochlorite
Carbon tetrachloride	Acids, ammonium salts, chlorates, finely divided organic or combustible materials, powdered metals, sodium, sulfur,
Chlorine	Ammonia, acetylene, benzene, butadiene, butane, hydrogen, finely divided metals, methane, propane (or other petroleum gases), sodium carbide, turpentine
Chromic acid and chromium	Acetic acid, alcohol, camphor, flammable liquids in general, glycerol naphthalene
Cyanides	Acids
Flammable liquids	Ammonium nitrate, chromatic acid, halogens, hydrogen peroxide, nitric acid, sodium peroxide

Examples of incompatible chemicals (continued)

<b>Chemical</b>	<b>Incompatibles</b>
Hydrofluoric acid (anhydrous)	Ammonia (aqueous or anhydrous)
Hydrogen peroxide	Acetone, alcohols, aniline, chromium, combustible materials, copper, iron, most metals or their salts, nitromethane, organic materials,
Hypochlorites	Acids, activated carbon
Mercury	Acetylene, ammonia, fulminic acid
Nitrates	Sulfuric acid
Nitric acid (concentrated)	Acetic acid, aniline, any heavy metals, brass, chromic acid, copper, flammable gases, flammable liquids, hydrocyanic acid, hydrogen sulfide
Nitrites	Potassium or sodium cyanide.
Oxygen	Flammable liquids, solids, or gases; grease, hydrogen, oils
Perchloric acid	Acetic anhydride, alcohol, bismuth and its alloys, grease, oils, paper, wood
Peroxides, Organic	Acids (organic or mineral), avoid friction, store cold
Phosphorus (white)	Air, alkalis, oxygen, reducing agents
Phosphorus pentoxide	Water
Potassium	Carbon dioxide, carbon tetrachloride, water
Potassium permanganate	Benzaldehyde, ethylene glycol, glycerol, sulfuric acid
Sodium	See Potassium
Sodium nitrite	Ammonium nitrate and other ammonium salts
Sodium peroxide	Acetic anhydride, benzaldehyde, carbon disulfide, Ethyl or methyl alcohol, ethyl acetate, ethylene glycol, furfural, glacial acetic acid, glycerin, methyl acetate
Sulfides	Acids
Sulfuric acid	Potassium chlorate, potassium perchlorate, potassium permanganate (similar compounds)

Revised on March 2024 (Apply/Pay)

Examples of incompatible chemicals (continued)

<b>Chemical</b>	<b>Incompatibles</b>
Water	of light metals, such as sodium, lithium) Acetyl chloride, alkaline and alkaline earth metals, their hydrides and oxides, barium peroxide, carbides, chromic acid, phosphorous oxychloride, phosphorous pentachloride, phosphorous pentoxide, sulfuric acid, sulfur trioxide

**APPENDIX V. GENERAL QUANTITY LIMITATIONS**

Chemical inventories in each laboratory unit shall be maintained within the maximum allowable quantities specified in the following tables. It is the Certificate of Fitness holder’s responsibility to figure out what is the approximate maximum quantity that he/she can handle and/or store in the laboratory according the laboratory size.

**A. Flammable & Combustible Liquids Quantity Limitation**

(1) Pre-existing laboratory

The laboratories approved by the Fire Department prior to July 1, 2008 are considered to be "pre-existing laboratories".

Table. Quantity Limitation for Pre-existing Laboratory

<b>Lab Type</b>	<b>Fire Rating (hr)</b>	<b>Fire Protection</b>	<b>Flammable liquids</b>	<b>Combustible liquids</b>
Schools K-12	1 or 2	Sprinklered or Nonsprinklered	20 Gallons*	5 Gallons*


- See section B on the

(2) New laboratory

All educational and instructional non-production laboratories established on or after July 1, 2008 are required to be in compliance with the 2008/2014 Fire Code shall comply with Class “D” laboratory requirements. The following table provides the quantity limitation for the laboratory units stored for the instruction of students through the 12th grade.

Table. Quantity Limitation Flammable and Combustible Liquids

<b>Laboratory unit hazard classification</b>	<b>Excluding Quantities in Storage Cabinets or Safety Cans</b>		<b>Including Quantities in Storage Cabinets or Safety Cans</b>	
	<b>Maximum Quantity Class I Liquids Alone per Lab Unit (gal)</b>	<b>Maximum Quantity Class I, II, IIIA Liquids per Lab Unit (gal)</b>	<b>Maximum Quantity Class I Liquids Alone per Lab Unit (gal)</b>	<b>Maximum Quantity Class I, II, IIIA Liquids per Lab Unit (gal)</b>
<b>Class D</b>	0.5 gals/100 ft <sup>2</sup> 37.5 (max)	0.5 gals/100 ft <sup>2</sup> 37.5 (max)	1 gals/100 ft <sup>2</sup> 75 (max)	1 gals/100 ft <sup>2</sup> 75 (max)

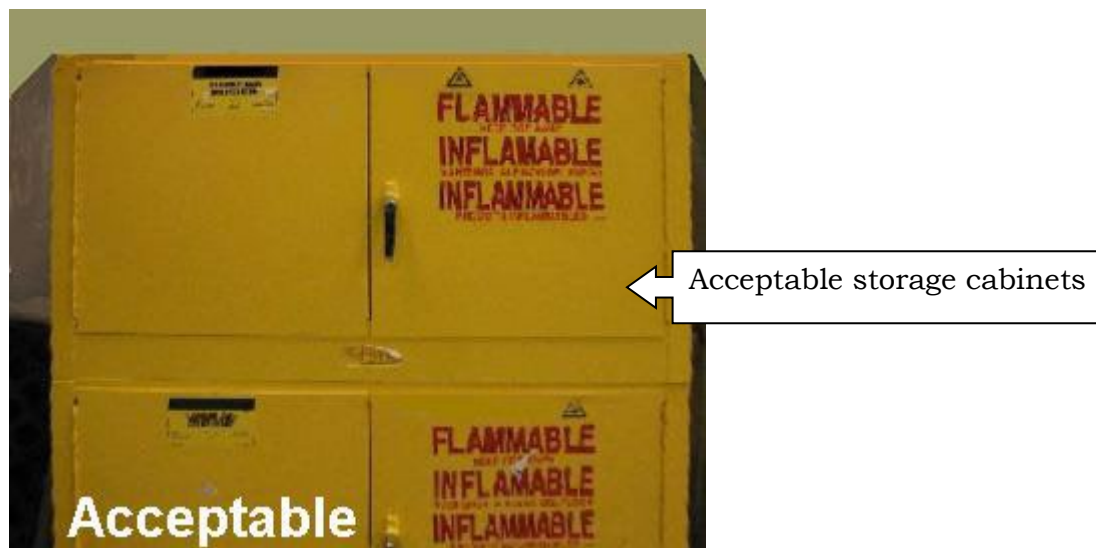

**B. Other Laboratory Hazardous Material Quantity Limitation**

The following quantity limitations are independent of any hazardous materials that are stored in an approved chemical storage room:

(1) Pre-existing laboratories

For the pre-existing laboratories, other laboratory hazardous material quantity in each laboratory unit shall be maintained within the maximum allowable quantities specified in the following tables:

Table II-4. Laboratory Hazardous Material Quantity Limitations for Pre-existing Laboratories

<b>Lab Type</b>	<b>Schools K-12<sup>a</sup></b>
<b>Flammable Solids</b>	50 Lbs
<b>Oxidizing Material</b>	100 Lbs
<b>Unstable Reactive Material</b>	30 Lbs
<b>Corrosive Material</b>	50 Gals
<b>Other Hazardous Material</b>	80 Lbs

a. See section C for specific information

Table II-5. Flammable Gases Quantity Limitations for Pre-existing Laboratories

<b>Area of Laboratory</b>		<b>Maximum Capacity*</b>
Up to 500 Sq. Ft.	Per additional 100 Sq. Ft.	
9.24 Cu. Ft.	1.54 Cu. Ft.	15.4 Cu. Ft.

\* Water container capacity

(2) New fire code



For those laboratory units following the new fire code, other laboratory hazardous material quantity in each laboratory unit shall be maintained within the maximum allowable quantities specified in the following tables:

Laboratory Hazardous Material Quantity Limitations in the New Fire Code

	<b>Maximum quantity in 1-hr fire rated lab</b>	<b>Maximum quantity in 2-hr fire rated lab</b>
Water-Reactive Material	2.5 Lbs.	5 Lbs.
Pyrophoric Material	0.5 Lbs.	1 Lbs.
Highly Toxic Material	5 Lbs.	5 Lbs.
Toxic Material	250 Lbs.	250 Lbs.
Corrosive Material	250 Gallons	250 Gallons
Flammable Solids	10 Lbs.	15 Lbs.
Oxidizers/Org Peroxides	40 Lbs. <sup>a</sup>	50 Lbs. <sup>a</sup>
Unstable reactive material	6 Lbs. <sup>b</sup>	12 Lbs. <sup>b</sup>

a. maximum 2 lbs of Class 3 oxidizers & 1 lb of Class I organic peroxides

b. maximum 1 lb of Class 3 unstable reactive material

In addition, there are special quantity limitations for compressed gases. For the educational or instructional laboratories, the total number of lecture bottle-sized containers of any type shall be limited to 10. For the containers other than the lecture bottles, the material quantity limitations are listed as the following table:

Hazardous Gases Quantity Limitations in New Fire Code  
(Educational and Instructional Labs)

<b>Gas Type</b>	<b>Maximum Capacity</b>
Flammable gases	6 Cu. Ft <sup>a</sup>
Oxidizing gases	6 Cu. Ft <sup>a</sup>
Liquefied flammable gases	1.2 Cu. Ft <sup>a</sup>
Other hazard gases (e.g. unstable/reactive, pyrophoric, etc.)	20 SCF <sup>b</sup>
Health hazard 3 or 4 gases	20 SCF <sup>b</sup>

a. The quantity limitation is limited by NFPA which uses water container capacity units

b. The quantity limitation is limited by Fire Code which uses SCF units (20 SCF is approximately equal to 0.10 cu ft).

**C. Storage and Use of Limited Quantities of Chemicals, Acids, and Flammables for Instruction Purposes in [Public High] Schools Through the Twelfth Grade**

1. The storage of dangerous chemicals, volatile flammable oils and liquids shall be confined to metal cabinets vented at top and bottom. A cardholder should be

provided for a visible record of the contents and maximum amount stored therein; also, a caution sign, if applicable to read: "In case of fire do not use water."

2. Listed below are the maximum quantities of combustibles and dangerous chemicals which may be stored in [public high]schools through the twelfth grade:

<b>Hazardous materials</b>	<b>Maximum Quantities</b>
<b>Explosives</b>	
Picric acid	1 lb.
Carbon bisulphide	10 lbs.
Carbon Dioxide	1 lb.
Anhydrous Ammonia	1 lb.
Sulphur Dioxide	1 lb.
Nitrous Oxide	1 lb.
Oxygen	1 lb.
<b>Volatile Flammable Liquids (Insoluble)</b>	
Crude Petroleum	2 lbs.
Benzine, Benola or Naphthas of any kind	2 lbs.
Ether, Sulphuric	10 lbs.
Varnishes, Lacquers, etc.	2 lbs.
<b>Volatile Flammable Liquids (Soluble)</b>	
Acetone	1 lb.
Alcohol, Denatured	5 gals.
Aylcohol. Methyl	5 gals.
<b>Non-Volatile Flammable Liquids (Insoluble)</b>	
Amyl Acetate	2 lbs.
Amyl Alcohol	2 lbs.
Aniline Oil	1 lb.
Kerosene	2 lbs.
Turpentine	½ gal.
Tuluol	1 gal.
Xylol	1 gal.
Essential Oils	2 lbs.
<b>Non-Volatile Flammable Liquids (Soluble)</b>	
Glycerine	5 lbs.
<b>Combustible Solids</b>	
Phosphorous	¼ lb.
Phosphorous, Red	5 lbs.
Sulphur	15 lbs.
Metallic Magnesium	1 lb.
<b>Gums, Resins, Pitch, Etc.</b>	
Camphor	1 lb.
Resin	11 lbs.

<b>Hazardous materials</b>	<b>Maximum Quantities</b>
Venice Turpentine	1 lb.
Naphthaline	1 lb.
Shellac	1 lb.
<b>Combustible Fibers and Powders (Vegetable)</b>	
Pulverized Charcoal	5 lbs.
Cotton, Absorbent	5 lbs.
Lampblack	2 lbs.
Lycopodium	1 lb.
<b>Dangerously corrosive Acids</b>	
Glacial Acetic Acid	5 gals.
Hydrofluoric Acid	1 lb.
Hydrochloric Acid	12 gals.
Sulphuric Acid	12 gals.
Carbolic Acid	1 lb.
<b>Acids</b>	
Acid, Chromic	1 lb.
Acid, Nitric	12 gals.
<b>Peroxides</b>	
Hydrogen Peroxide, U.S.P.	0 lbs.
Sodium Peroxide	2 lbs.
Barium Peroxide	2 lbs.
Other Hydrogen Peroxides over 3 percent, not to exceed 15 percent	5 lbs.
<b>Chlorates</b>	
Potassium Chlorate	15 lbs.
<b>Permanganates</b>	
Potassium Permanganates	1 lb
<b>Nitrates</b>	
Barium Nitrate	1 lb.
Stontium Nitrate	1 lb.
Cobalt Nitrate	1 lb.
Copper Nitrate	1 lb.
Iron Nitrate, Ferric Mercury Nitrate (mercuric)	1 lb.
Mercury Nitrate (mercurous)	1 lb.
Potassium Nitrate	10 lbs.
Silver Nitrate	5 lbs.
Sodium Nitrate	15 lbs.
Other Metallic Nitrates	5 lbs.
<b>Metallic Oxides</b>	
Lead Oxide (red)	5 lbs.
Lead Oxide (Litharge)	10 lbs.
Oxide of Mercury red precipitate (mercuric)	10 lbs.

Revised on March 2024 (Apply/Pay)

<b>Hazardous materials</b>	<b>Maximum Quantities</b>
Oxide of Mercury; yellow precipitate (mercurous)	5 lbs.
<b>Substances Made Dangerous by Contact with Other Substances</b>	
Calcium Carbide	5 lbs.
Metallic Potassium	½ lb.
All other Metals of the Alkalies or Alkaline Earths	2 lbs.
Metallic Sodium	½ lb.
Zinc Dust	5 lbs.
Slaked Lime	25 lbs.

## APPENDIX VI. COMMON HAZARDOUS MATERIALS

In this appendix, the supplementary information of common hazardous materials in non-production chemical laboratory is covered.

### A. CORROSIVE MATERIALS



#### A. Storage and Use Requirements

Special care needs to be taken when storing acids. Minor spills and acid fumes can quickly corrode standard metal storage cabinets or soapstone countertops, for example. The best choice for storing acid containers is a chemically-resistant cabinet designed for that purpose, with polyethylene construction being the best choice. Polyethylene spill trays are also a very good idea, whether acids are stored on a bench top or in a cabinet. Containers of sodium bicarbonate or other suitable neutralizing or absorbing agents must be provided where more than 5 gallons are stored or used per laboratory or storage room and accessible in these storage areas at all times. Corrosives, if exposed to incompatible materials, can lead to dangerous reactions such as explosions, release of toxic gas, or extreme fire conditions. Compressed gas containers and systems should not be exposed to corrosive chemicals or fumes that could damage containers, valves or valve-protective caps. Acids and bases should not be stored or used near each other as their accidental combination could generate a huge amount of heat and energy, possibly resulting in an explosion.



unobstructed at all times.

When corrosive liquids are stored in excess of 5 gallons, special emergency showers must be installed in the laboratory/storage-room, or outside the laboratory within 25 feet of laboratory/storage-room entrance door. Store containers at a convenient height for handling, below eye level if possible. High shelving increases the risk of dropping containers and the severity of damage if a fall occurs. The showers are designed to quickly drench the individual in case of emergency. The Certificate of Fitness holder must make sure the showers remain accessible and

Handling and use of corrosive materials shall be located in accordance with the distances and exposures noted for storage.

## B. COMPRESSED AND LIQUEFIED GASES



### ADDITIONAL PERMITS AND CERTIFICATES OF FITNESS

**Quantities requiring a permit AND Supervision by a G-97 certificate of fitness holder:** When there are more than 60 gallons cryogenic containers in a storage area outside of the laboratory, permits and a G-97 Certificate of Fitness (Supervision of Commercial Cryogenic Systems and for Storage and Handling of Cryogenic Liquids) holder must be present.

#### A. General Requirement

Compressed gas containers are often used in the laboratory. All compressed gases are potential hazards because of the pressure within the container, their flammability, and/or their toxicity. The chemical is in gaseous form and pressurized, it can quickly contaminate a large area in the event of a leak.

#### (1) Labeling all compressed gas container clearly

**MARKING REQUIREMENTS**

178.36 to 178.68 Subpart C Specifications for Cylinders.

1. DOT or ICC marking may appear-new manufacture must read "DOT". 49CFR171.14  
"3AA" indicates spec in 49CFR178.37.  
"2015" is the marked service pressure.

2. Serial number-- no duplicates permitted with any particular symbol-- serial number combination.

3. Symbol of manufacturer, user, or purchaser.

4. "6 56" date of manufacture. Month and year.  
"C" disinterested inspector's official mark.

5. Plus mark (+) indicates cylinder may be 10% overcharged per 49CFR173.302(C).

6. Retest dates

7. 5 pointed star indicates ten year retest interval See 49 CFR173.34(e)(15).

**CAUTION:** This is a training aid and does not include all provisions of the regulations.

The contents of any compressed gas container must be clearly identified. Gas identification should be stenciled or stamped on the container or a label which shall be marked to show the authorizing code and its working pressure at 70°F. Do not rely

solely on the color of the container to identify the contents. Reject any container that is unmarked or has conflicting marking or labels.

(2) Refilling container

The practice of transferring compressed gases from one commercial container to another is not permitted.


**B. Use of Containers**

(1) Train Users

Before attempting to connect a container to a system, be certain that the personnel handling the containers are trained and knowledgeable regarding the product, container, fittings, equipment, and proper connection procedures.

(2) Regulator use

Containers, when in use, must be connected to gas delivery systems and a regulator instrument. The regulator system shall be equipped with two gauges installed so as to show both the pressure in the container and the pressure in the system.

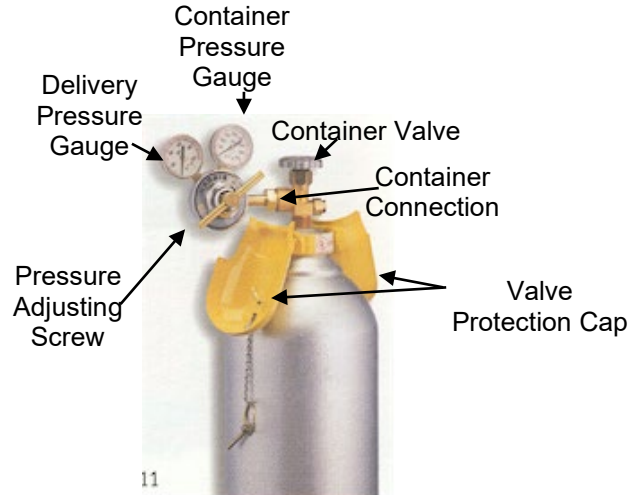

(3) Valves

Valves utilized on compressed gas systems shall be suitable for the use intended and shall be accessible. Valve handles or operators for required shutoff valves shall not be removed or otherwise altered to prevent access or hinder operation. Always open the valves slowly and only with the proper regulator in place. Valve protection caps should remain in place until ready to withdraw gas, or connect to a manifold. Before removing the regulator from the container, close the container valve first and release all pressure from the regulator.



(4) Eye protection

Always wear eye protection when working on or near compressed gas systems. Never let anyone without eye protection into any area where compressed gas are used or stored.


(5) Containers not in use

In order to decrease the potential hazards for the laboratory personnel, all not “in use” containers, except nominal 11b propane containers made for consumer use, shall be removed from the laboratory unit to a storage facility (“ in use” can include connected to a regulator; connected to a manifold; or an unconnected reserve stored alongside a connected container). Always shut off and have a container cap on any container that is not in use or is being stored.

**C. Storing Containers**

(1) Upright position

All containers must be secured from tipping over and shall be stored in an upright position and be equipped with a pressure regulator designed for the specific gas and marked for its maximum container pressure. You can use appropriate material, such as chain, plastic coated wire cable, commercial straps, etc., to secure containers. The only exception for storing the compressed gas containers in a horizontal position is those containers with an internal volume is less than 0.174 Cu. Ft. (e.g. lecture bottles).

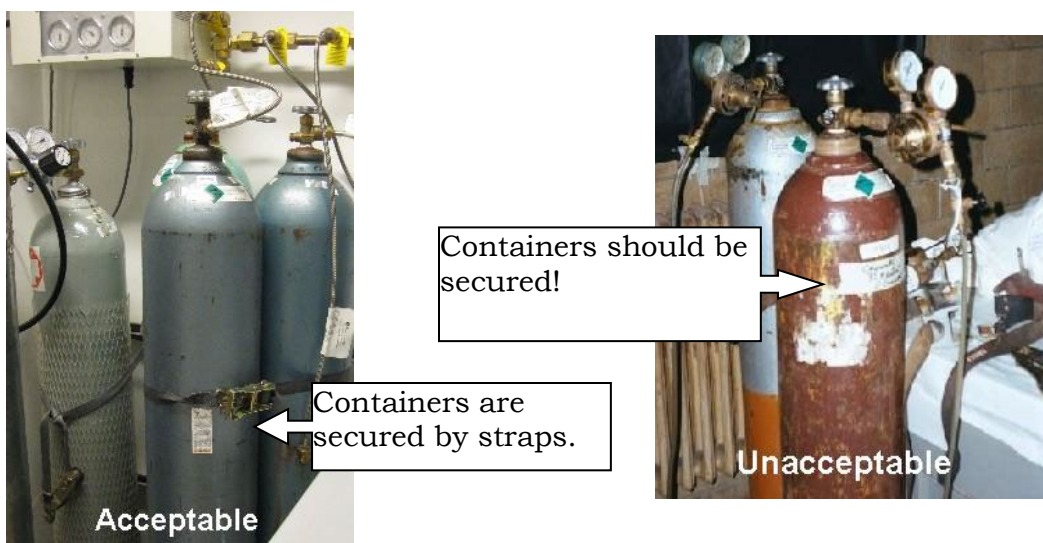

(2) Well-ventilated areas

Containers of all gases that have health hazard ratings of 3 or 4; or have a health hazard rating of 2 without physiological warning properties; or are pyrophoric gases shall be kept in a continuously mechanically ventilated hood or enclosure. The containers that are greater than lecture bottle size shall be kept in continuously mechanically ventilated gas cabinets.

(3) Separation from hazardous conditions

All compressed gas containers and systems in storage or use shall be away from materials and conditions that present potential hazards to them or to which they present potential hazards. Those containers shall be segregated in hazard classes while in storage, especially be separated from incompatible materials. It is recommended to group containers according to the type of gas (e.g. flammable, oxidizer, toxic or corrosive) or whether containers are full or empty, if they are stored



at the same location. Combustible waste shall be kept a minimum of 10 feet from compressed gas containers and systems. Generally, corridors are not designed for storage of compressed gases. However, there are circumstances when the Fire Department may allow this. Any corridor storage of compressed gases should be approved by the Fire Department prior to commencing such storage. Oxidizing gases shall not be stored/used or come in contact with oil, grease, or other petroleum base.

Generally, the compressed gas containers shall be kept away from

- Sources of ignition
- Temperature extremes (Above 125 degrees F or less than mean low atmospheric temperatures)
- Corrosive chemicals or fumes
- Falling objects
- Ledges, unprotected platforms, and elevators or other areas where the container could drop a distance exceeding one-half the height of the container

**D. Typical Internal Volume of Cylinders**

The following table provides information on the typical internal volume of cylinders:



Model	Nominal Dimension (Diameter x Length*, inch)	Internal Volume (Water volume, Cu. Ft.)
<b>TYPE</b>	<b>STANDARD CYLINDER SIZES AND CAPACITIES (NFPA 45)</b>	
Lecture Bottle	2 x 15	0.016
D	4.5 x 18	0.08
E	4.5 x 31	0.164
M	7 x 43	0.77
G	9 x 55	1.54
H	9 x 60	1.75
<b>LPG WEIGHT</b>	<b>COMMON LPG CONTAINER SIZES AND CAPACITIES</b>	
16.4 oz.	4¼ x 6¼	0.051
5 lbs.	9 ⅜ x 12½	0.192
20 lbs.	12 ⅛ x 20⅞	0.769
<b>TYPE</b>	<b>COMMON ACETYLENE CONTAINER SIZES AND CAPACITIES</b>	
B (40 SCF)	6 x 25	0.278
WC (110 SCF)	8½ x 33½	0.885
WK (330 SCF)	13 x 42	2.414

\* Includes valve and cap

**E. Compressed Gas Container Disposal or Return**

It is dangerous to empty a compressed gas container completely, a container is considered empty when the container pressure is at atmospheric pressure or 15 psia (pounds per square inch absolute) remaining. The empty containers shall be labeled with the word “empty” or the abbreviation “MT and the date”. Always handle empty containers as carefully as full ones; residual pressure can be dangerous.

Examples of the gas container tag

Container before use	Container in service	Empty container
 <p>Acceptable</p>	 <p>Acceptable</p>	 <p>Acceptable</p>

**F. Cryogenic Liquid**

(1) Safety Practices

Always handle cryogenic/refrigerated liquids carefully. At their extremely low temperatures, they can produce frostbite on the skin and exposed eye tissue. When spilled, they tend to cover a surface completely, cooling a large area. Delicate tissues, such as those of the eyes, can be damaged by exposure to these cold vapors, even when the contact has been so brief to affect the skin of the hands or face. Boiling and splashing always occurs when charging a warm container, or when inserting warm objects into a liquid. Always perform the operations slowly to minimize boiling and splashing. Never allow any unprotected part of the body to touch uninsulated pipes or vessels which contain cryogenic/refrigerated fluids. Even nonmetallic materials are dangerous to touch at low temperatures. Use tongs to withdraw objects dipped in a cryogenic/refrigerated liquid. Objects that are soft and pliable at room temperature, such as rubber or plastics, are easily broken because they become hard and brittle at extremely low temperatures. Carbon steels also become brittle at low temperatures and will easily break.

If severe spraying or splashing may occur, a face shield or chemical goggles should be worn for additional protection. Insulated gloves should always be worn when handling anything that comes in contact with cold liquids and vapors. Gloves should be loose fitting so that they can be removed quickly if liquids are spilled into them. Trousers should be left outside of boots or work shoes.

In the event of unlikely contact with a cryogenic/refrigerated liquid, a cold-contact burn may occur, which means that the skin tissue freezes. If this should occur, remove any clothing that may restrict the blood circulating to the frozen area. Do not rub frozen parts because the tissue may become damaged. Immerse the affected parts in warm water (105°F to 115°F). Never use dry heat. If possible, put the victim in a warm room. Obtain medical assistance as soon as possible.

Persons who work with cryogenic/refrigerated liquids, including handling, storage, and transfer operations should be trained in the:

1. nature and properties of cryogenics in both liquid and gaseous phases;
2. specific instructions on the equipment to be used;
3. approved materials that are compatible with the cryogenics;
4. use and care of protective equipment and clothing;
5. safety, first aid, and self aid when first aid and/or medical treatment is not available;
6. handling emergency situations such as fire, leaks, and spills;
7. good housekeeping practices are essential for the safety of personnel.

(2) Ventilation

All gases should be used and stored in well-ventilated areas. All of the gases except oxygen can cause a person to suffocate by replacing breathable air in an enclosed workplace. However, workers will not be aware of the presence of such gases without a tool to help them detect the gases. Therefore, an oxygen sensor equipped with an audible alarm must be installed to monitor the level of oxygen in the area when the total cryogenic gas capacity exceeds 60 gallons. In addition, all entrances to such areas should have prominent durable signs indicating danger due to extreme cold and possibility of rapid suffocation.

**C. HIGHLY TOXIC AND TOXIC MATERIALS**



**A. General Description**

Toxic chemicals are chemicals that can produce injury or death when inhaled, ingested, or absorbed through the skin. While damage may be acute or chronic the Fire Code is only concerned with acute lethality. The extent of lethality depends on the dose and duration of exposure. Exposure may enter the body through three routes: inhalation, ingestion, or contact with the skin and eyes.

For the purposes of the Fire Code, Toxic & Highly Toxic Material are defined in terms of LD50 values as follows.

**Summary Definitions Toxic & Highly Toxic**

	<b>Toxic</b>	<b>Highly Toxic</b>
Oral LD50 (albino rats)	50-500 mg/kg	<50 mg/kg
Skin Contact LD50 (albino rabbits)	200-1000 mg/kg	<200 mg/kg
Inhalation LC50 (albino rats) gas	200-2000 ppmv/air	<200 ppmv/air
Inhalation LC50 (albino rats) mists/dust	2-20 mg/L	<2 mg/L

For the purposes of Fire Code compliance, it is important to have supporting documentation regarding the toxicity of the specific materials being stored, handled or used. Generally this would be MSDS's. Care should be exercised when changing material vendors as the MSDS information may be different. It is the facility storing, handling or using these chemicals to know their toxicity and be able to demonstrate to

an inspector that the appropriate classification and handling procedures are being used.

The level of toxicity of Highly Toxic and Toxic Materials may be reduced by diluting such materials with other materials, such as water, to a degree that the resulting mixture may no longer be Highly Toxic or Toxic. For the purposes of Fire Code compliance, a mixture containing any amount of Highly Toxic and/or Toxic material is presumed to be a highly toxic or toxic material, as applicable, unless it is otherwise certified and labeled by the manufacturer.

Highly Toxic and Toxic Materials that are compressed gases can be referred to the section of this study guide, Part III-1 [COMPRESSED AND LIQUEFIED GASES], which follows requirements of the NFPA 45 and the New Fire Code Chapter 30 [Compressed Gases]. Additionally Highly Toxic and Toxic Materials that meet the definition of other hazard classes shall comply with those requirements also including New Fire Code Chapters 35 (Flammable Gases), 37 (Highly Toxic and Toxic Materials), 40 (Oxidizers) and 41 (Pyrophoric), as applicable.

## **B. Storage and Use Requirements (liquids/solids)**

The indoor and outdoor storage, handling or use of Highly Toxic and Toxic solids or liquids in amounts that do not exceed the maximum allowable quantity per control area shall be in accordance with the general provisions for hazardous materials and with the general provisions for Highly Toxic & Toxic Materials.

### **D. FLAMMABLE SOLID**



#### **A. General Description**

Many flammable solids may react violently or explosively on contact with water including water applied for extinguishment purposes (i.e., water fire extinguishers). They may also be ignited by friction, heat, sparks or flame. Some of these materials will burn with intense heat. Dusts or fumes may form explosive mixtures in air. Containers may explode when heated. Materials may re-ignite after fire is extinguished.

Fires may produce irritating, corrosive and/or toxic gases. Some of these materials may also be pyrophoric – spontaneously reacting with oxygen in air to ignite. Many flammable solids are metals. Oxides from metallic fires are a severe health hazard, inhalation or contact with substance or decomposition products may cause severe injury or death. Cutting some flammable solids can initiate a fire. For example, using a torch to cut titanium tubing will generate sufficient heat to ignite the material. Dry sand can usually be used to smother a fire involving flammable solids. Keep a container of sand near the work area.

## **E. OXIDIZERS AND ORGANIC PEROXIDES**



### **A. General Description**

#### **(1) Oxidizers**

Oxidizers are chemicals that release large amounts of oxygen. Because this class of compounds can act as an oxygen source, they can be unpredictable and dangerous during fire situation. Inorganic oxidizers can increase the danger of fire around flammable or combustible materials, while organic oxidizers are flammable in themselves. Oxidizers and organic peroxides are both considered “oxidizing materials” in that they provide oxygen to chemical and physical reactions. Some organic oxidizers can even explode when they are exposed to heat, shock or friction. Most oxidizer are corrosive and can irritate skin or lungs. In general, oxidizers shall be kept away with organic or combustible materials.

#### **(2) Organic peroxides**

Organic peroxide is a compound having a double oxygen or peroxy (-O-O-) in its chemical structure. The oxygen-oxygen linkage (-O-O-), a thermally sensitive and energetic bond, makes organic peroxides become relative unstable compounds which can decompose spontaneously and sometimes explosively. For example, if one liter of liquid with 100 ppm peroxides is distilled down to dryness and the residue explodes, the energy is roughly equivalent to good firecracker or a .22 caliber bullet charge (i.e., one kilo-Joule). This is the same energy as a 280 pound weight falling from a 30-inch height onto the floor or a change of two degrees Fahrenheit in a cup of water. Moreover, the decomposition of organic peroxide generally produces heat and by-products (e.g. free radicals, gases, mists) which can become uncontrolled and violent. Improper storage or handling could lead to an uncontrolled decomposition. All materials in the vicinity of organic peroxides should be investigated for compatibility, and segregated if necessary.

Solid oxidizers and organic peroxides are less likely to pose problems than liquids and gases due to their physical characteristics. However, special attention must be paid to the class of oxidizer and organic peroxides that may be found on the label accompanying the material, its MSDS (Material Safety Data Sheet), or through a phone call 1-800-CHEMTREC or to the manufacturer. For instance, greater care must be used in the storage of Class 4 oxidizers than with Class 1 oxidizers. Similarly, greater care must be used in the storage of Class I organic peroxides than with Class IV organic peroxides.

### **B. Storage and Use Requirements**

Solid oxidizers are less likely to pose problems than liquids and gases due to their physical characteristics. However, great care must be used in the handling and use of all oxidizing materials. In some respects, the hazard during handling may be significantly increased due to the potential absence of a suitable container. The use of these materials near potential fuels must be avoided. Fuels include paper, wood, and flammable liquids. Also of concern is the use of oxidizing materials near some acids, as a dangerous reaction may occur when these materials are mixed. All materials in

the vicinity of oxidizers and organic peroxides should be investigated for compatibility, and segregated if necessary.

All potential sources of ignition must be removed from the vicinity of oxidizers in use. “No smoking” signs must be posted prominently and no open flames – such as those associated with boilers or water heaters – are permissible where oxidizers and organic peroxides are used or stored.

#### (1)Oxidizers

It is important to understand that the conditions of acceptable storage for oxidizing materials are based upon their ability to cause combustible and flammable materials to ignite and burn, or explode. The fundamental and general rule is to keep fuels (including wood, paper, cardboard, flammable liquids and gases, metals, etc...) and sources of ignition away from the stored oxidizing materials.

Many oxidizing materials possess other hazards such as flammability, corrosivity and toxicity. Chlorine, for instance, is an oxidizer that is also both corrosive and toxic. Strong oxidizing materials, such as perchloric acid, shall not be heated by gas flames or oil baths. Adequate safety glasses must be worn at all times when handling oxidizing chemicals (ordinary glasses do not provide adequate protection). All hazards should be investigated prior to use and handling and steps taken to reduce the potential for problems, in accordance with the Fire Code.

In the event of an uncontrolled spill or release of a liquid, solid or gaseous oxidizing material, the area should be evacuated and notification to 911 made as soon as possible.

#### (2)Organic Peroxides

In general, great care of temperature and contamination must be used in handling or storing organic peroxides. The most important one is the control of the temperature. Whether handling or storing organic peroxides, if the temperature is maintained below its Self-Accelerating Decomposition Temperature, most uncontrollable reaction are avoided. In addition, where the required storage temperature range, as specified by the manufacturer, extends beyond normal ambient temperatures, high or low temperature limit switches, as applicable, shall be provided in addition to normal temperature controls. These limit switches shall actuate an alarm in a supervised area to ensure reporting to the Fire Department. In addition, contamination can lead to rapid decomposition too. Organic peroxides shall be stored in their original DOT shipping containers. Organic peroxides shall be stored in a manner to prevent contamination.

For any containers holding a peroxide-forming compound, label it with the words “Date received”, “Date opened” and “Expiration date”. Laboratory chemicals known to form peroxides have been categorized into three groups (Group A, Group B, Group C) based on their susceptibility to peroxide formation. The chemicals in Group A can form explosive peroxide levels even in an unopened container, and severe peroxide hazard after prolonged storage, especially after exposure to air. All have been responsible for fatalities. The chemicals in Group B have peroxide hazards on concentration. The chemicals in Group C, which are hazardous due to, peroxide initiation of autopolymerization. The peroxide-forming potential increases for liquids of Group C, especially for butadiene, chloroprene and tetrafluoroethylene, such that

these materials should be considered as a peroxide hazard. The sample chemicals in each group are listed in the following table.

Table. Peroxide-Forming Chemicals

SOURCE: Clark, D.E., Peroxides and Peroxide - Forming Compounds, *Chemical Health and Safety*, 2001, 8 (5), 12-21

<b>Group A</b>		
Butadiene <sup>a</sup>	Isopropyl ether	Sodium amide
Chloroprene <sup>a</sup>	Potassium amide	Tetrafluoroethylene <sup>a</sup>
Divinyl acetylene	Potassium metal	Vinylidene chloride
<b>Group B</b>		
Acetal	Diacetylene (butadiyne)	Methyl-isobutyl ketone
Acetaldehyde	Dicyclopentadiene	4-Methyl-2-pentanol
Benzyl alcohol	Diethylene glycol dimethyl ether (diglyme)	4-Penten-1-ol
2-Butanol	Diethyl ether	1-Phenylethanol
	Ethylene glycol ether acetates (cellosolves)	2-Phenylethanol
Chlorofluoroethylene	Furan	Tetrahydrofuran
Cumene (isopropylbenzene)	4-Heptanol	Tetrahydronaphthalene
Cyclohexene	2-Hexanol	Vinyl ethers
2-Cyclohexen-1-ol	Methyl acetylene	Other secondary alcohols
Cyclopentene		
Decahydronaphthalene (decalin)	3-Methyl-1-butanol	
<b>Group C</b>		
Butadiene <sup>b</sup>	Styrene	Vinyl chloride
Chlorobutadiene	Tetrafluoroethylene <sup>b</sup>	Vinyl pyridine
Chloroprene <sup>b</sup>	Vinyl acetate	Vinyladiene chloride
Chlorotrifluoroethylene	Vinyl acetylene	

a. When stored as a liquid monomer.

b. Can form explosive levels of peroxides when stored as liquid. When stored as gas, peroxide accumulation may cause autopolymerization.

## F. UNSTABLE REACTIVES (INSTABILITY HAZARD)



### A. General Description

In storing unstable reactive materials, care must be taken to ensure that the materials do not encounter any incompatible materials or conditions that could cause a reaction. Storage of temperature-sensitive materials requires the use of temperature controls. Whenever the chemical manufacturer or MSDS specifies a maximum/minimum storage temperature, the storage area must also have an emergency alarm that notifies personnel whenever the temperature falls below or exceeds the set point. These personnel must ensure notification to the Fire Department.

There are different storage considerations for “deflagrating” unstable reactives, as opposed to those for “non-deflagrating” unstable reactives. To determine whether or not a material is considered deflagrating, one must consult an MSDS or the chemical manufacturer.

Additionally, one must determine the class of unstable reactive by consulting an MSDS or by contacting the chemical manufacturer. The classes of unstable reactives are ordered in incrementally increasing hazard. A Class 4 unstable reactive, therefore, must be handled more carefully than a Class 1 unstable reactive.

### **B. Storage and Use Requirements**

The storage and use of these materials near incompatibles such as heat sources must be avoided. Material must be kept away from any possible fuel sources. Proper personal protective equipment must be worn at all times while handling these materials.

Many unstable materials possess other hazards such as flammability, corrosivity, and toxicity. Be sure to reference MSDS’s or manufacturer’s information for all materials prior to working with material. All hazards should be investigated prior to use and handling and steps taken to reduce the potential for problems, in accordance with the Fire Code. In the event of an uncontrolled spill or release of material, the area should be evacuated and notification made to 911 as soon as possible.


### **G. WATER-REACTIVE SOLID & LIQUIDS**



#### **A. General Description**

Water-Reactive chemicals react with the hydrogen and oxygen in water to create new combinations of chemicals and produce energy, resulting in an exothermic reaction. Water reactive materials often produce byproducts that may be ignited by the heat generated, thereby producing a flame or explosion. Water-reactive materials are often elemental metals in either whole or powder form. Examples include Potassium, calcium, and sodium.

The chemical equation below shows the reaction of elemental potassium with water. The heat generated by the reaction ignites the hydrogen gas, creating a bright flame.







A reaction of potassium metal with water.

Water-reactive materials are divided into Classes 1 through 3, with increasing levels of hazard from Class 1 to Class 3. To determine the class of the water-reactive material, one should consult the MSDS or call the chemical manufacturer.

### **B. Storage and Use Requirements**

In storing water reactive materials, care must be taken to ensure that the materials do not come in contact with any water or other incompatible materials.

The hazards presented by these materials in storage also exist during the use of these materials. The use of these materials near incompatibles such as heat sources and water must be avoided. Material must be kept away from any possible fuel sources. All water reactives should be managed under solvent or in an inert atmosphere.

Many water reactive materials possess other hazards such as flammability, corrosivity and toxicity. Be sure to reference MSDS' or manufacturer's information for all materials prior to working with material. All hazards should be investigated prior to use and handling and steps taken to reduce the potential for problems, in accordance with the Fire Code.

## **H. PYROPHORICS MATERIALS**

### **A. Storage and Use Requirements**

The handling and use of pyrophoric materials near incompatibles such as heat sources and water must be avoided. Material must be kept away from any possible fuel sources. All pyrophorics should be managed under inert gases, solvent or in an inert atmosphere. Compressed pyrophoric gas systems shall have approved emergency shutoff valves that can be activated at each point of use and each source. Proper personal protective equipment must be worn at all times while handling these materials.

Many pyrophorics possess other hazards such as flammability, corrosivity and toxicity. Be sure to reference MSDS' or manufacturer's information for all materials prior to working with material. All hazards should be investigated prior to use and handling and steps taken to reduce the potential for problems, in accordance with the Fire Code.

Appropriate fire extinguishing equipment must be present in each in areas where these materials are handled. Extinguishing agents include a Class D fire extinguisher and Metal X for metal fires.

Revised on March 2024 (Apply/Pay)

In the event of an uncontrolled spill or release of material, the area should be evacuated and notification made to 911 as soon as possible.

Manufacturing, storing, handling and/or using of detonable pyrophoric materials is prohibited in most cases. Always consult the Fire Code prior to conducting any activities with any of these materials.

Pyrophoric materials will often have very specific storage or handling requirements due to the volatile nature of the chemicals. It is important to consult the MSDS or to contact the chemical manufacture for specific guidelines. Some examples of pyrophoric materials include diethylaluminum chloride, lithium metal or silane gases.