


NYC 2014 Building Code Section 2702.1.7.2.1 Automatic Transfer Device Room

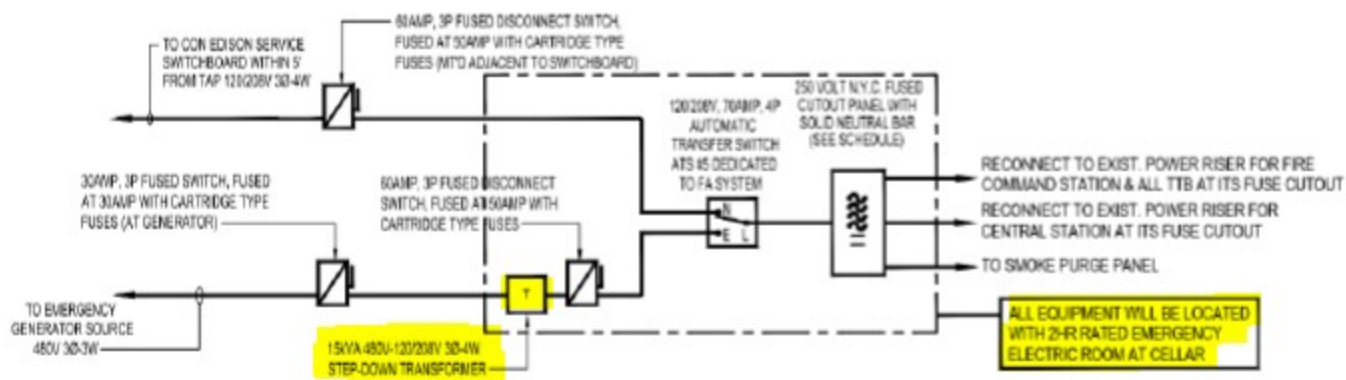

**DETAIL OF FIRE ALARM SYSTEM POWER SUPPLY
FROM 120/208V NORMAL AND 480V EMERGENCY SERVICES**

K.T.S.